



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBISC-13 Series
CBISCSAV2025 SERIES**




Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: August 23, 2023
Project Number: PV2312

WELDMENT AND BOLTING DETAIL

* OPTIONAL
WELD I.L.O.
BOLTED STUD

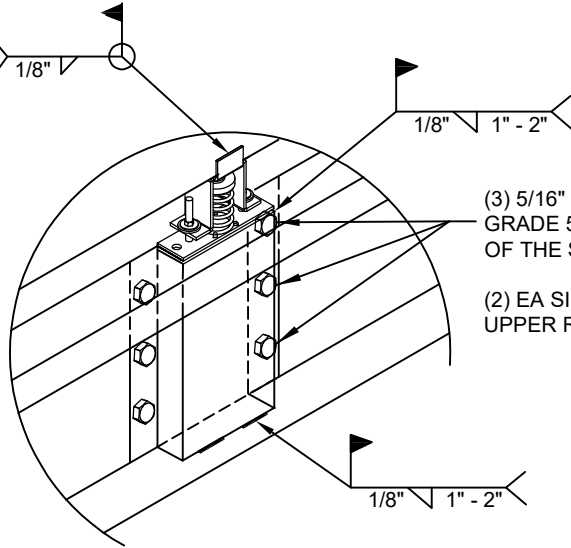

(3) 5/16" BOLTS
GRADE 5 EA SIDE
OF THE STIFFENER

(2) EA SIDE FOR
UPPER RAIL SUPPORT

BASE CURB SUPPORT


Note: * - INDICATES WELD REQUIRED I.L.O.
BOLTED STUD FOR THE FOLLOWING CURBS:

- LXL (CBISC-02)
- PRD3715 (CBISC-04)
- SAV1518 (CBISC-12)
- SAV2025 (CBISC-13)
- SAV28 (CBISC-14)

OPTIONAL BOTTOM
BUMPER FOR:
ISCALSLU180
ISCALSLM1830

FOR JQA/CQA:
5/16" Ø HOLE USE 1/2" Ø A307 BOLT
WITH FLAT WASHER AND NUT

FOR JQB, JQBX, JQE, JQF:
1 1/16" Ø HOLE USE 5/8" Ø A307 BOLT
WITH FLAT WASHER AND NUT

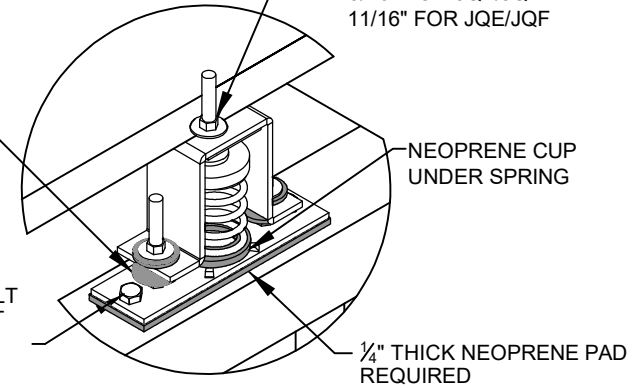

HOLE FOR ISOLATOR STUD,
W/ FLAT WASHER REQUIRED
UNDER NUT
7/16" FOR JQA/CQA
9/16" FOR JQB/JQBX
1 1/16" FOR JQE/JQF

NEOPRENE CUP
UNDER SPRING

1/4" THICK NEOPRENE PAD
REQUIRED

FOR BOLT ON ISOLATORS



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-61


DATE:
08/14/23

REV:
2

DRAWN BY:
FMM

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

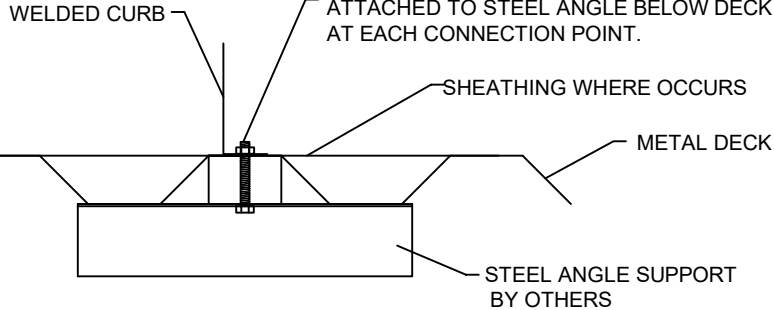


NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	3 @ 19.25" O.C.	2 @ 23" O.C.
LXL	3 @ 19.25" O.C.	2 @ 33" O.C.
SUN3672	4 @ 21" O.C.	2 @ 27.25" O.C.
PRD3715	6 @ 14.28" O.C.	3 @ 20.75" O.C.
PRS	4 @ 20.46" O.C.	2 @ 31.13" O.C.
PRL	5 @ 17.44" O.C.	2 @ 41.5" O.C.
SAV1518	6 @ 22.43" O.C.	3 @ 35.56" O.C.
SAV2025	7 @ 21.02" O.C.	3 @ 35.56" O.C.
SAV28	7 @ 23.75" O.C.	3 @ 35.56" O.C.

ASSUMES:

CONC SLAB
 $f_c = 4000$ PSI MINIMUM
6" MIN THICKNESS
NORMAL WEIGHT CONCRETE
MIN. 9-1/8" EDGE DISTANCE.

CONCRETE ATTACHMENT



Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

ROOF ANCHORAGE DETAIL
CBISC Series
LXS
LXL
SUN3672
PRD3715
PRS
PRL
SAV1518
SAV2025
SAV28

NO. OF ANCHORAGE BOLTS REQUIRED


CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	2 @ 23.0" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.50" O.C.
SUN3672	4 @ 21.0" O.C.	2 @ 27.25" O.C.
PRD3715	9 @ 8.92" O.C.	6 @ 8.30" O.C.
PRS	5 @ 15.34" O.C.	3 @ 15.56" O.C.
PRL	7 @ 11.63" O.C.	4 @ 13.83" O.C.
SAV1518	8 @ 16.02" O.C.	6 @ 14.23" O.C.
SAV2025	9 @ 15.77" O.C.	6 @ 14.23" O.C.
SAV28	10 @ 15.83" O.C.	6 @ 14.23" O.C.

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

WOOD ATTACHMENT

WELDED CURB

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø x 4.5" SIMPSON SDS SCREWS W/ 2.75" THREADED EMBED (SGMIN=0.50)



NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	8 @ 6.07" O.C.	5 @ 6.75" O.C.
LXL	7 @ 7.08" O.C.	7 @ 6.17" O.C.
SUN3672	9 @ 8.38" O.C.	5 @ 7.81" O.C.
PRD3715	15 @ 5.38" O.C.	10 @ 5.06" O.C.
PRS	10 @ 7.26" O.C.	6 @ 7.03" O.C.
PRL	12 @ 6.70" O.C.	8 @ 6.50" O.C.
SAV1518	15 @ 8.29" O.C.	10 @ 8.35" O.C.
SAV2025	18 @ 7.65" O.C.	10 @ 8.35" O.C.
SAV28	20 @ 7.71" O.C.	10 @ 8.35" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:

CB-62

DATE:
6/28/2023

REV:
4

DRAWN BY:
FMM

For wood, concrete and steel attachment see Roof Anchorage Detail, Form No. CB-62.

Welded isolation springs housing are standard. For bolted spring housing, neoprene pads and spring cups see Weldment and Bolting Detail, Form No. CB-61

CALCULATED VIBRATION ISOLATION ROOF CURBS SUNCHOICE UNITS



AV 20-25, AD 20-25, AE 13-15, AW 13-15, AH 18-20, AL 18-20, HV 15-20

FEATURES


- Roof curb base 12 ga.
- Roof curb upper rail 14 ga.
- Fully welded construction.
- Gasketing package provided.
- Heat treated wood nailer provided.
- Insulated deck pans provided.
- Pitched curbs and taller curbs are available.
- CalDyn OSHPd pre-approved seismic restraints. (OPM-0401-13), (CQA).

NOTES

- Attach ductwork to roof curb. Flanges of duct rest on top of the curb, Support ductwork below the curb.
- Thru the curb utilities are available. Contact your York distributor or Provent directly.

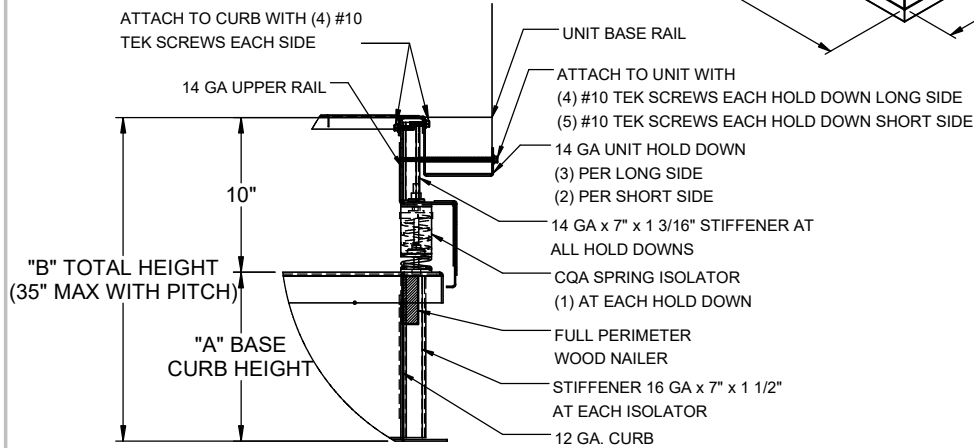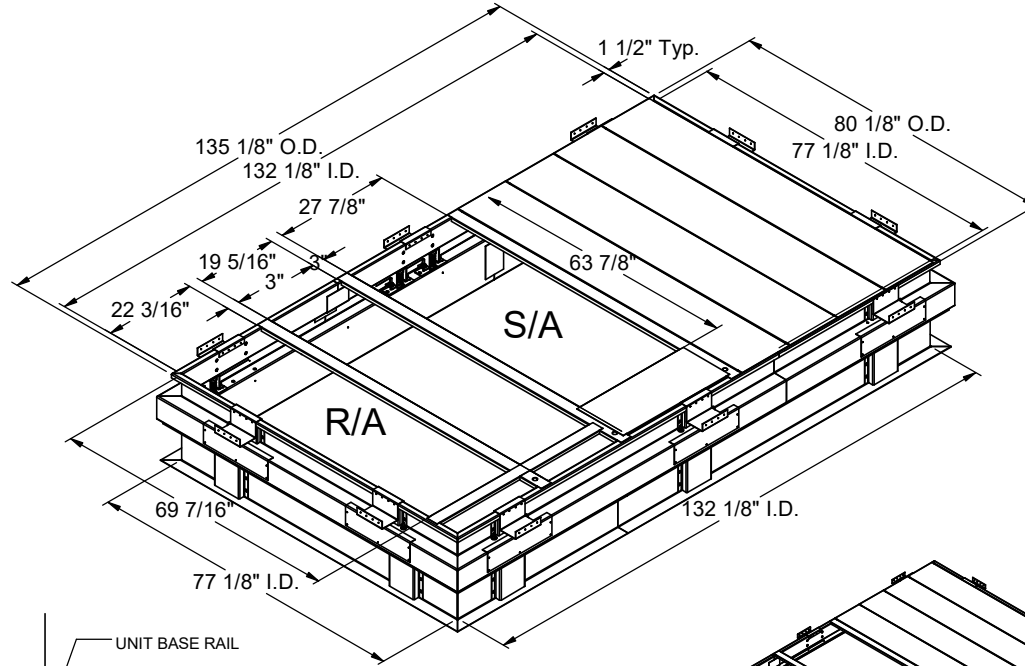

PROFILE DETAIL

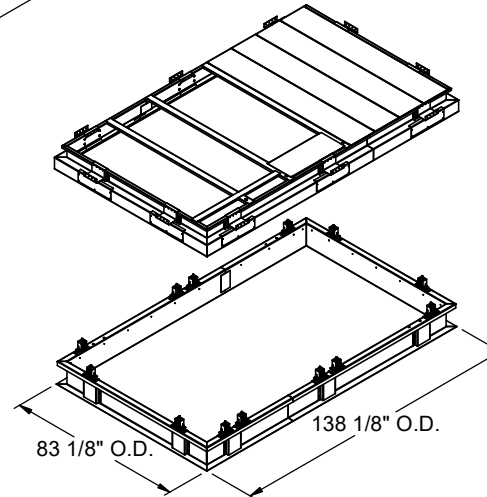

PROVENT P/N	A	B	EST. WEIGHT
CBISCSAV202518**	8"	18"	615 Lbs
CBISCSAV202521**	11"	21"	660 Lbs
CBISCSAV202524**	14"	24"	710 Lbs

**Note: Spring configuration must be added to part number at time of order

Weight of upper portion supported by spring isolators= 325 Lbs.

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021



3847 WABASH DRIVE
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____

COMPANY: _____

JOB NAME: _____

EQUIPMENT: _____

NOTES: _____

FORM NO: _____

CBISC-13

DATE: _____

8/14/2023

PART NUMBER: _____

CBISCSAV2025 SERIES

REV: _____

2

DRAWN BY: _____

FMM




Client:	ProVent	PV2312	Upper curb rail
Project:	CBISC-13	Iso Curb	CBISCSAV2025
Unit:	AV/AD 20-25; AE/AW 13-15; AH/AL 18-20; HV 15-20		

Upper Curb Information

Hcurb upper =	5.5	in	(Height of upper curb rail)
Lcurb =	135.125	in	(Length of upper curb)
wcurb =	80.125	in	(Width of upper curb)
WGTupper =	325	lbs	(Weight of upper curb)
# Clips long side =	3		
# Clips short side =	2		

Unit Information

WGTunit =	2655	lbs	(Weight of Unit)
Wtmax =	797	lbs	(Maximum corner weight)
Wtmin =	564	lbs	(Minimum corner weight)
Hunit =	57.25	in	(Height of unit above curb)
Hcm =	28.625	in	(Height to center of mass)
Lunit =	143.8125	in	(Length of unit)
Wunit =	88.75	in	(Width of unit)

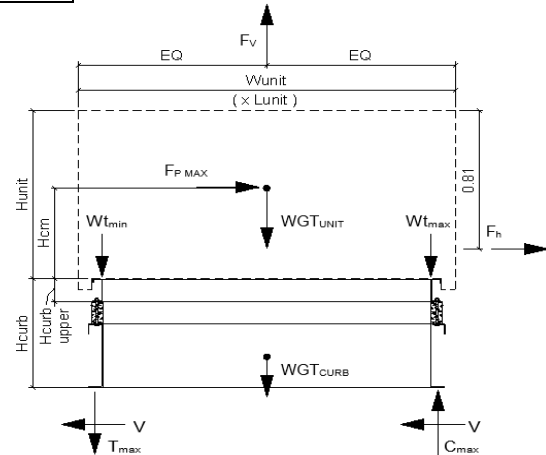

Seismic Loading - 2021 IBC/2022 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	5.130	(0.4*ap*Sds*Ip)*Wp <= 1.6*Sds*Ip*Wp
FpmaxASD =	9534	(0.7*Fpmax)
	(unit only)	
ap =	2.5	
Rp =	2	
FpmaxASD =	10701	lbs
	(unit + upper rail)	

Wind Loading - 2021 IBC/2022 CBC

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.00	(Max. assumed topographic factor)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
Ke =	1.00	(Ground Elevation Factor Table 26.9-1 ASCE 7-16)
V =	110	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	29.8	psf
Fh ASD trans =	2126	lbs
Fh ASD long =	1312	lbs
Fvert ASD =	2373	lbs
	= 0.00256*Kz*Kzt*Kd*Ke*V ² (Eq. 26.10-1 ASCE 7-16)	
	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)	
	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)	
	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)	

Upper Curb Loading

Transverse:		
Compression _{SEISMIC} =	5508	lbs
Tension _{SEISMIC} =	3089	lbs
Compression _{WIND} =	528	lbs
Tension _{WIND} =	1269	lbs

---> Negative values indicate opposite load.

Longitudinal:		
Compression _{SEISMIC} =	4121	lbs
Tension _{SEISMIC} =	1703	lbs
Compression _{WIND} =	47	lbs
Tension _{WIND} =	788	lbs

---> Negative values indicate opposite load.

Governing Reactions:

Transverse:		
Comp _{MAX} =	5508	lbs
(on long edge)	Tens _{MAX} =	3089
		lbs
Longitudinal:		
Comp _{MAX} =	4121	lbs
(on short edge)	Tens _{MAX} =	1703
		lbs

---> Negative values indicate opposite load.




Curb Design

F _y =	50 ksi	F _u =	65 ksi
E =	29500 ksi	t =	0.0713 14 Gauge

Calculate Section Properties of Curb

A' =	5.500 in	a =	5.144 in = A' - (2r + t)
B' =	1.500 in	a' =	5.429 in = A' - t
C' =	0.500 in (0 if no lips)	b =	1.233 in = B' - [r + t/2 + α(r + t/2)]
α =	0.500 (0 - no Lip; 1 w/ lip)	b' =	1.447 in = B' - (t/2 + αt/2)
R =	0.1069 (Inside bend radius)	c =	0.161 in = α[C' - (r + t/2)]
t =	0.0713 in	c' =	0.232 in = α(C' - t/2)
r' =	0.143 in = R + t/2	u =	0.224 in = πr/2
x =	0.292 in (Distance between centroid and web centerline)		
I _x =	2.515 in ⁴	rx =	2.04 in
I _y =	0.133 in ⁴	ry =	0.470 in
A =	0.60 in ²	r _{min} =	0.470 in

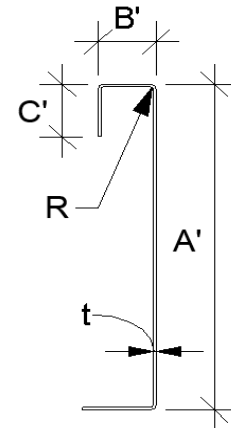

Axial Compression

P _a =	4.767 k	(Max Axial Comp)	Ω _c =	1.80
P _n /Ω _c =	4.957 k			
F _e =	16.90 ksi	$P_n = \frac{F_n A}{\Omega_c}$	$\lambda_c = \sqrt{\frac{F_y}{F_e}}$	$F_e = \frac{\pi^2 E}{(kl/r)^2}$
λ _c =	1.72	If λ _c ≤ 1.5; F _n = (0.658 ^{λ_c²) F_y}		
F _n =	14.82 ksi	If λ _c > 1.5; F _n = $\frac{0.877}{\lambda_c^2} F_y$		
L _y =	77.13 in	Lateral unbraced length		
k _y L _y /r _y =	131	(assume k=0.8)		

Compression Check = **O.K.**

Check Web Crippling

h =	5.5 in	-- Check limits:	C = 7.50	
t =	0.0713 in	h/t =	77.14 ≤ 260	C _R = 0.08
N =	7.00	N/t =	98.18 ≤ 210	C _N = 0.12
Ω _w =	1.75	N/h =	1.273 ≤ 2.0	C _h = 0.048
P _n =	1.947 k	R/t =	1.50 ≤ 12.0	
P _n /Ω _w =	1.112 k			
Long side: P _{Utrans} =	1.836 k	web stiffener REQ'D	# clips =	3
Short side: P _{ULong} =	2.061 k	web stiffener REQ'D	# clips =	2

$$P_n = C t^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}} \right) \left(1 + C_N \sqrt{\frac{N}{t}} \right) \left(1 - C_h \sqrt{\frac{h}{t}} \right)$$

Check Web Stiffener

	16Ga x 1 3/16in x 7in (C-channel)	P _n =	0.7(P _{wc} + A _e F _y) ≥ P _{wc}
width of stiffener =	7.000 in	ts =	0.0566 16 Gauge
web of stiff. w =	6.717 in	Rs =	0.0849 in
***Check w/ts ≤ 1.28√E/F _y		Ω _c =	1.70
w/ts =	118.675		
1.28√(E/F _y) =	31.091	--> w/ts over limit	Use C3.7.2
		P _n /Ω _c =	8.629 k

O.K.

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T _{crnmax} =	2675 lbs	Max(F _{pmaxASD} /4 -OR- F _{hASDtrans} /4 corner connections)	
V _{crnmax} =	2754 lbs	Max(Tens/2 -OR- Comp/2 corner connections per side)	
Bolt:	Tall = 2480 lbs	Vall = 1208 lbs	
Threaded Insert:	Tall = 2860 lbs	Vall = 1096 lbs	

of Bolts required for Tension = 1.1

of Bolts required for Shear = 2.5

of Bolts Used = 4.0

Check Combined Stress in Bolts & Inserts: 0.898 **O.K.**

Check 1/8" welded connection

<--- USE WELD


Ω = 2.35

$$\text{Assume } L/t > 25: 25 \cdot t = 1.783 \text{ in} \quad P_n/\Omega = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req} \quad L_{req'd} = \frac{V_{req} \Omega}{0.75 t F_u}$$

$$L_{req'd} = 1.862 \text{ in}$$



Connection Unit to Curb Clip		#10 SMS screw	$\Omega = 3.0$
$t_1 = 0.0713$ in (clip thickness)	$t_2/t_1 = 1.0$	$F_{u1} = 65$ ksi	
$t_2 = 0.0713$ in (unit base rail thickness)		$F_{u2} = 65$ ksi	
$d = 0.190$ in (screw diameter)	$d_w = 0.375$ in (nom. washer diameter)		
For $t_2/t_1 \leq 1.0$:		For $t_2/t_1 \geq 2.5$:	
Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$	$P_{ns} = 2266$ #	$P_{ns} = 2377$ #	
Tension: $P_{ns} = 2.7t_1dF_{u1}$	$P_{ns} = 2.38$ k	$P_{ns} = 2.7t_1dF_{u1}$	2.38 k
$P_{ns} = 2.7t_2dF_{u2}$	2.38 k	$P_{ns} = 2.7t_2dF_{u2}$	2.38 k
$P_{ns}/\Omega = 755$ #			
$P_{ss}/\Omega = 540$ # <- Controls		$P_{not} = 0.85t_c d F_{u2}$	
$P_{not} = 0.748$ k (screw pull-out strength)		$t_c = \min(t_1, t_2)$	
$P_{nov} = 2.607$ k (screw pull-over strength)		$P_{nov} = 1.5t_1 d_w F_{u1}$	
$P_{ts}/\Omega = 249$ # <- Controls			
$P_{ts}/\Omega = 820$ #			
	(full tensile screw capacity)		
	Shear (k)	# clips	V_{clip} (k)
Long side:	4.767	3	1.59
Short side:	4.767	2	2.38
			V_{allow} (lb)
			540 #
			540 #
			# screws
			4
			5
			spacing
			2.00 in
			1.50 in
	clip width (in) = 7.00		clip height = 2.5 in
	min spacing = 0.57 in		edge distance = 0.5 in (min. 1.5d)
Check Block shear rupture: O.K.		thinnest part = 0.0713	AISI BSR applies
$F_y = 50$ ksi		$\Omega = 2.22$ bolt/screw connection	
$A_{gv} = 0.463$ in ²		$A_{nv} = 0.402$ in ²	$A_{nt} = 0.082$ in ²
$R_n/\Omega = 8.674$ k		$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$	
		(AISI Sect. E5.3)	

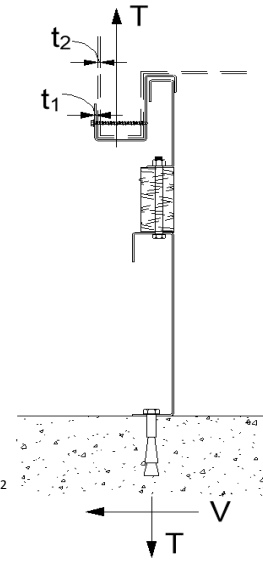

Curb Loads (copied from above)

Transverse:	$Comp_{MAX} = 6523$ lbs
(on long edge)	$Tens_{MAX} = 4139$ lbs
	$Shear_{MAX} = 10701$ lbs
Longitudinal:	$Comp_{MAX} = 4668$ lbs
(on short edge)	$Tens_{MAX} = 2284$ lbs
	$Shear_{MAX} = 10701$ lbs

Loads at each Isolator

Type: CQA

Transverse loading:	$Comp_{MAX} = 2174.4$ lbs
(on long edge)	$Tens_{MAX} = 1379.7$ lbs
# isolators: 3	$Shear_{MAX} = 1070.1$ lbs
Longitudinal loading:	$Comp_{MAX} = 2334.1$ lbs
(on short edge)	$Tens_{MAX} = 1142.1$ lbs
# isolators: 2	$Shear_{MAX} = 1070.1$ lbs

Max compression force on isolator: 2.334 k ≤ 3.176 k **O.K.**
 Max uplift on isolator: 1.380 k ≤ 3.176 k **O.K.**
 Max shear on isolator: 1.070 k ≤ 1.163 k **O.K.**

Forces on top bolt:

Tension = 1.380 k $d_b = 0.375$ in
 Shear = 1.070 k upper rail, $t = 0.0713$ in

Shear on curb rail:

$P_n = t_e F_u$ $\Omega = 2.00$ (Appendix A, Section E3.1 AISI)

Shear O.K.

$P_n/\Omega = 4.635$ k $e = 1.0$ in

Net section rupture:

$P_n = A_n F_t$ $\Omega = 2.22$ (Appendix A, Section E3.2 AISI)

$P_n/\Omega = 4.989$ k $A_n = 0.116$ in

N.S.R. O.K.

$F_t = (0.1 + 3d/s)F_u \leq F_u = 43.063$ ksi

Bolt Bearing Strength:

$P_n = C m_f d t F_u$ $\Omega = 2.50$ (Section E3.3.1 AISI)

$P_n/\Omega = 2.086$ k $d/t = 5.26$

Bearing O.K.

$C = 3.00$ $m_f = 1.00$

Shear and tension in bolt:

(Appendix A, Section E3.4 AISI)

Tension $P_{nt} = A_b F_{nt}$ $F_{nt} = 40.5$ ksi $A_b = 0.1104$ in²

$P_{nt}/\Omega = 1.988$ k **Bolt tension O.K.** $\Omega t = 2.25$ (Table E3.4-1, AISI)

Shear $P_{nv} = A_b F_{nv}$ $F_{nv} = 24.0$ ksi $\Omega v = 2.40$ (Table E3.4-1, AISI)

$P_{nv}/\Omega = 1.104$ k **Bolt shear O.K.**

Combined Shear and tension in bolt:

$F'_{nt} = 1.3F_{nt} - \frac{\Omega F_{nt}}{F_{nv}} f_v \leq F_{nt}$ $f_t = 12.49$ ksi $f_v = 9.69$ ksi **O.K.**

$P'_{nt}/\Omega = 0.658$ k $F'_{nt} = 13.41$ ksi $F_{nv}/\Omega = 10.00$ ksi

No Good - Use Welds

Longitudinal weld loading:

$L = 1.5P_n/\Omega = \frac{1}{\Omega} \left(1 - \frac{0.01L}{t_2} \right) L t_2 F_{u2} \geq V_{req}$ $\Omega = 2.55$

If $L/t < 25$: $L/t = 21.04$ $t = 0.0713$ $P_n/\Omega = 2.153$ k

Transverse weld loading:

$t = 0.0713$ $P_n/\Omega = \frac{1}{\Omega} t L F_u \geq T_{req}$ $\Omega = 2.35$

$L = 1$ $F_u = 65$ ksi $P_n/\Omega = 1.972$ k



Client:	ProVent	PV2312	Base curb
Project:	CBISC-13	Iso Curb	CBISCAV2025
Unit:	AV/AD 20-25; AE/AW 13-15; AH/AL 18-20; HV 15-20		

Base Curb Information

Hbase curb =	25	in	(Height of base curb)
Lcurb =	138.125	in	(Length of base curb)
wcurb =	83.125	in	(Width of base curb)
WGTbase =	385	lbs	(Weight of base curb)
# Springs long side =	3		# Springs short side = 2

Unit Information

WGUnit =	2655	lbs	(Weight of Unit)
Wt'max =	878	lbs	(Wtmax+1/4*WGUpper)
Wt'min =	645	lbs	(Wtmin+1/4*WGUpper)
Hunit =	57.25	in	(Height of unit above curb)
H'cm =	38.625	in	(Hcm+10"(upper+spring))
Lunit =	143.8125	in	(Length of unit)
Wunit =	88.75	in	(Width of unit)
WGUnit+upper+base =	3365	lbs	(Total weight)

Seismic Loading - 2021 IBC/2022 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	5.130 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	10701 lbs	(0.7*Fpmax)
	(unit + upper rail)	FpmaxASD = 12084 lbs (unit + upper rail + base curb)

Wind Loading - 2021 IBC/2022 CBC

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.00	(Max. assumed topographic factor)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
Ke =	1.00	(Ground Elevation Factor Table 26.9-1 ASCE 7-16)
V =	110	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	29.8 psf	= 0.00256*Kz*Kzt*Kd*Ke*V ² (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	3125 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hbase curb+10") (Eq. 29.4-2)
Fh ASD long =	1928 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hbase curb+10")
Fvert ASD =	2373 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Base Curb Loading

Transverse:

Compression _{SEISMIC} =	7288 lbs	= [FpmaxASD*H'cm+2*(1+0.14S _{DS})*Wt'max*wcurb]/wcurb
Tension _{SEISMIC} =	4610 lbs	= [FpmaxASD*H'cm-2*(0.6-0.14S _{DS})*Wt'min*wcurb]/wcurb
Compression _{WIND} =	1319 lbs	= [Fh ASD trans*H'cm+2*0.6*Wt'max*wcurb-Fvert ASD*wcurb/2]/wcurb
Tension _{WIND} =	1864 lbs	= [Fh ASD trans*H'cm-2*0.6*Wt'min*wcurb+Fvert ASD*wcurb/2]/wcurb

---> Negative values indicate opposite load.

Longitudinal:


Compression _{SEISMIC} =	5308 lbs	= [FpmaxASD*H'cm+2*(1+0.14S _{DS})*Wt'max*Lcurb]/Lcurb
Tension _{SEISMIC} =	2630 lbs	= [FpmaxASD*H'cm-2*(0.6-0.14S _{DS})*Wt'min*Lcurb]/Lcurb
Compression _{WIND} =	406 lbs	= [Fh ASD long*H'cm+2*0.6*Wt'max*Lcurb-Fvert ASD*Lcurb/2]/Lcurb
Tension _{WIND} =	951 lbs	= [Fh ASD long*H'cm-2*0.6*Wt'min*Lcurb+Fvert ASD*Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

Governing Reactions:

Transverse:	Comp _{MAX} =	7288 lbs	---> Along long edge of curb.
(on long edge)	Tens _{MAX} =	4610 lbs	---> Along long edge of curb.
Longitudinal:	Comp _{MAX} =	5308 lbs	---> Along short edge of curb.
(on short edge)	Tens _{MAX} =	2630 lbs	---> Along short edge of curb.

---> Negative values indicate opposite load.

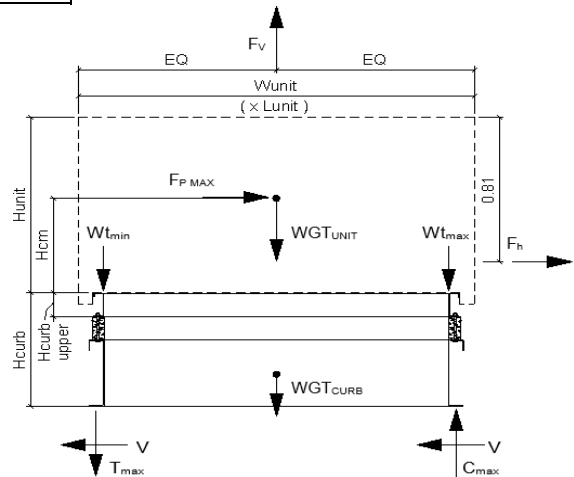




Curb Design

F_y = 50 ksi F_u = 65 ksi
E = 29500 ksi t = 0.1017 12 Gauge

Calculate Section Properties of Curb

A' = 25.000 in	a = 24.492 in = A' - (2r + t)
B' = 1.750 in	a' = 24.898 in = A' - t
C' = 1.000 in (0 if no lips)	b = 1.242 in = B' - [r + t/2 + α(r + t/2)]
α = 1.000 (0 - no Lip; 1 w/ lip)	b' = 1.648 in = B' - (t/2 + αt/2)
R = 0.1525 (Inside bend radius)	c = 0.746 in = α[C' - (r + t/2)]
t = 0.1017 in	c' = 0.949 in = α(C' - t/2)
r' = 0.203 in = R + t/2	u = 0.319 in = πr/2
x = 0.187 in (Distance between centroid and web centerline)	
I _x = 205.037 in	r _x = 8.23 in
I _y = 0.672 in	r _y = 0.471 in
A = 3.02 in ²	r _{min} = 0.471 in

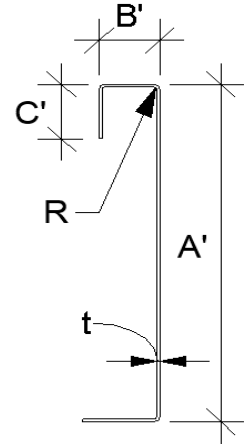

Axial Compression

P_u = 5.351 k (Max Axial Comp) Ω_c = 1.80
P_n/Ω_c = 7.812 k
F_e = 5.30 ksi $\lambda_c = \frac{F_y}{F_e}$ $F_e = \frac{\pi^2 E}{(kl/r)^2}$
λ_c = 3.07 If λ_c ≤ 1.5; F_n = (0.658λ_c²)F_y
F_n = 4.65 ksi If λ_c > 1.5; F_n = $\frac{0.877}{\lambda_c^2} F_y$
L_y = 138.13 in Lateral unbraced length
k_yL_y/r_y = 234 (assume k=0.8)

Compression Check = **O.K.**

Check Web Crippling

h = 25 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.1017 in	h/t = 245.82 ≤ 260	C _R = 0.14	
N = 7.00	N/t = 68.83 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.28 ≤ 2.0	C _h = 0.02	
P _n = 4.106 k	R/t = 1.50 ≤ 9.0		
P _n /Ω _w = 2.346 k			
Long side: P _{uTrans} = 2.429 k	web stiffener REQ'D # clips = 3	$P_n = C t^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}} \right) \left(1 + C_N \sqrt{\frac{N}{t}} \right) \left(1 - C_h \sqrt{\frac{h}{t}} \right)$	
Short side: P _{uLong} = 2.654 k	web stiffener REQ'D # clips = 2		

Check Web Stiffener

16Ga x 1.5in x 7in (C-channel)

width of stiffener = 7.000 in t_s = 0.0566 16 Gauge
web of stiff. w = 6.717 in R_s = 0.0849 in
***Check w/t_s ≤ 1.28E/F_{ys} Ω_c = 1.70
w/t_s = 118.675
1.28E/F_{ys} = 31.091 --> w/t_s over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc} A_e = 0.380 in²
P_{wc} = 4.106 k
P_n = 16.181 k
P_n/Ω_c = 9.518 k **O.K.**

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T_{crnmax} = 3021 lbs Max(F_{pmaxASD}/4 -OR- F_{hASDtrans}/4 corner connections)
V_{crnmax} = 3644 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)
Bolt: T_{all} = 2480 lbs V_{all} = 1208 lbs
Threaded Insert: T_{all} = 2860 lbs V_{all} = 1096 lbs
of Bolts required for Tension = 1.2
of Bolts required for Shear = 3.3
of Bolts Used = 5.0
Check Combined Stress in Bolts & Inserts: 0.909 **O.K.**

Check 1/8" welded connection

---- USE WELD

Ω = 2.35

Assume L/t > 25: 25*t = 2.543 in $P_n/\Omega = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$ $L_{req'd} = \frac{V_{req} \Omega}{0.75 t F_u}$
L_{req'd} = 1.727 in



Curb Loads (copied from upper rail calcs)

Transverse: (on long edge)	Comp _{MAX} =	6523	lbs
	Tens _{MAX} =	4139	lbs
	Shear _{MAX} =	10701	lbs
Longitudinal: (on short edge)	Comp _{MAX} =	4668	lbs
	Tens _{MAX} =	2284	lbs
	Shear _{MAX} =	10701	lbs

Max compression force on isolator: 2.334 k ≤ 3.176 k **O.K.**
 Max uplift on isolator: 1.380 k ≤ 3.176 k **O.K.**
 Max shear on isolator: 1.070 k ≤ 1.163 k **O.K.**

Forces on bottom bolts:

$d_b = 0.5$ in
 base curb, $t = 0.1017$ in
 Tension = 0.690 k / bolt
 Shear = 0.535 k / bolt

Shear on base curb:
 $P_n = t_e F_u$
 $P_n / \Omega = 6.611$ k

Shear O.K.

Net section rupture:
 $P_n = A_n F_t$
 $P_n / \Omega = 8.428$ k

N.S.R. O.K.

Bolt Bearing Strength:
 $P_n = C m_f d t F_u$
 $P_n / \Omega = 3.966$ k

Bearing O.K.

Shear and tension in bolt:

Tension
 $P_{nt} = A_b F_{nt}$
 $P_{nt} / \Omega = 3.927$ k
 Shear
 $P_{nv} = A_b F_{nv}$
 $P_{nv} / \Omega = 2.209$ k

(Appendix A, Section E3.4 AISI)

$F_{nt} = 45.0$ ksi

$A_b = 0.1963$ in²

Bolt tension O.K.

$F_{nv} = 27.0$ ksi

$\Omega_v = 2.40$

Bolt shear O.K.

*** (Table E3.4-1, AISI) ***

Combined Shear and tension in bolt:

$$F'_{nt} = 1.3 F_{nt} - \frac{\Omega F_{nt}}{F_{nv}} f_v \leq F_{nt}$$

$$P'_{nt} = A_b F'_{nt}$$

$f_t = 7.03$ ksi

$f_v = 2.73$ ksi

$F'_{nt} = 45.00$ ksi

$F_{nv} / \Omega = 11.25$ ksi

$P'_{nt} / \Omega = 3.927$ k

Combined Not Applicable -> $F'_{nt} = F_{nt}$

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6 - 0.14 S_{DS}) D + 0.7 E$

WIND: $0.6 D + W$

Transverse:	Uplift _{MAX} =	8777 lbs	Shear _{MAX} =	6042 lbs
Compression _{SEISMIC} =	11469 lbs	=[F _{pmax} ASD*(H'cm+Hbase curb)+(1+0.14S _{DS})*WGT _{unit+upper+base} *wcurb/2]/wcurb		
Tension _{SEISMIC} =	8777 lbs	=[F _{pmax} ASD*(H'cm+Hbase curb)-(0.6-0.14S _{DS})*WGT _{unit+upper+base} *wcurb/2]/wcurb		
Compression _{WIND} =	2215 lbs	=[F _{h ASD trans} *(H'cm+Hbase curb)+0.6*WGT _{unit+upper+base} *wcurb/2-F _{vert ASD} *wcurb/2]/wcurb		
Tension _{WIND} =	2569 lbs	=[F _{h ASD trans} *(H'cm+Hbase curb)-0.6*WGT _{unit+upper+base} *wcurb/2+F _{vertASD} *wcurb/2]/wcurb		
Longitudinal:	Uplift _{MAX} =	5094 lbs	Shear _{MAX} =	6042 lbs
Compression _{SEISMIC} =	7786 lbs	=[F _{pmax} ASD*(H'cm+Hbase curb)+(1+0.14S _{DS})*WGT _{unit+upper+base} *Lcurb/2]/Lcurb		
Tension _{SEISMIC} =	5094 lbs	=[F _{pmax} ASD*(H'cm+Hbase curb)-(0.6-0.14S _{DS})*WGT _{unit+upper+base} *Lcurb/2]/Lcurb		
Compression _{WIND} =	711 lbs	=[F _{h ASD long} *(H'cm+Hbase curb)+0.6*WGT _{unit+upper+base} *Lcurb/2-F _{vert ASD} *Lcurb/2]/Lcurb		
Tension _{WIND} =	1065 lbs	=[F _{h ASD long} *(H'cm+Hbase curb)-0.6*WGT _{unit+upper+base} *Lcurb/2+F _{vertASD} *Lcurb/2]/Lcurb		

Wood Attachment: 1/4" φ x 4.5" Simpson SDS screws w/ 2.75" threaded emb (SGmin = 0.43)

	Tall _{metal} =	997	lbs	Vall _{metal} =	1097	lbs
<u>Transverse:</u>	Tall _{wood} =	760	lbs	Vall _{wood} =	672	lbs
# of Screws Req'd for Uplift =	11.55					
# of Screws Req'd for Shear =	8.99					
Total # of screws required =	18					
				COMBINED LOADING:		
				Req'd Min Spacing =		



Use 18 - 1/4" φ x 4.5" Simpson SDS screws @ 7.7 in o.c. along long side of curb w/ 2.75" threaded embed

Loads at each Isolator

Type:

CQA

Transverse loading: (on long edge) # isolators: 3	Comp _{MAX} =	2174.4	lbs
	Tens _{MAX} =	1379.7	lbs
	Shear _{MAX} =	1070.1	lbs
Longitudinal loading: (on short edge) # isolators: 2	Comp _{MAX} =	2334.1	lbs
	Tens _{MAX} =	1142.1	lbs
	Shear _{MAX} =	1070.1	lbs

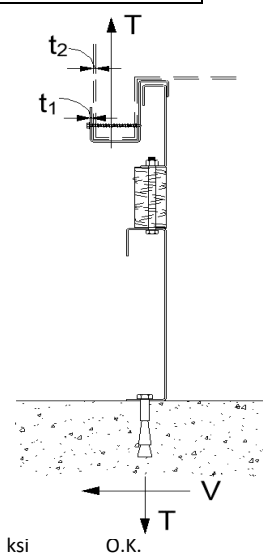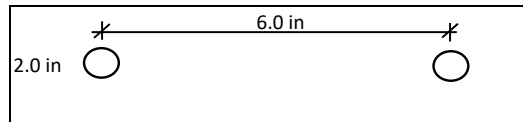



Longitudinal:

of Screws Req'd for Uplift = 6.70
of Screws Req'd for Shear = 8.99
Total # of screws required = 10

COMBINED LOADING: 0.991 O.K.
Screw Spacing = 8.35 in o.c.

Use 10 - 1/4" ϕ x 4.5" Simpson SDS screws @ 8.3 in o.c. along short side of curb w/ 2.75" threaded embed

Steel Deck Attachment: 1/2" ϕ A307 Bolts to steel angle below deck

Transverse: Tall_{bolt} = 3927 lbs Vall_{bolt} = 2209 lbs
Tall_{metal} = 2086 lbs Vall_{metal} = 2192 lbs
of Bolts Req'd for Uplift = 4.21 COMBINED LOADING: 0.877 O.K.
of Bolts Req'd for Shear = 2.76 Bolt Spacing = 21.02 in o.c.
Total # of bolts required = 7

Use 7 - 1/2" ϕ A307 Bolts to steel angle below deck @ 21 in o.c. along long side of curb

Longitudinal:

of Bolts Req'd for Uplift = 2.44 COMBINED LOADING: 0.624 O.K.
of Bolts Req'd for Shear = 2.76 Bolt Spacing = 35.56 in o.c.
Total # of bolts required = 3

Use 3 - 1/2" ϕ A307 Bolts to steel angle below deck @ 35.6 in o.c. along short side of curb

For Concrete anchorage: SEISMIC (0.6-0.14S_{DS})D + 0.7Q_o E $\Omega_o = 2.5$

Concrete Attachment: 0.625in ϕ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 4in embed

Epoxy: Hilti HIT-HY 200 V3 (ICC ESR 4868)

f'_c = 4000 psi
h = 6 in (concrete thickness, $t_{min} = h_{ef} + 2d_o$) O.K.
 h_{ef} = 4 in (effective embedment)
da = 0.625 in (anchor diameter) do = 0.75 in (hole diameter)
n = 5 (number of dummy anchors to check capacity with spacing effect)
s = 14 in (initial spacing estimate)
tk_{cr} / uncr = 1170 2220 psi (from ESR 4868, Table 14, Temp range B)
tk_{cr} / uncr = 1226 2327 psi If $f'_c > 2500$, multiply by $(f'_c/2500)^{0.1}$
 $c_{Na} = 9.0625$ in (min. edge distance for full capacity); $c_{Na} = 10d_a \sqrt{\frac{\tau_{uncr}}{1100}}$

Tension:

Bond strength
***Bond strength
will govern over
concrete breakout

$$N_{ag} = \frac{A_{Na}}{A_{Na0}} \phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} N_{ba} \quad (\text{ACI318-14, 17.4.5.1b})$$

$$\phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} = 1.0$$

$$A_{Na} = 1343.52 \text{ in}^2$$

$$A_{Na0} = 328.52 \text{ in}^2$$

$$N_{ba} = 9535 \text{ lbs}$$

$$N_{ag} = 38995 \text{ lbs (group)}$$

$$\phi N_{ag} = 19010 \text{ lbs (group)}$$

$$N_{ba} = \lambda_a \tau_{cr} \pi d_a h_{ef} \alpha_{n,seismic} \quad \alpha_{n,seismic} = 0.99$$

$$\lambda_a = 1.0$$

$$\lambda_a = 1.0 \text{ for normal weight conc; } 0.6 \text{ for lightw}$$

Breakout strength

$$N_{cbg} = \frac{A_{Nc}}{A_{Nco}} \phi_{ec,N} \phi_{ed,N} \phi_{cp,N} N_b$$

$$A_{Nc} = 816 \text{ in}^2$$

$$A_{Nco} = 144 \text{ in}^2$$

$$N_{cbg} = 48741 \text{ lbs (group)}$$

$$\phi N_{cbg} = 27417 \text{ lbs (group)}$$

$$N_b = \lambda_a k_c \sqrt{f'_c} h_{ef}^{1.5}$$

$$N_b = 8601 \text{ lbs}$$

$$k_c = 17$$

$$\phi_{conc} = 0.75$$

$$\phi_{bond} = 0.65$$

$$\phi_{seis} = 0.75$$

$$\phi_{steel} = 0.65$$

Shear:

Steel strength

$$V_{sa,eq} = 7865 \text{ (from ESR4868, Table 11)}$$

$$\phi V_{sa,eq} = 3067$$

$$\alpha_{v,seismic} = 0.6$$

$$Tall_{LRFD} = 3802 \text{ lbs (anchor)}$$

$$Vall_{LRFD} = 3067 \text{ lbs}$$

$$\alpha = (1 + 0.2SDS)D + 2.5E = 1.421$$

$$Tall_{ASD} = Tall_{LRFD} / \alpha = 2225 \text{ lbs}$$

$$Vall_{ASD} = Vall_{LRFD} / \alpha = 1795 \text{ lbs}$$

$$D = 0.758 \quad E = 0.242 \quad \alpha = 1.709$$

Transverse: Uplift_{MAX} = 11938 lbs Shear_{MAX} = 15105 lbs

$$\text{Compression}_{SEISMIC} = 14747 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Tension}_{SEISMIC} = 11938 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Shear}_{SEISMIC} = 15105 \text{ lbs} = \Omega_o * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 5.36 \text{ spacing} = 25.23 \text{ in o.c.}$$

$$\text{T applied} = 1326.5 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 8.41 \text{ spacing} = 15.77 \text{ in o.c.}$$


$$\text{V applied} = 1007.0 \text{ lbs}$$

Try using 9 bolts
spaced at 15.77 in o.c.

$$\text{COMBINED LOADING} = \frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.16 \text{ O.K.}$$

Use 9 - 0.625in ϕ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 15.8 in o.c. max. along long side of curb w/ 4in embed

Longitudinal: Uplift_{MAX} = 6988 lbs Shear_{MAX} = 15105 lbs

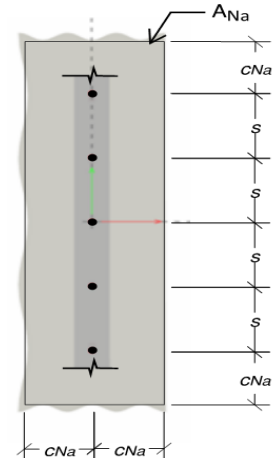



MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
(619)727-4800
Page 8 of 8

$$\begin{aligned}
 \text{Compression}_{\text{SEISMIC}} &= 9797 \text{ lbs} &= [\Omega_o * F_{\text{pmaxASD}} * (H_{\text{cm}} + H_{\text{curb}}) + (1 + 0.14 S_{\text{DS}}) * WGT_{\text{unit+curb}} * L_{\text{curb}} / 2] / L_{\text{curb}} \\
 \text{Tension}_{\text{SEISMIC}} &= 6988 \text{ lbs} &= [\Omega_o * F_{\text{pmaxASD}} * (H_{\text{cm}} + H_{\text{curb}}) - (0.6 - 0.14 S_{\text{DS}}) * WGT_{\text{unit+curb}} * L_{\text{curb}} / 2] / L_{\text{curb}} \\
 \text{Shear}_{\text{SEISMIC}} &= 15105 \text{ lbs} &= \Omega_o * F_{\text{pmaxASD}} / 2 \\
 \text{Min Bolts Req'd Uplift} &= 3.14 \text{ spacing} = 23.71 \text{ in o.c.} & \text{Applied} = 1164.7 \text{ lbs} \\
 \text{Min Bolts Req'd Shear} &= 8.41 \text{ spacing} = 8.89 \text{ in o.c.} & \text{Applied} = 1007.0 \text{ lbs} \\
 \text{Try using } 6 \text{ bolts spaced at } 14.23 \text{ in o.c.} & \text{COMBINED LOADING} = \frac{T_{\text{applied}}}{T_{\text{allow, ASD}}} + \frac{V_{\text{applied}}}{V_{\text{allow, ASD}}} \leq 1.2 & = 1.08 \text{ O.K.}
 \end{aligned}$$

Use 6 - 0.625in ϕ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 14.2 in o.c. max. along short side of curb w/ 4in embed

CURB DESIGN SUMMARY:		CBISC-13	CBISCSAV2025	Unit:	AV/AD 20-25; AE/AW 13-15;
UPPER CURB RAIL THICKNESS:		0.1017 in	12 Gauge	AH/AL 18-20; HV 15-20	
UNIT CLIP THICKNESS:		0.0713 in	14 Gauge		
# OF CLIPS (LONG SIDE) - 3 clips with 4 - #10 SMS screws each clip					
WEB STIFFENER: 16Ga x 1 3/16in x 7in (C-channel) stiffener at each clip					
# OF CLIPS (SHORT SIDE) - 2 clips with 5 - #10 SMS screws each clip					
WEB STIFFENER: 16Ga x 1 3/16in x 7in (C-channel) stiffener at each clip					
VIBRATION ISOLATOR TYPE: CQA		Top stud diameter: 3/8		(3) - CQA Isolators long side	
Anchor bolt diameter: 1/2		Anchor hole diameter: 9/16		(2) - CQA Isolators short side	
BASE CURB THICKNESS: 0.1017 in 12 Gauge				***Must weld top of CQA***	
WEB STIFFENER: 16Ga x 1.5in x 7in (C-channel) stiffener at each clip on base curb					
CORNER CONNECTION: Use minimum 5 - 1/4" ϕ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts					
CURB ANCHORAGE	<u>WOOD</u>		<u>STEEL</u>		<u>CONCRETE</u>
	1/4" ϕ x 4.5" Simpson SDS screws w/ 2.75" threaded embed (SGmin =		1/2" ϕ A307 Bolts to steel angle below deck		0.625in ϕ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 4in embed
	<u>LONG DIRECTION</u>		18 @ 7.65 in o.c.		7 @ 21.02 in o.c.
	<u>SHORT DIRECTION</u>		10 @ 8.35 in o.c.		3 @ 35.56 in o.c.
				9 @ 15.77 in o.c.	
				6 @ 14.23 in o.c.	