




**MOUR GROUP**  
ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
619-727-4800

**Structural Calculations**  
**for**  
**CBKD-153 Series**  
KDKITLXL

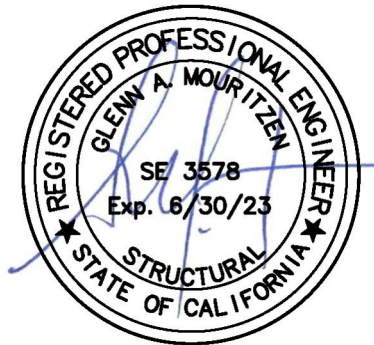

**Prepared for:**

**PROVENT / RRS**

**3847 Wabash Drive**  
**Mira Loma, CA 91725**

**Date: October 1, 2021**

**Project Number: PV2101**

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-60

**STRUCTURALLY CALCULATED HOLD DOWN CLIPS FOR KNOCK-DOWN ROOF CURBS FOR YORK UNITS**







ProVent P/N	A	WEIGHT
CBKDLXL08	8"	53 Lbs
CBKDLXL11	11"	64 Lbs
CBKDLXL14	14"	75 Lbs

SEISMIC KIT P/N	WEIGHT
KDKITLX	5 Lbs

Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

**P\*\*\*B ALL MODELS**

Meets seismic requirements for the following codes:  
CBC 2019  
IBC 2018

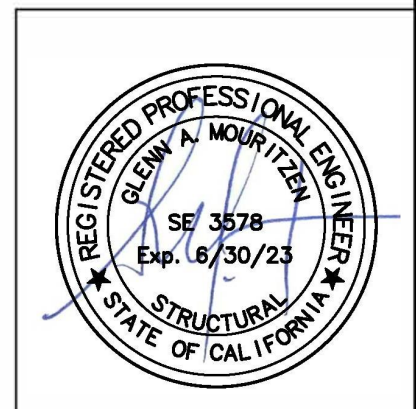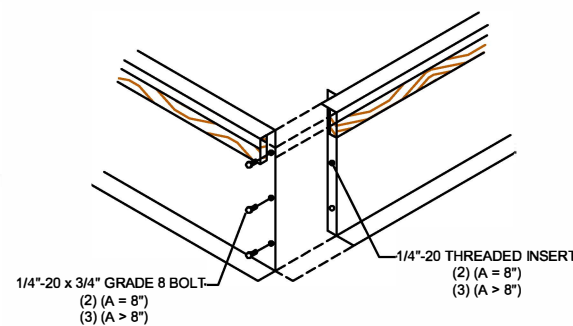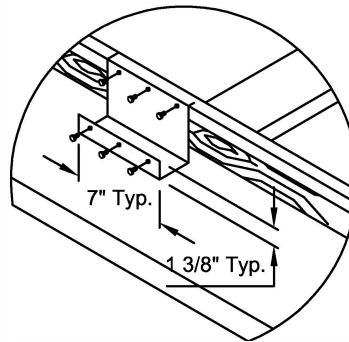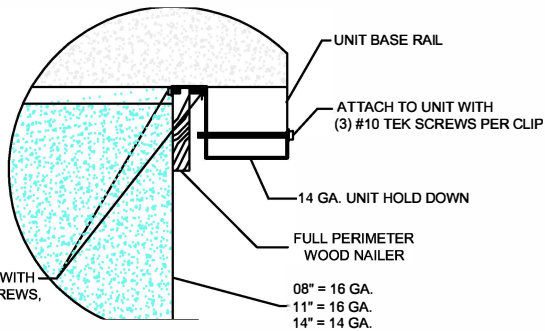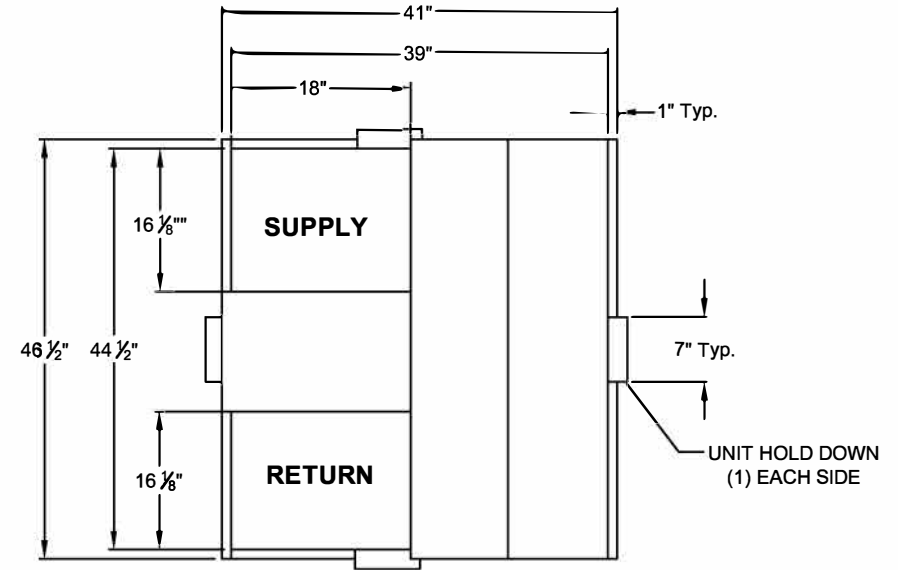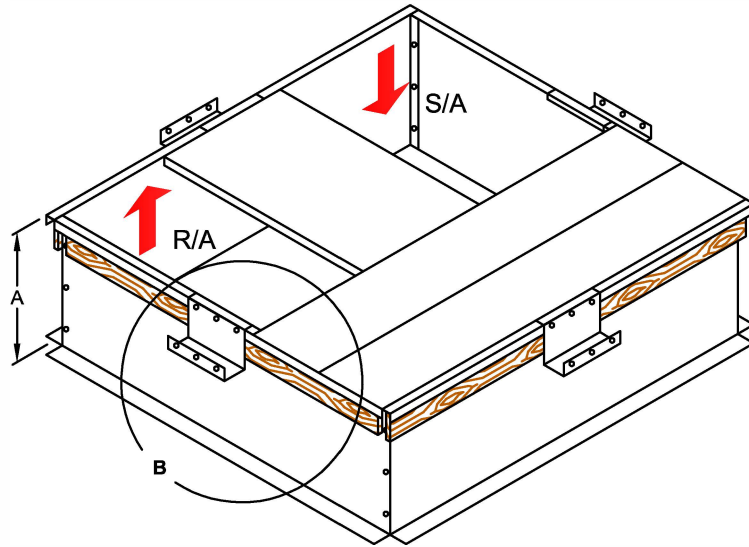

3847 WABASH DRIVE  
 MIRA LOMA, CA 91725  
 PHONE (951) 685-1101  
 FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
 COMPANY: \_\_\_\_\_  
 JOB NAME: \_\_\_\_\_  
 EQUIPMENT: \_\_\_\_\_  
 NOTES: \_\_\_\_\_

FORM NO:  
 CBKD-153

DATE:  
 3/26/2021


PART NUMBER:  
 KDKITLX

REV:  
 7

DRAWN BY:  
 ALL

**STEEL ATTACHMENT**

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" (OR 5/8" FOR MIL SERIES ONLY) Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

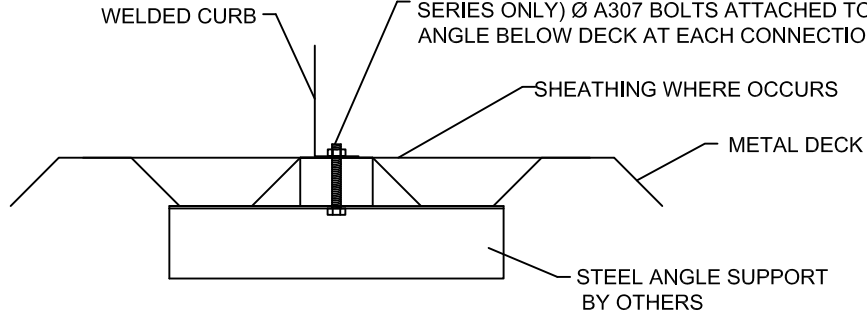

**NO. OF ANCHORAGE BOLTS REQUIRED**

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 39" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SLU180	3 @ 51.38" O.C.	2 @ 71.5" O.C.
SLM1830	3 @ 56.88" O.C.	3 @ 35.75" O.C.

\* SIX INCHES FROM EACH CORNER EVENLY SPACED.  
\*\* CENTERED.

Meets seismic requirements for the following codes:  
CBC 2019  
IBC 2018

**ROOF ANCHORAGE DETAIL**


CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SLU180	SLU180
SLM1830	SLM1830

**ASSUMES:**

CONC SLAB  
f<sub>c</sub>= 4000PSI MINIMUM  
6" MIN THICKNESS  
NORMAL WEIGHT CONCRETE  
OR SAND LIGHT WEIGHT

**CONCRETE ATTACHMENT**

WELDED CURB




CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED

**NO. OF ANCHORAGE BOLTS REQUIRED**

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 11.5" O.C.	3 @ 9.5" O.C.
LXL	4 @ 11.5" O.C.	3 @ 14.5" O.C.
SUN3672	4 @ 20.17" O.C.	3 @ 12.38" O.C.
PRD3715	9 @ 8.61" O.C.	7 @ 6.5" O.C.
PRS	5 @ 14.72" O.C.	4 @ 9.56" O.C.
PRL	6 @ 14.4" O.C.	5 @ 10.38" O.C.
SLU180	8 @ 14.68" O.C.	7 @ 11.92" O.C.
SLM1830	12 @ 10.34" O.C.	10 @ 7.94" O.C.

**WOOD ATTACHMENT**

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø SIMPSON SDS OR EQUIVALENT SCREWS (3 1/2" MIN. EMBED. INTO WOOD FRAMING)

5/8" Ø LAG SCREW W/MIN. 3.5" EMBED (SGMIN=0.43) (FOR MIL SERIES ONLY)

**NO. OF ANCHORAGE SCREWS REQUIRED**

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	9 @ 9.11" O.C.	8 @ 6.14" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.34" O.C.
PRL	5 @ 19" O.C.	4 @ 15.17" O.C.
SLU180	9 @ 13.34" O.C.	7 @ 12.58" O.C.
SLM1830	13 @ 9.81" O.C.	12 @ 6.86" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE  
MIRA LOMA, CA 91725

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO:  
CB-60

DATE:  
10/07/2021

REV:  
7

DRAWN BY:  
FMM




Client:	ProVent PV2101	Previous:	PV1806
Description:	CBKD-153 14" KDKITLXL		
Unit:	ALL YORK P***B MODELS		

**Curb Information**

Hcurb =	14 in	(Height of curb)
Lcurb =	46.5 in	(Length of curb)
wcurb =	41 in	(Width of curb)
WGTcurb =	80 lbs	(Weight of curb)
# Clips long side =	1	# Clips short side = 1

**Unit Information**

WGUnit =	420 lbs	(Weight of Unit)
Wtmax =	141 lbs	(Maximum corner weight)
Wtmin =	78 lbs	(Minimum corner weight)
Hunit =	55 in	(Height of unit above curb)
Hcm =	27.5 in	(Height to center of mass)
Lunit =	51.25 in	(Length of unit)
Wunit =	45.75 in	(Width of unit)

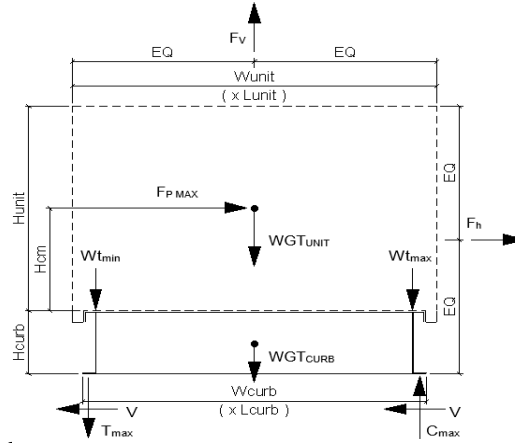

**Seismic Loading - 2018 IBC/2019 CBC**

Ss =	2.85	(Worst case for majority of California)
Fa =	1.2	Default Site Class D
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	503 lbs	(0.7*Fpmax)
	(unit only)	FpmaxASD = 599 lbs
		(unit and curb)

**Wind Loading - 2018 IBC/2019 CBC**

\*\*\* Exposure Category C \*\*\*

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V <sup>2</sup> (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	910 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	813 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	477 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

**Curb Loading**

<b>Transverse:</b>		
Compression <sub>SEISMIC</sub> =	709 lbs	= [FpmaxASD*Hcm + 2*(1+0.14S <sub>DS</sub> )*Wtmax*wcurb]/wcurb
Tension <sub>SEISMIC</sub> =	293 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*wcurb]/wcurb
Compression <sub>WIND</sub> =	542 lbs	= [Fh ASD trans *Hcm + 2*0.6*Wtmax*wcurb - Fvert ASD*wcurb/2]/wcurb
Tension <sub>WIND</sub> =	755 lbs	= [Fh ASD trans *Hcm - 2*0.6*Wtmin*wcurb + Fvert ASD*wcurb/2]/wcurb

---> Negative values indicate opposite load.

<b>Longitudinal:</b>		
Compression <sub>SEISMIC</sub> =	669 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*S <sub>DS</sub> )*Wtmax*Lcurb]/Lcurb
Tension <sub>SEISMIC</sub> =	254 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*Lcurb]/Lcurb
Compression <sub>WIND</sub> =	412 lbs	= [Fh ASD long *Hcm + 2*0.6*Wtmax*Lcurb - Fvert ASD*Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	625 lbs	= [Fh ASD long *Hcm - 2*0.6*Wtmin*Lcurb + Fvert ASD*Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

**Governing Reactions:**

<b>Transverse:</b>		
(on long edge)	Comp <sub>MAX</sub> = 709 lbs	---> Along long edge of curb.
	Tens <sub>MAX</sub> = 755 lbs	---> Along long edge of curb.
<b>Longitudinal:</b>		
(on short edge)	Comp <sub>MAX</sub> = 669 lbs	---> Along short edge of curb.
	Tens <sub>MAX</sub> = 625 lbs	---> Along short edge of curb.

---> Negative values indicate opposite load.




**Curb Design**

Fy = 50 ksi      Fu = 65 ksi  
E = 29500 ksi      t = 0.0713 14 Gauge

**Calculate Section Properties of Curb**

A' = <span style="border: 1px solid black; padding: 2px;">14.000</span> in	a = 13.644 in = A' - (2r+t)
B' = <span style="border: 1px solid black; padding: 2px;">1.750</span> in	a' = 13.929 in = A' - t
C' = <span style="border: 1px solid black; padding: 2px;">0.000</span> in (0 if no tips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
α = <span style="border: 1px solid black; padding: 2px;">0.000</span> (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - [t/2+αt/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
Ix = 27.499 in <sup>4</sup>	rx = 4.73 in
Iy = 0.204 in <sup>4</sup>	ry = 0.407 in
A = 1.23 in <sup>2</sup>	rmin = 0.407 in

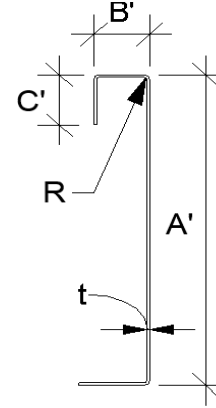

**Axial Compression**

Pu = 0.455 k (Max Axial Comp)      Ωc = 1.80  
Pn/Ωc = 17.057 k  
Fe = 30.16 ksi       $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$       If λc ≤ 1.5;  $F_n = (0.658\lambda_c^2) F_y$   
λc = 1.29      If λc > 1.5;  $F_n = \frac{0.877}{\lambda_c^2} F_y$        $\lambda_c = \sqrt{\frac{F_y}{F_e}}$        $F_e = \frac{\pi^2 E}{(kl/r)^2}$   
Fn = 24.98 ksi  
Ly = 50 in      Lateral unbraced length  
kyLy/ry = 98 (assume k=0.8)

**Compression Check = O.K.**

**Check Web Crippling**

h = 14 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 196.35 ≤ 200	CR = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	CN = 0.35	
Ωw = 1.75	N/h = 0.5 ≤ 2.0	Ch = 0.02	
Pn = 2.422 k	R/t = 1.50 ≤ 9.0		
Pn/Ωw = 1.384 k			
Long side: PuTrans = 0.709 k	<b>O.K.</b> # clips = 1	$P_n = Ct^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$	
Short side: PuLong = 0.669 k	<b>O.K.</b> # clips = 1		

**Check Web Stiffener**

16Ga x 3/4" x 7" [C-channel]  
width of stiffener = 7.000 in      ts = 0.0566 16 Gauge  
web of stiff. w = 6.717 in      Rs = 0.0849 in  
\*\*\*Check w/ts ≤ 1.28√E/Fys      Ωc = 1.70  
w/ts = 118.675  
1.28√E/Fys = 31.091 --> w/ts over limit Use C3.7.2  
 $P_n = 0.7(P_{wc} + A_e F_y) \geq P_{wc}$       Ae = 0.380 in<sup>2</sup>  
Pwc = 2.422 k      Pn/Ω = 8.825 k  
Pn = 15.002 k

**Not Req'd**

**Corner Connections**

**1/4" φ SAE Grade 8 bolts w/ 1/4"-20-UNC Threaded inserts**  
Tcrnmax = 228 lbs      Max[FpmaxASD/4 -OR- FhASDtrans/4 corner connections]  
Vcrnmax = 378 lbs      Max[Tens/2 -OR- Comp/2 corner connections per side]  
Bolt: Tall = 2480 lbs      Vall = 1208 lbs  
Threaded Insert: Tall = 2860 lbs      Vall = 1536 lbs  
# of Bolts required for Tension = 0.1  
# of Bolts required for Shear = 0.3  
# of Bolts Used = 2.0  
Check Combined Stress in Bolts & Inserts: 0.202 **O.K.**

**Check 1/8" welded connection**

<--- USE WELD      Ω = 2.35  
Assume L/t > 25: 25\*t = 1.783 in       $\frac{P_n}{\Omega} = \frac{1}{\Omega} 0.75t L F_u \geq V_{req}$        $L_{req'd} = \frac{V_{req} \Omega}{0.75t F_u}$   
Lreq'd = 0.255 in



**Connection Unit to Curb Clip**

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$  in

$F_{u1} = 65$  ksi

$t_2 = 0.1017$  in (unit base rail thickness)

$F_{u2} = 65$  ksi

$d = 0.190$  in (screw diameter)

$d_w = 0.375$  in (nom. washer diameter)

$t_2/t_1 = 1.4$

For  $t_2/t_1 \leq 1.0$ :

**Shear:**  $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$  2377 # 3.86 k

$P_{ns} = 2.7t_1dF_{u1}$  2.38 k

$P_{ns} = 2.7t_2dF_{u2}$  3.39 k

$P_{ns}/\Omega = 792$  #

$P_{ss}/\Omega = 540$  # <- Controls

**Tension:**  $P_{not} = 1.068$  k (screw pull-out strength)

$P_{not} = 0.85t_c d F_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{nov} = 2.607$  k (screw pull-over strength)

$P_{ts}/\Omega = 356$  # <- Controls

$P_{ts}/\Omega = 820$  #

(full tensile screw capacity)

	Shear (k)	# clips	$V_{clip}$ (k)	$V_{allow}$ (lb)	# screws	spacing
Long side:	0.910	1	0.91	540 #	2	6.00 in
Short side:	0.813	1	0.81	540 #	2	6.00 in

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.57 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$  ksi

$\Omega = 2.22$  bolt/screw connection

$A_{gv} = 0.463$  in<sup>2</sup>

$A_{nv} = 0.443$  in<sup>2</sup>


$A_{nt} = 0.042$  in<sup>2</sup>

$R_n/\Omega = 7.500$  k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

**BSR O.K.**

(AISI Sect. E5.3)

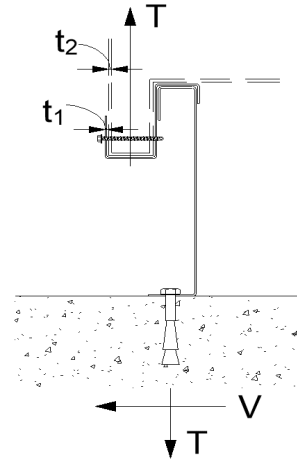

**Connection of Curb to Supporting Structure**

**Roof Loading**

SEISMIC:  $(0.6-0.14S_{DS})D + 0.7E$

WIND:  $0.6D + W$

Transverse:	Uplift <sub>MAX</sub> =	1010 lbs	Shear <sub>MAX</sub> =	455 lbs
Compression <sub>SEISMIC</sub>	=	936 lbs	=	$[F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14 S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension <sub>SEISMIC</sub>	=	795 lbs	=	$[F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14 S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression <sub>WIND</sub>	=	833 lbs	=	$[F_{h ASD trans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vert ASD} * w_{curb}/2] / w_{curb}$
Tension <sub>WIND</sub>	=	1010 lbs	=	$[F_{h ASD trans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vert ASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	Uplift <sub>MAX</sub> =	814 lbs	Shear <sub>MAX</sub> =	406 lbs
Compression <sub>SEISMIC</sub>	=	864 lbs	=	$[F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14 S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension <sub>SEISMIC</sub>	=	724 lbs	=	$[F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14 S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression <sub>WIND</sub>	=	637 lbs	=	$[F_{h ASD long} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vert ASD} * L_{curb}/2] / L_{curb}$
Tension <sub>WIND</sub>	=	814 lbs	=	$[F_{h ASD long} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vert ASD} * L_{curb}/2] / L_{curb}$

**Wood Attachment:**

1/4" φ x 3.5" Simpson SDS screw w/ 2.25" threaded emt (SGmin = 0.43)

Transverse:	Tall <sub>metal</sub> = 997 lbs	Vall <sub>metal</sub> = 1097 lbs
	Tall <sub>wood</sub> = 616 lbs	Vall <sub>wood</sub> = 672 lbs
	# of Screws Req'd for Uplift = 1.64	COMBINED LOADING: 0.772 O.K.
	# of Screws Req'd for Shear = 0.68	Screw Spacing = 19.3 in o.c.
	Total # of screws Required = 3	

1/4" φ x 3.5" Simpson SDS screws @ 19.3 in o.c. along long side of curb w/ 2.25" threaded embed

**Longitudinal:**

	# of Screws Req'd for Uplift = 1.3	COMBINED LOADING: 0.642 O.K.
	# of Screws Req'd for Shear = 0.6	Screw Spacing = 16.5 in o.c.
	Total # of screws Required = 3	

1/4" φ x 3.5" Simpson SDS screws @ 16.5 in o.c. along short side of curb w/ 2.25" threaded embed

**Steel Deck Attachment:**

1/2" φ A307 Bolts to steel angle below deck

Transverse:	Tall <sub>bolt</sub> = 3927 lbs	Vall <sub>bolt</sub> = 2209 lbs
	Tall <sub>metal</sub> = 2086 lbs	Vall <sub>metal</sub> = 2192 lbs
	# of Bolts Req'd for Uplift = 0.48	COMBINED LOADING: 0.117 O.K.
	# of Bolts Req'd for Shear = 0.21	Bolt Spacing = 34.5 in o.c.
	Total # of Bolts Required = 2	

1/2" φ A307 Bolts to steel angle below deck @ 34.5 in o.c. along long side of curb

**Longitudinal:**

	# of Bolts Req'd for Uplift = 0.39	COMBINED LOADING: 0.085 O.K.
	# of Bolts Req'd for Shear = 0.19	Req'd Min Spacing = 29.0 in o.c.
	Total # of Bolts Required = 2	

1/2" φ A307 Bolts to steel angle below deck @ 29 in o.c. along short side of curb



**For Concrete anchorage:** SEISMIC  $(0.6-0.14S_{DS})D + 0.7\Omega_o E$   $\Omega_o = 2.0$

**Concrete Attachment:** 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed

$T_{all,LRFD} = 1722 \text{ lbs}$   $V_{all,LRFD} = 2032 \text{ lbs}$   $\alpha = (1 + 0.2SDS)D + 2.5E = 1.708$

$T_{all,ASD} = T_{all,LRFD}/\alpha = 920.9 \text{ lbs}$   $V_{all,ASD} = V_{all,LRFD}/\alpha = 1086.6 \text{ lbs}$   $(D = 0.758, E = 0.242)$

<b>Transverse:</b>	<b>Uplift<sub>MAX</sub> =</b>	<b>1141 lbs</b>	<b>Shear<sub>MAX</sub> =</b>	<b>599 lbs</b>
--------------------	-------------------------------	-----------------	------------------------------	----------------

Compression<sub>SEISMIC</sub> = 1541 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$   
 Tension<sub>SEISMIC</sub> = 1141 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$   
 Shear<sub>SEISMIC</sub> = 599 lbs =  $\Omega_o * F_{pmaxASD} / 2$   
 Min Bolts Req'd Uplift = 1.24 spacing = 34.50 in o.c.  $T_{applied} = 380.5 \text{ lbs}$   
 Min Bolts Req'd Shear = 2.00 spacing = 34.50 in o.c.  $V_{applied} = 119.7 \text{ lbs}$

Try using 3 bolts spaced at 17.25 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.52$
---	--

Use 3 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 17.3 in o.c. max. along long side of curb w/ 4" embed

<b>Longitudinal:</b>	<b>Uplift<sub>MAX</sub> =</b>	<b>998 lbs</b>	<b>Shear<sub>MAX</sub> =</b>	<b>599 lbs</b>
----------------------	-------------------------------	----------------	------------------------------	----------------

Compression<sub>SEISMIC</sub> = 1398 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$   
 Tension<sub>SEISMIC</sub> = 998 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$   
 Shear<sub>SEISMIC</sub> = 599 lbs =  $\Omega_o * F_{pmaxASD} / 2$   
 Min Bolts Req'd Uplift = 1.08 spacing = 14.50 in o.c.  $T_{applied} = 499.0 \text{ lbs}$   
 Min Bolts Req'd Shear = 2.00 spacing = 29.00 in o.c.  $V_{applied} = 119.7 \text{ lbs}$

Try using 2 bolts spaced at 29.00 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.65$
---	--

Use 2 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 29 in o.c. max. along short side of curb w/ 4" embed

<b>CURB DESIGN SUMMARY:</b> CBKD-153 KDKITLXL		<b>Unit:</b> ALL YORK P***B MODELS
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		
# OF CLIPS (LONG SIDE) - 1 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
# OF CLIPS (SHORT SIDE) - 1 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
CORNER CONNECTION: Use 2 - 1/4" $\phi$ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
<b>CURB ANCHORAGE</b>	<b>WOOD</b>	<b>STEEL</b>
	1/4" $\phi$ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	1/2" $\phi$ A307 Bolts to steel angle below deck
	<b>CONCRETE</b>	
	3/4" $\phi$ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed	
<b>LONG DIRECTION</b>	3 @ 19.25 in o.c.	2 @ 34.5 in o.c.
<b>SHORT DIRECTION</b>	3 @ 16.5 in o.c.	2 @ 29 in o.c.