



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBKD-152 Series
KDKITLXS



Prepared for:

PROVENT / RRS

3847 Wabash Drive
Mira Loma, CA 91725

Date: October 1, 2021

Project Number: PV2101

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-60.

Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)




STRUCTURALLY CALCULATED HOLD DOWN CLIPS FOR KNOCK-DOWN ROOF CURBS FOR YORK UNITS

P*A ALL MODELS**


ProVent P/N	A	WEIGHT
CBKDLXS08	8"	43 Lbs
CBKDLXS11	11"	54 Lbs
CBKDLXS14	14"	65 Lbs

SEISMIC KIT P/N	WEIGHT
KDKITLX	5 Lbs


Meets seismic requirements for the following codes:
CBC 2019
IBC 2018

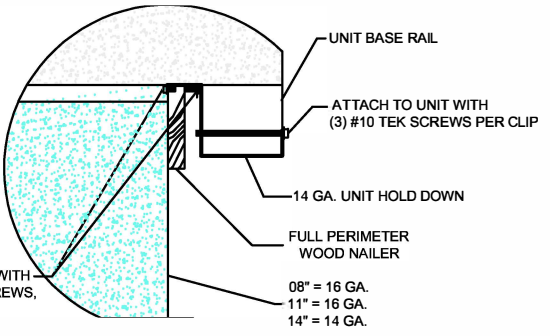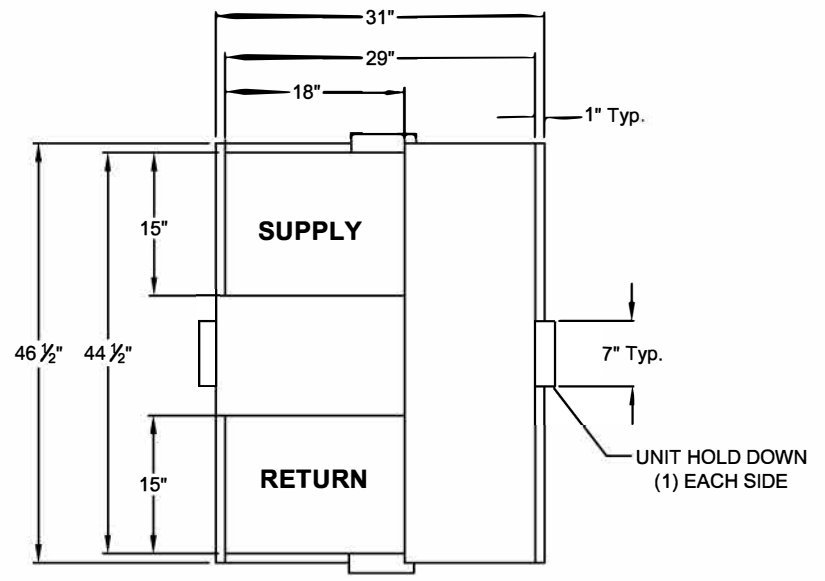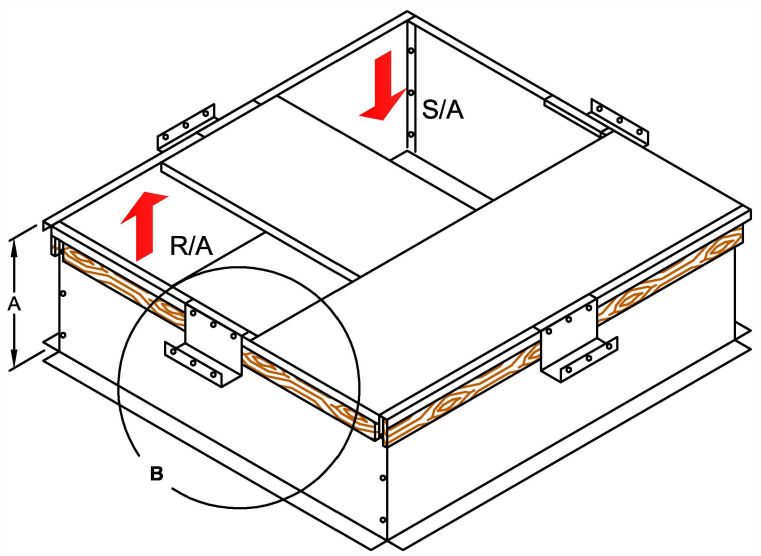


HOLD DOWN DETAIL

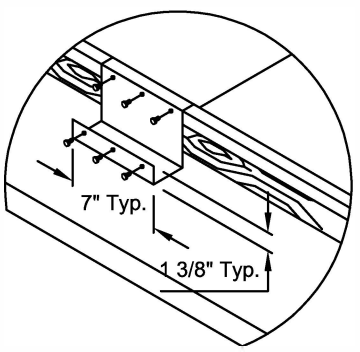

DETAIL B

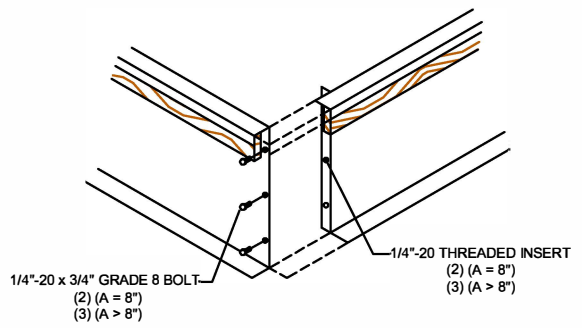

CORNER DETAIL

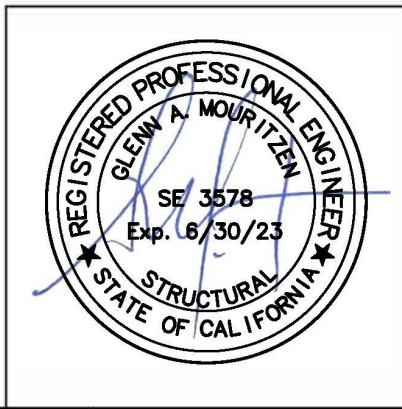

3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-152

DATE:
3/26/2021


REV:
7

PART NUMBER:
KDKITLX

DRAWN BY:
ALL

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" (OR 5/8" FOR MIL SERIES ONLY) Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

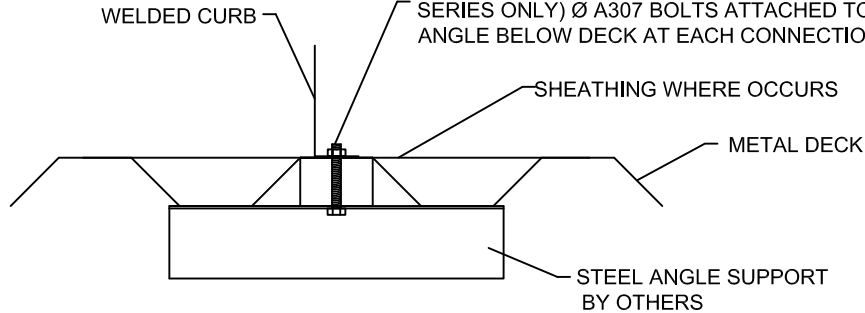

NO. OF ANCHORAGE BOLTS REQUIRED


CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 39" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SLU180	3 @ 51.38" O.C.	2 @ 71.5" O.C.
SLM1830	3 @ 56.88" O.C.	3 @ 35.75" O.C.

ASSUMES:

CONC SLAB
f_c= 4000PSI MINIMUM
6" MIN THICKNESS
NORMAL WEIGHT CONCRETE
OR SAND LIGHT WEIGHT

CONCRETE ATTACHMENT

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 11.5" O.C.	3 @ 9.5" O.C.
LXL	4 @ 11.5" O.C.	3 @ 14.5" O.C.
SUN3672	4 @ 20.17" O.C.	3 @ 12.38" O.C.
PRD3715	9 @ 8.61" O.C.	7 @ 6.5" O.C.
PRS	5 @ 14.72" O.C.	4 @ 9.56" O.C.
PRL	6 @ 14.4" O.C.	5 @ 10.38" O.C.
SLU180	8 @ 14.68" O.C.	7 @ 11.92" O.C.
SLM1830	12 @ 10.34" O.C.	10 @ 7.94" O.C.

Meets seismic requirements for the following codes:
CBC 2019
IBC 2018


ROOF ANCHORAGE DETAIL

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SLU180	SLU180
SLM1830	SLM1830

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

WOOD ATTACHMENT

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø SIMPSON SDS OR EQUIVALENT SCREWS (3 1/2" MIN. EMBED. INTO WOOD FRAMING)

5/8" Ø LAG SCREW W/MIN. 3.5" EMBED (SGMIN=0.43) (FOR MIL SERIES ONLY)

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	9 @ 9.11" O.C.	8 @ 6.14" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.34" O.C.
PRL	5 @ 19" O.C.	4 @ 15.17" O.C.
SLU180	9 @ 13.34" O.C.	7 @ 12.58" O.C.
SLM1830	13 @ 9.81" O.C.	12 @ 6.86" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
10/07/2021

REV:
7

DRAWN BY:
FMM




Client:	ProVent PV2101	Previous:	PV1806
Description:	CBKD-152 14" KDKITLXS		
Unit:	ALL YORK P***A MODELS		

Curb Information

Hcurb =	14	in	(Height of curb)
Lcurb =	46.5	in	(Length of curb)
wcurb =	31	in	(Width of curb)
WGTcurb =	70	lbs	(Weight of curb)
# Clips long side =	1		
# Clips short side =	1		

Unit Information

WGUnit =	367	lbs	(Weight of Unit)
Wtmax =	120	lbs	(Maximum corner weight)
Wtmin =	71	lbs	(Minimum corner weight)
Hunit =	49	in	(Height of unit above curb)
Hcm =	24.5	in	(Height to center of mass)
Lunit =	51.25	in	(Length of unit)
Wunit =	35.75	in	(Width of unit)

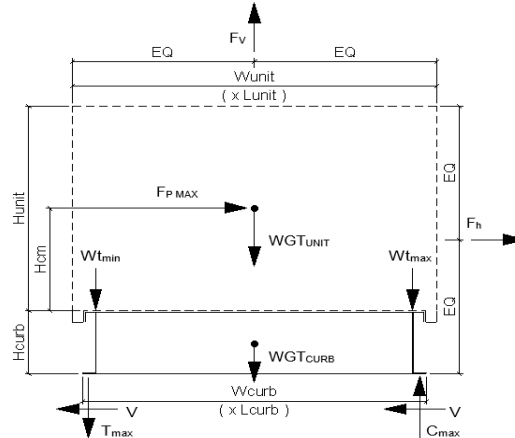

Seismic Loading - 2018 IBC/2019 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.2	Default Site Class D
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	439 lbs	(0.7*Fpmax)
	(unit only)	
ap =	2.5	
Rp =	6	
FpmaxASD =	523 lbs	(unit and curb)

Wind Loading - 2018 IBC/2019 CBC

*** Exposure Category C ***

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	831 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	580 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	372 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:		
Compression _{SEISMIC} =	664 lbs	= [FpmaxASD*Hcm + 2*(1+0.14S _{DS})*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	307 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S _{DS})*Wtmin*wcurb]/wcurb
Compression _{WIND} =	615 lbs	= [Fh ASD trans *Hcm + 2*0.6*Wtmax*wcurb - Fvert ASD*wcurb/2]/wcurb
Tension _{WIND} =	758 lbs	= [Fh ASD trans *Hcm - 2*0.6*Wtmin*wcurb + Fvert ASD*wcurb/2]/wcurb

---> Negative values indicate opposite load.

Longitudinal:		
Compression _{SEISMIC} =	548 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*S _{DS})*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	192 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S _{DS})*Wtmin*Lcurb]/Lcurb
Compression _{WIND} =	263 lbs	= [Fh ASD long *Hcm + 2*0.6*Wtmax*Lcurb - Fvert ASD*Lcurb/2]/Lcurb
Tension _{WIND} =	406 lbs	= [Fh ASD long *Hcm - 2*0.6*Wtmin*Lcurb + Fvert ASD*Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

Governing Reactions:

Transverse:			
(on long edge)	Comp _{MAX} =	664 lbs	---> Along long edge of curb.
	Tens _{MAX} =	758 lbs	---> Along long edge of curb.
Longitudinal:			
(on short edge)	Comp _{MAX} =	548 lbs	---> Along short edge of curb.
	Tens _{MAX} =	406 lbs	---> Along short edge of curb.

---> Negative values indicate opposite load.




Curb Design

Fy = 50 ksi Fu = 65 ksi
E = 29500 ksi t = 0.0713 14 Gauge

Calculate Section Properties of Curb

A' = 14.000 in	a = 13.644 in = A' - (2r+t)
B' = 1.750 in	a' = 13.929 in = A' - t
C' = 0.000 in (0 if no tips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - [t/2+αt/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
Ix = 27.499 in ⁴	rx = 4.73 in
Iy = 0.204 in ⁴	ry = 0.407 in
A = 1.23 in ²	rmin = 0.407 in

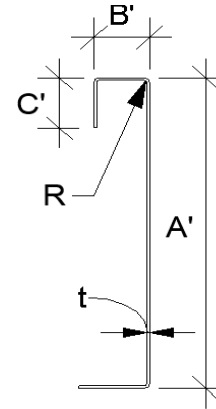

Axial Compression

Pu = 0.416 k (Max Axial Comp) Ωc = 1.80
Pn/Ωc = 17.057 k
Fe = 30.16 ksi $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λc ≤ 1.5; $F_n = (0.658\lambda_c^2) F_y$
λc = 1.29 If λc > 1.5; $F_n = \frac{0.877}{\lambda_c^2} F_y$ $\lambda_c = \sqrt{\frac{F_y}{F_e}}$ $F_e = \frac{\pi^2 E}{(kl/r)^2}$
Fn = 24.98 ksi
Ly = 50 in Lateral unbraced length
kyLy/ry = 98 (assume k=0.8)

Compression Check = O.K.

Check Web Crippling

h = 14 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 196.35 ≤ 200	CR = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	CN = 0.35	
Ωw = 1.75	N/h = 0.5 ≤ 2.0	Ch = 0.02	
Pn = 2.422 k	R/t = 1.50 ≤ 9.0		
Pn/Ωw = 1.384 k			
Long side: PuTrans = 0.664 k	O.K. # clips = 1	$P_n = Ct^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$	
Short side: PuLong = 0.548 k	O.K. # clips = 1		

Check Web Stiffener

16Ga x 3/4" x 7" [C-channel]
width of stiffener = 7.000 in ts = 0.0566 16 Gauge
web of stiff. w = 6.717 in Rs = 0.0849 in
***Check w/ts ≤ 1.28√E/Fys Ωc = 1.70
w/ts = 118.675
1.28√E/Fys = 31.091 --> w/ts over limit Use C3.7.2
 $P_n = 0.7(P_{wc} + A_e F_y) \geq P_{wc}$
Pwc = 2.422 k Ae = 0.380 in²
Pn = 15.002 k Pn/Ω = 8.825 k

Not Req'd

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts
Tcrnmax = 208 lbs Max[FpmaxASD/4 -OR- FhASDtrans/4 corner connections]
Vcrnmax = 379 lbs Max[Tens/2 -OR- Comp/2 corner connections per side]
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.1
of Bolts required for Shear = 0.3
of Bolts Used = 2.0
Check Combined Stress in Bolts & Inserts: 0.199 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.783 in $\frac{P_n}{\Omega} = \frac{1}{\Omega} 0.75t L F_u \geq V_{req}$ $L_{req'd} = \frac{V_{req} \Omega}{0.75t F_u}$
Lreq'd = 0.256 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$ in

$F_{u1} = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_{u2} = 65$ ksi

$d = 0.190$ in (screw diameter)

$d_w = 0.375$ in (nom. washer diameter)

$t_2/t_1 = 1.4$

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ 3.86 k

$P_{ns} = 2377$ #

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2377$ #

$P_{ns} = 2.7t_1dF_{u1}$ 2.38 k

$P_{ns} = 2.7t_1dF_{u1}$ 2.38 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{ns}/\Omega = 792$ #

$P_{ss}/\Omega = 540$ # <- Controls

Tension: $P_{not} = 1.068$ k (screw pull-out strength)

$P_{not} = 0.85t_c d F_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 2.607$ k (screw pull-over strength)

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 356$ # <- Controls

$P_{ts}/\Omega = 820$ #

(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	0.831	1	0.83	540 #	2	6.00 in
Short side:	0.580	1	0.58	540 #	2	6.00 in

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.57 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$ ksi

$\Omega = 2.22$ bolt/screw connection

$A_{gv} = 0.463$ in²

$A_{nv} = 0.443$ in²


$A_{nt} = 0.042$ in²

$R_n/\Omega = 7.500$ k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

(AISI Sect. E5.3)

BSR O.K.

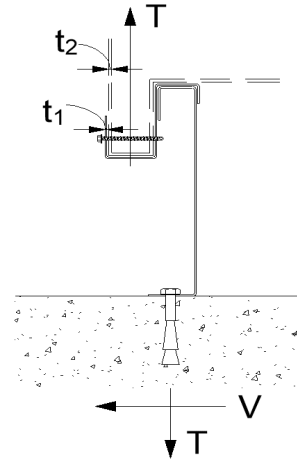

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

Transverse:	Uplift _{MAX} = 1087 lbs	Shear _{MAX} = 416 lbs
Compression _{SEISMIC} =	938 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension _{SEISMIC} =	815 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression _{WIND} =	977 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vertASD} * w_{curb}/2] / w_{curb}$
Tension _{WIND} =	1087 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vertASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	Uplift _{MAX} = 599 lbs	Shear _{MAX} = 290 lbs
Compression _{SEISMIC} =	721 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension _{SEISMIC} =	599 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression _{WIND} =	425 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vertASD} * L_{curb}/2] / L_{curb}$
Tension _{WIND} =	535 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vertASD} * L_{curb}/2] / L_{curb}$

Wood Attachment:

1/4" ϕ x 3.5" Simpson SDS screw w/ 2.25" threaded emt (SGmin = 0.43)

Transverse:	Tall _{metal} = 997 lbs	Vall _{metal} = 1097 lbs
	Tall _{wood} = 616 lbs	Vall _{wood} = 672 lbs
	# of Screws Req'd for Uplift = 1.77	COMBINED LOADING: 0.795 O.K.
	# of Screws Req'd for Shear = 0.62	Screw Spacing = 19.3 in o.c.
	Total # of screws Required = 3	

1/4" ϕ x 3.5" Simpson SDS screws @ 19.3 in o.c. along long side of curb w/ 2.25" threaded embed

Longitudinal:

	# of Screws Req'd for Uplift = 1.0	COMBINED LOADING: 0.702 O.K.
	# of Screws Req'd for Shear = 0.4	Screw Spacing = 23.0 in o.c.
	Total # of screws Required = 2	

1/4" ϕ x 3.5" Simpson SDS screws @ 23 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment:

1/2" ϕ A307 Bolts to steel angle below deck

Transverse:	Tall _{bolt} = 3927 lbs	Vall _{bolt} = 2209 lbs
	Tall _{metal} = 2086 lbs	Vall _{metal} = 2192 lbs
	# of Bolts Req'd for Uplift = 0.52	COMBINED LOADING: 0.126 O.K.
	# of Bolts Req'd for Shear = 0.19	Bolt Spacing = 34.5 in o.c.
	Total # of Bolts Required = 2	

1/2" ϕ A307 Bolts to steel angle below deck @ 34.5 in o.c. along long side of curb

Longitudinal:

	# of Bolts Req'd for Uplift = 0.29	COMBINED LOADING: 0.050 O.K.
	# of Bolts Req'd for Shear = 0.13	Req'd Min Spacing = 19.0 in o.c.
	Total # of Bolts Required = 2	

1/2" ϕ A307 Bolts to steel angle below deck @ 19 in o.c. along short side of curb



For Concrete anchorage: SEISMIC $(0.6-0.14S_{DS})D + 0.7\Omega_o E$ $\Omega_o = 2.0$

Concrete Attachment: 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed

$T_{all,LRFD} = 1722 \text{ lbs}$ $V_{all,LRFD} = 2032 \text{ lbs}$ $\alpha = (1 + 0.2SDS)D + 2.5E = 1.708$

$T_{all,ASD} = T_{all,LRFD}/\alpha = 920.9 \text{ lbs}$ $V_{all,ASD} = V_{all,LRFD}/\alpha = 1086.6 \text{ lbs}$ $(D = 0.758, E = 0.242)$

Transverse:	Uplift_{MAX} =	1238 lbs	Shear_{MAX} =	523 lbs
--------------------	-------------------------------	-----------------	------------------------------	----------------

Compression_{SEISMIC} = 1588 lbs = $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
 Tension_{SEISMIC} = 1238 lbs = $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
 Shear_{SEISMIC} = 523 lbs = $\Omega_o * F_{pmaxASD} / 2$
 Min Bolts Req'd Uplift = 1.34 spacing = 34.50 in o.c. $T_{applied} = 412.6 \text{ lbs}$
 Min Bolts Req'd Shear = 2.00 spacing = 34.50 in o.c. $V_{applied} = 104.6 \text{ lbs}$

Try using 3 bolts spaced at 17.25 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.54$
---	--

Use 3 - 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy @ 17.3 in o.c. max. along long side of curb w/ 4" embed

Longitudinal:	Uplift_{MAX} =	805 lbs	Shear_{MAX} =	523 lbs
----------------------	-------------------------------	----------------	------------------------------	----------------

Compression_{SEISMIC} = 1154 lbs = $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
 Tension_{SEISMIC} = 805 lbs = $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
 Shear_{SEISMIC} = 523 lbs = $\Omega_o * F_{pmaxASD} / 2$
 Min Bolts Req'd Uplift = 0.87 spacing = 9.50 in o.c. $T_{applied} = 402.4 \text{ lbs}$
 Min Bolts Req'd Shear = 2.00 spacing = 19.00 in o.c. $V_{applied} = 104.6 \text{ lbs}$

Try using 2 bolts spaced at 19.00 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.53$
---	--

Use 2 - 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy @ 19 in o.c. max. along short side of curb w/ 4" embed

CURB DESIGN SUMMARY: CBKD-152 KDKITLXS		Unit: ALL YORK P***A MODELS
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		
# OF CLIPS (LONG SIDE) - 1 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
# OF CLIPS (SHORT SIDE) - 1 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
CORNER CONNECTION: Use 2 - 1/4" ϕ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
CURB ANCHORAGE	WOOD 1/4" ϕ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	STEEL 1/2" ϕ A307 Bolts to steel angle below deck
		CONCRETE 3/4" ϕ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
LONG DIRECTION	3 @ 19.25 in o.c.	2 @ 34.5 in o.c.
SHORT DIRECTION	2 @ 23 in o.c.	2 @ 19 in o.c.