




**MOUR GROUP**  
ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
619-727-4800

**Structural Calculations**  
**for**  
**CBKD-141 Series**  
KDKITPRL

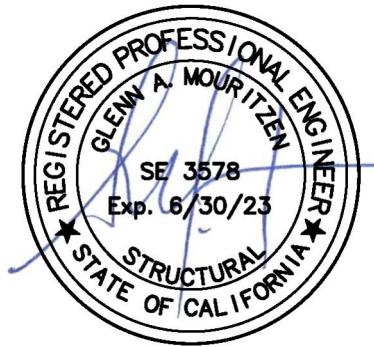

**Prepared for:**  
**PROVENT / RRS**  
**3847 Wabash Drive**  
**Mira Loma, CA 91725**

**Date: October 1, 2021**  
**Project Number: PV2101**

For wood, concrete and steel attachments see Roof Anchorage Detail, Form Nos. CB-60.

Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)


# STRUCTURALLY CALCULATED HOLD DOWN CLIPS FOR KNOCK-DOWN ROOF CURBS FOR YORK UNITS

ZX08-14; XX08-12; XYA7; ZYA7  
ZY07-12; XY07-09; ZL08-14

ProVent P/N	A	WEIGHT
CBKDPRL08	8"	115 Lbs
CBKDPRL11	11"	129 Lbs
CBKDPRL14	14"	144 Lbs



SEISMIC KIT P/N	WEIGHT
KDKITPRL	60 Lbs

Meets seismic requirements for the following codes:  
CBC 2019  
IBC 2018

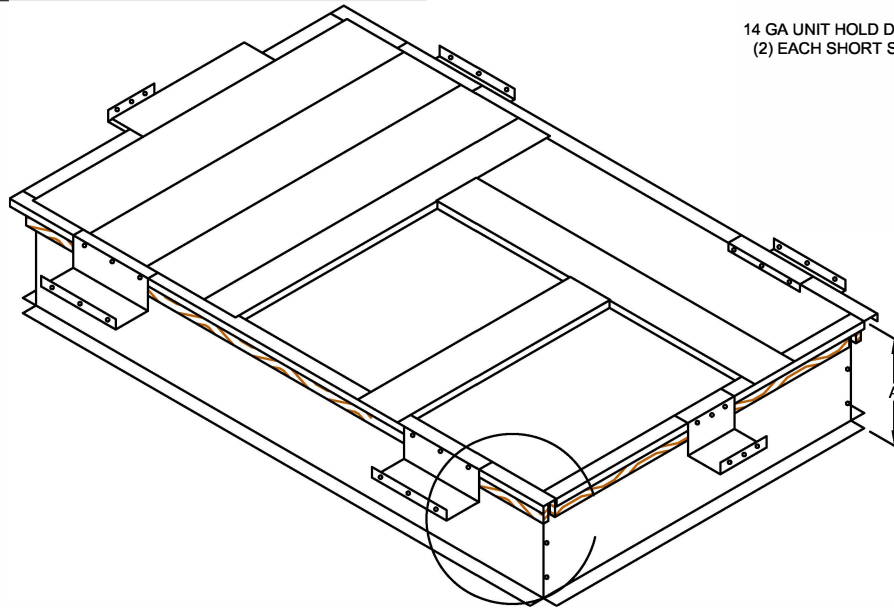


14 GA UNIT HOLD DOWN  
(2) EACH SHORT SIDE

7 Typ"

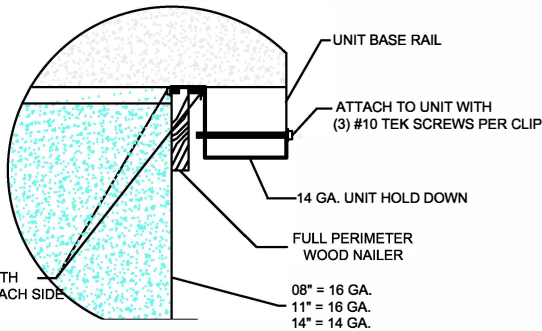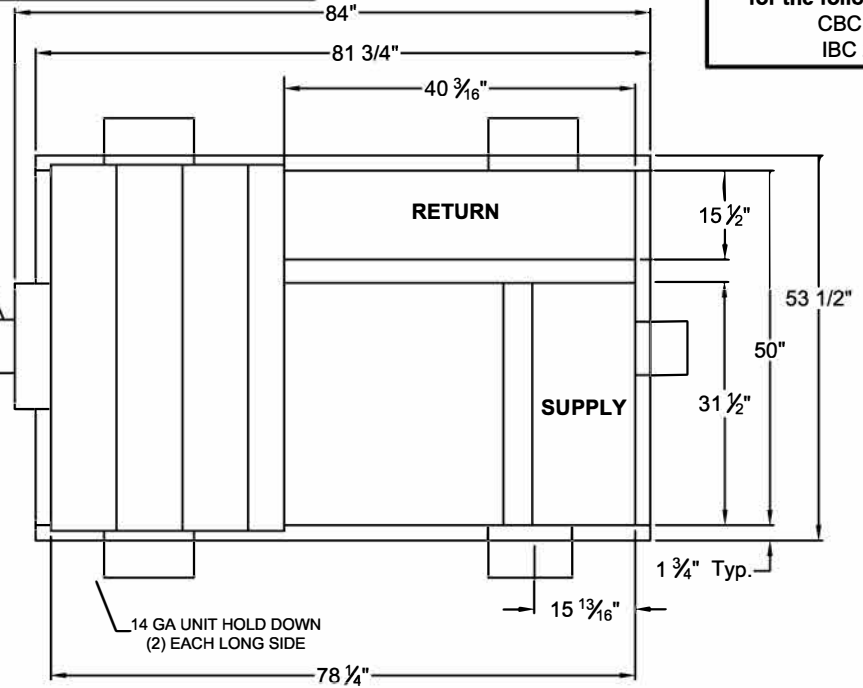

HOLD DOWN DETAIL

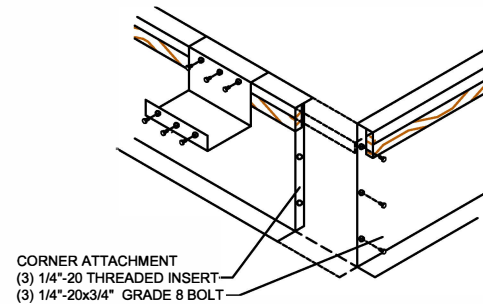

CORNER & HOLD DOWN DETAIL



3847 WABASH DRIVE  
MIRA LOMA, CA 91725

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO:  
CBKD-141


DATE:  
9/9/2021

REV:  
7

PART NUMBER:  
KDKITPRL Series

DRAWN BY:  
ALL

### STEEL ATTACHMENT

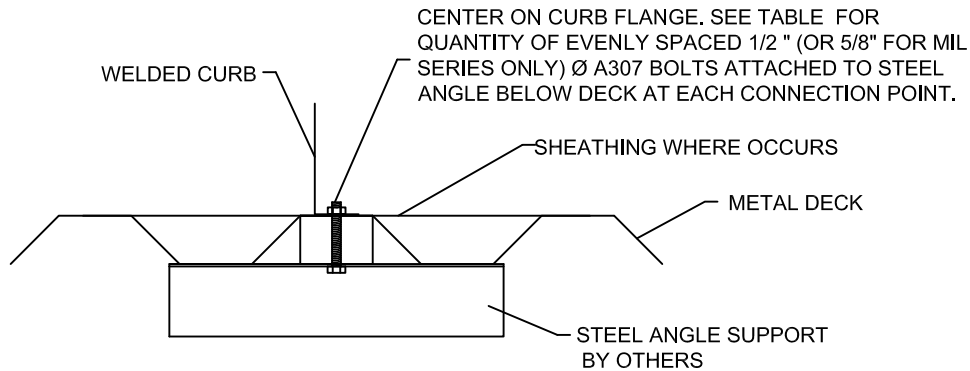

NO. OF ANCHORAGE BOLTS REQUIRED


CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 39" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SLU180	3 @ 51.38" O.C.	2 @ 71.5" O.C.
SLM1830	3 @ 56.88" O.C.	3 @ 35.75" O.C.

### ASSUMES:

CONC SLAB  
 $f_c = 4000$  PSI MINIMUM  
6" MIN THICKNESS  
NORMAL WEIGHT CONCRETE  
OR SAND LIGHT WEIGHT

### CONCRETE ATTACHMENT

WELDED CURB




CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 11.5" O.C.	3 @ 9.5" O.C.
LXL	4 @ 11.5" O.C.	3 @ 14.5" O.C.
SUN3672	4 @ 20.17" O.C.	3 @ 12.38" O.C.
PRD3715	9 @ 8.61" O.C.	7 @ 6.5" O.C.
PRS	5 @ 14.72" O.C.	4 @ 9.56" O.C.
PRL	6 @ 14.4" O.C.	5 @ 10.38" O.C.
SLU180	8 @ 14.68" O.C.	7 @ 11.92" O.C.
SLM1830	12 @ 10.34" O.C.	10 @ 7.94" O.C.

\* SIX INCHES FROM EACH CORNER EVENLY SPACED.  
\*\* CENTERED.

### WOOD ATTACHMENT

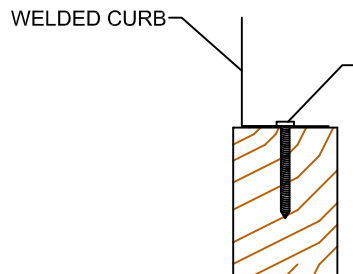

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø SIMPSON SDS OR EQUIVALENT SCREWS (3 1/2" MIN. EMBED. INTO WOOD FRAMING)

5/8" Ø LAG SCREW W/MIN. 3.5" EMBED (SGMIN=0.43) (FOR MIL SERIES ONLY)

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	9 @ 9.11" O.C.	8 @ 6.14" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.34" O.C.
PRL	5 @ 19" O.C.	4 @ 15.17" O.C.
SLU180	9 @ 13.34" O.C.	7 @ 12.58" O.C.
SLM1830	13 @ 9.81" O.C.	12 @ 6.86" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE  
MIRA LOMA, CA 91725

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO:  
CB-60

DATE:  
10/07/2021

REV:  
7

DRAWN BY:  
FMM




Client:	ProVent PV2101	Previous:	PV1806
Description:	CBKD-141 14" KDKITPRL		
Unit:	ZX, ZY 08-12; ZX 14; ZY 07		

#### Curb Information

Hcurb =	14	in	(Height of curb)
Lcurb =	84	in	(Length of curb)
wcurb =	53.5	in	(Width of curb)
WGTCurb =	204	lbs	(Weight of curb)
# Clips long side =	2		
# Clips short side =	1		

#### Unit Information

WGUnit =	653	lbs	(Weight of Unit)
Wtmax =	176	lbs	(Maximum corner weight)
Wtmin =	151	lbs	(Minimum corner weight)
Hunit =	40.56	in	(Height of unit above curb)
Hcm =	20.28	in	(Height to center of mass)
Lunit =	74.05	in	(Length of unit)
Wunit =	48.88	in	(Width of unit)

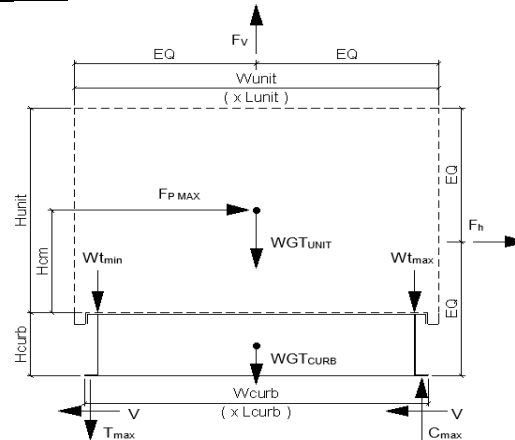

#### Seismic Loading - 2018 IBC/2019 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.2	Default Site Class D
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	782 lbs	(0.7*Fpmax)
	(unit only)	
		FpmaxASD = 1026 lbs
		(unit and curb)

#### Wind Loading - 2018 IBC/2019 CBC

##### \*\*\* Exposure Category C \*\*\*

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V <sup>2</sup> (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	1040 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	687 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	736 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

#### Curb Loading

##### Transverse:

Compression <sub>SEISMIC</sub> =	761 lbs	= [FpmaxASD*Hcm+2*(1+0.14S <sub>DS</sub> )*Wtmax*wcurb]/wcurb
Tension <sub>SEISMIC</sub> =	211 lbs	= [FpmaxASD*Hcm-2*(0.6-0.14S <sub>DS</sub> )*Wtmin*wcurb]/wcurb
Compression <sub>WIND</sub> =	238 lbs	= [Fh ASD trans*Hcm+2*0.6*Wtmax*wcurb-Fvert ASD*wcurb/2]/wcurb
Tension <sub>WIND</sub> =	581 lbs	= [Fh ASD trans*Hcm-2*0.6*Wtmin*wcurb+Fvert ASD*wcurb/2]/wcurb

----> Negative values indicate opposite load.

##### Longitudinal:

Compression <sub>SEISMIC</sub> =	653 lbs	= [FpmaxASD*Hcm+2*(1+0.14*S <sub>DS</sub> )*Wtmax*Lcurb]/Lcurb
Tension <sub>SEISMIC</sub> =	104 lbs	= [FpmaxASD*Hcm-2*(0.6-0.14S <sub>DS</sub> )*Wtmin*Lcurb]/Lcurb
Compression <sub>WIND</sub> =	9 lbs	= [Fh ASD long*Hcm+2*0.6*Wtmax*Lcurb-Fvert ASD*Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	352 lbs	= [Fh ASD long*Hcm-2*0.6*Wtmin*Lcurb+Fvert ASD*Lcurb/2]/Lcurb

----> Negative values indicate opposite load.

#### Governing Reactions:

Transverse:	Comp <sub>MAX</sub> =	761	lbs	----> Along long edge of curb.
(on long edge)	Tens <sub>MAX</sub> =	581	lbs	----> Along long edge of curb.
Longitudinal:	Comp <sub>MAX</sub> =	653	lbs	----> Along short edge of curb.
(on short edge)	Tens <sub>MAX</sub> =	352	lbs	----> Along short edge of curb.

----> Negative values indicate opposite load.




**Curb Design**

F<sub>y</sub> = 50 ksi      F<sub>u</sub> = 65 ksi  
E = 29500 ksi      t = 0.0713 14 Gauge

**Calculate Section Properties of Curb**

A' = <span style="border: 1px solid black; padding: 2px;">14.000</span> in	a = 13.644 in = A' - (2r+t)
B' = <span style="border: 1px solid black; padding: 2px;">1.750</span> in	a' = 13.929 in = A' - t
C' = <span style="border: 1px solid black; padding: 2px;">0.000</span> in (0 if no lips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
α = <span style="border: 1px solid black; padding: 2px;">0.000</span> (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - [t/2+αt/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
I <sub>x</sub> = 27.499 in <sup>4</sup>	r <sub>x</sub> = 4.73 in
I <sub>y</sub> = 0.204 in <sup>4</sup>	r <sub>y</sub> = 0.407 in
A = 1.23 in <sup>2</sup>	r <sub>min</sub> = 0.407 in

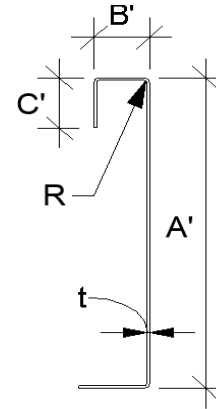

**Axial Compression**

P<sub>u</sub> = 0.520 k (Max Axial Comp)      Ω<sub>c</sub> = 1.80

P<sub>n</sub>/Ω<sub>c</sub> = 17.057 k

F<sub>e</sub> = 30.16 ksi

λ<sub>c</sub> = 1.29

F<sub>n</sub> = 24.98 ksi

L<sub>y</sub> = 50 in

k<sub>y</sub>L<sub>y</sub>/r<sub>y</sub> = 98

$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$       If λ<sub>c</sub> ≤ 1.5; F<sub>n</sub> = (0.658<sup>λ<sub>c</sub><sup>2</sup></sup>) F<sub>y</sub>  
If λ<sub>c</sub> > 1.5; F<sub>n</sub> =  $\frac{0.877}{\lambda_c^2} F_y$

Lateral unbraced length  
(assume k=0.8)

$$\lambda_c = \sqrt{\frac{F_y}{F_e}} \quad F_e = \frac{\pi^2 E}{(kl/r)^2}$$

**Compression Check = O.K.**

**Check Web Crippling**

h = 14 in

t = 0.0713 in

N = 7.00

Ω<sub>w</sub> = 1.75

P<sub>n</sub> = 2.422 k

P<sub>n</sub>/Ω<sub>w</sub> = 1.384 k

Long side: P<sub>u</sub><sub>Trans</sub> = 0.380 k

Short side: P<sub>u</sub><sub>Long</sub> = 0.218 k

-- Check limits:

h/t = 196.35 ≤ 200

N/t = 98.18 ≤ 210

N/h = 0.5 ≤ 2.0

R/t = 1.50 ≤ 9.0

C = 4.00

C<sub>R</sub> = 0.14

C<sub>N</sub> = 0.35

C<sub>h</sub> = 0.02

[See table C3.4.1-2, fastened to support, one flange, end loading]

$$P_n = Ct^2 F_y \sin(90) \left( 1 - C_R \sqrt{\frac{R}{t}} \right) \left( 1 + C_N \sqrt{\frac{N}{t}} \right) \left( 1 - C_h \sqrt{\frac{h}{t}} \right)$$

**O.K.** # clips = 2

**O.K.** # clips = 3

**Check Web Stiffener**

16Ga x 3/4" x 7" [C-channel]

width of stiffener = 7.000 in

web of stiff. w = 6.717 in

\*\*\*Check w/ts ≤ 1.28√E/F<sub>y</sub>

w/ts = 118.675

1.28√E/F<sub>y</sub> = 31.091 --> w/ts over limit Use C3.7.2

P<sub>n</sub> = 0.7(P<sub>wc</sub> + A<sub>e</sub>F<sub>y</sub>) ≥ P<sub>wc</sub>

P<sub>wc</sub> = 2.422 k

P<sub>n</sub> = 15.002 k

A<sub>e</sub> = 0.380 in<sup>2</sup>

P<sub>n</sub>/Ω = 8.825 k

**Not Req'd**

**Corner Connections**

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T<sub>crn</sub>max = 260 lbs      Max(F<sub>pmaxASD</sub>/4 -OR- F<sub>hASDtrans</sub>/4 corner connections)

V<sub>crn</sub>max = 380 lbs      Max(Tens/2 -OR- Comp/2 corner connections per side)

Bolt:      T<sub>all</sub> = 2480 lbs      V<sub>all</sub> = 1208 lbs

Threaded Insert:      T<sub>all</sub> = 2860 lbs      V<sub>all</sub> = 1536 lbs

# of Bolts required for Tension = 0.1

# of Bolts required for Shear = 0.3

# of Bolts Used = 2.0

Check Combined Stress in Bolts & Inserts: 0.210 **O.K.**

**Check 1/8" welded connection**

<--- USE WELD

Ω = 2.35

Assume L/t > 25: 25\*t = 1.783 in

L<sub>req'd</sub> = 0.257 in

$$P_n/\Omega = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$$

$$L_{req'd} = \frac{V_{req} \Omega}{0.75 t F_u}$$



## Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$  in

$F_{u1} = 65$  ksi

$t_2 = 0.1017$  in (unit base rail thickness)

$F_{u2} = 65$  ksi

$d = 0.190$  in (screw diameter)

$d_w = 0.375$  in (nom. washer diameter)

$t_2/t_1 = 1.4$

For  $t_2/t_1 \leq 1.0$ :

$P_{ns} = 2377$  #

For  $t_2/t_1 \geq 2.5$ :

$P_{ns} = 2377$  #

**Shear:**  $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$  3.86 k

$P_{ns} = 2.7t_1dF_{u1}$  2.38 k

$P_{ns} = 2.7t_1dF_{u1}$  2.38 k

$P_{ns} = 2.7t_2dF_{u2}$  3.39 k

$P_{ns} = 2.7t_2dF_{u2}$  3.39 k

$P_{ns}/\Omega = 792$  #

$P_{ss}/\Omega = 540$  # <- Controls

$P_{not} = 0.85t_c d F_{u2}$

**Tension:**  $P_{not} = 1.068$  k (screw pull-out strength)

$t_c = \min(t_1, t_2)$

$P_{nov} = 2.607$  k (screw pull-over strength)

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 356$  # <- Controls

$P_{ts}/\Omega = 820$  #

(full tensile screw capacity)

	Shear [k]	# clips	$V_{clip}$ [k]	$V_{allow}$ [lb]	# screws	spacing
Long side:	1.040	2	0.52	540 #	2	6.00 in
Short side:	0.782	3	0.26	540 #	2	6.00 in

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.57 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$  ksi

$\Omega = 2.22$  bolt/screw connection

$A_{gv} = 0.463$  in<sup>2</sup>

$A_{nv} = 0.443$  in<sup>2</sup>


$A_{nt} = 0.042$  in<sup>2</sup>

$R_n/\Omega = 7.500$  k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

(AISI Sect. E5.3)

BSR O.K.

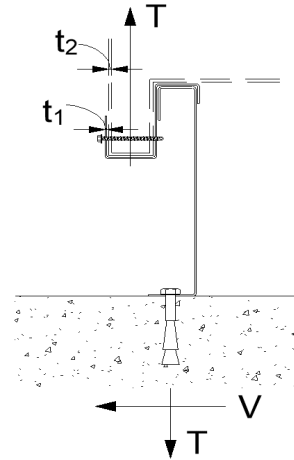

## Connection of Curb to Supporting Structure

### Roof Loading

SEISMIC:  $(0.6-0.14S_{DS})D + 0.7E$

WIND:  $0.6D + W$

Transverse:	Uplift <sub>MAX</sub> = 982 lbs	Shear <sub>MAX</sub> = 520 lbs
Compression <sub>SEISMIC</sub> =	1223 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension <sub>SEISMIC</sub> =	982 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression <sub>WIND</sub> =	556 lbs	$= [F_h ASD_{trans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vert ASD} * w_{curb}/2] / w_{curb}$
Tension <sub>WIND</sub> =	777 lbs	$= [F_h ASD_{trans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vert ASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	Uplift <sub>MAX</sub> = 743 lbs	Shear <sub>MAX</sub> = 513 lbs
Compression <sub>SEISMIC</sub> =	984 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension <sub>SEISMIC</sub> =	743 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression <sub>WIND</sub> =	169 lbs	$= [F_h ASD_{long} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vert ASD} * L_{curb}/2] / L_{curb}$
Tension <sub>WIND</sub> =	391 lbs	$= [F_h ASD_{long} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vert ASD} * L_{curb}/2] / L_{curb}$

### Wood Attachment:

1/4"  $\phi$  x 3.5" Simpson SDS screws w/ 2.25" threaded emt (SGmin = 0.43)

Transverse:	Tall <sub>metal</sub> = 997 lbs	Vall <sub>metal</sub> = 1097 lbs
	Tall <sub>wood</sub> = 616 lbs	Vall <sub>wood</sub> = 672 lbs
# of Screws Req'd for Uplift =	1.59	COMBINED LOADING: 0.789 O.K.
# of Screws Req'd for Shear =	0.77	Screw Spacing = 38.0 in o.c.
Total # of screws Required =	3	

1/4"  $\phi$  x 3.5" Simpson SDS screws @ 38 in o.c. along long side of curb w/ 2.25" threaded embed

### Longitudinal:

# of Screws Req'd for Uplift =	1.2	COMBINED LOADING: 0.985 O.K.
# of Screws Req'd for Shear =	0.8	Screw Spacing = 45.5 in o.c.
Total # of screws Required =	2	

1/4"  $\phi$  x 3.5" Simpson SDS screws @ 45.5 in o.c. along short side of curb w/ 2.25" threaded embed

### Steel Deck Attachment:

1/2"  $\phi$  A307 Bolts to steel angle below deck

Transverse:	Tall <sub>bolt</sub> = 3927 lbs	Vall <sub>bolt</sub> = 2209 lbs
	Tall <sub>metal</sub> = 2086 lbs	Vall <sub>metal</sub> = 2192 lbs
# of Bolts Req'd for Uplift =	0.47	COMBINED LOADING: 0.118 O.K.
# of Bolts Req'd for Shear =	0.24	Bolt Spacing = 72.0 in o.c.
Total # of Bolts Required =	2	

1/2"  $\phi$  A307 Bolts to steel angle below deck @ 72 in o.c. along long side of curb

### Longitudinal:

# of Bolts Req'd for Uplift =	0.36	COMBINED LOADING: 0.084 O.K.
# of Bolts Req'd for Shear =	0.23	Req'd Min Spacing = 41.5 in o.c.
Total # of Bolts Required =	2	

1/2"  $\phi$  A307 Bolts to steel angle below deck @ 41.5 in o.c. along short side of curb



**For Concrete anchorage:** SEISMIC  $(0.6-0.14S_{DS})D + 0.7\Omega_o E$   $\Omega_o = 2.0$

**Concrete Attachment:** 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed

$$Tall_{LRFD} = 1722 \text{ lbs} \quad Vall_{LRFD} = 2032 \text{ lbs} \quad \alpha = (1 + 0.2SDS)D + 2.5E = 1.708$$

$$Tall_{ASD} = Tall_{LRFD}/\alpha = 920.9 \text{ lbs} \quad Vall_{ASD} = Vall_{LRFD}/\alpha = 1086.6 \text{ lbs} \quad (D = 0.758, E = 0.242)$$

<b>Transverse:</b>	Uplift <sub>MAX</sub> = 1194 lbs	Shear <sub>MAX</sub> = 1026 lbs
Compression <sub>SEISMIC</sub> = 1880 lbs	= $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$	
Tension <sub>SEISMIC</sub> = 1194 lbs	= $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$	
Shear <sub>SEISMIC</sub> = 1026 lbs	= $\Omega_o * F_{pmaxASD} / 2$	
Min Bolts Req'd Uplift = 1.30	spacing = 72.00 in o.c.	Applied = 398.1 lbs
Min Bolts Req'd Shear = 2.00	spacing = 72.00 in o.c.	Applied = 171.0 lbs

Try using 3 bolts spaced at 36.00 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.59$
--	--

Use 3 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 36 in o.c. max. along long side of curb w/ 4" embed

<b>Longitudinal:</b>	Uplift <sub>MAX</sub> = 717 lbs	Shear <sub>MAX</sub> = 1026 lbs
Compression <sub>SEISMIC</sub> = 1403 lbs	= $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$	
Tension <sub>SEISMIC</sub> = 717 lbs	= $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$	
Shear <sub>SEISMIC</sub> = 1026 lbs	= $\Omega_o * F_{pmaxASD} / 2$	
Min Bolts Req'd Uplift = 0.78	spacing = 20.75 in o.c.	Applied = 239.0 lbs
Min Bolts Req'd Shear = 2.00	spacing = 41.50 in o.c.	Applied = 171.0 lbs

Try using 3 bolts spaced at 20.75 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.42$
--	--

Use 3 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 20.8 in o.c. max. along short side of curb w/ 4" embed

<b>CURB DESIGN SUMMARY:</b> CBKD-141 KDKITPRL			<b>Unit:</b> ZX, ZY 08-12; ZX 14; ZY 07
<b>CURB RAIL THICKNESS:</b> 0.0713 in 14 Gauge			
<b>UNIT CLIP THICKNESS:</b> 0.0713 in 14 Gauge			
# OF CLIPS (LONG SIDE) - 2 clips with 2 - #10 SMS screws each clip			
<b>WEB STIFFENER:</b> NOT REQUIRED			
# OF CLIPS (SHORT SIDE) - 3 clips with 2 - #10 SMS screws each clip			
<b>WEB STIFFENER:</b> NOT REQUIRED			
<b>CORNER CONNECTION:</b> Use 2 - 1/4" $\phi$ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts			
<b>CURB ANCHORAGE</b>	<b>WOOD</b>	<b>STEEL</b>	<b>CONCRETE</b>
	1/4" $\phi$ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	1/2" $\phi$ A307 Bolts to steel angle below deck	3/4" $\phi$ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
<b>LONG DIRECTION</b>	3 @ 38 in o.c.	2 @ 72 in o.c.	3 @ 36 in o.c.
<b>SHORT DIRECTION</b>	2 @ 45.5 in o.c.	2 @ 41.5 in o.c.	3 @ 20.75 in o.c.