




MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120

619-727-4800

Structural Calculations
for
CBKD Series Roof Curbs
CBKD-94A (80-265-13)
2020 Florida Building Code requirements

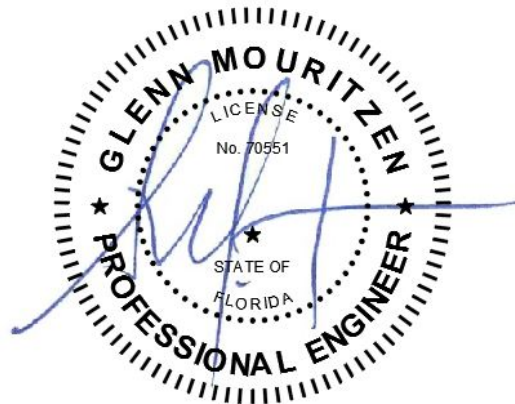


Exp. 02 / 28 / 2023

Prepared for:

PROVENT
3847 Wabash Drive
Mira Loma, CA 91725

Date: May 19, 2021
Project Number: PV2101

STEEL ATTACHMENT

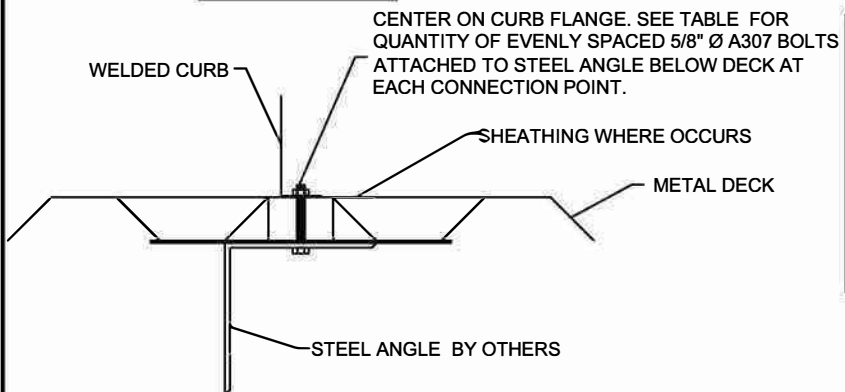


WIND LOAD ROOF ANCHORAGE DETAIL

Meets wind requirements for the following codes:
 FBC 2020
 based on ASCE 7-16.

Wind:
 190 mph exposure D category III or IV
 building, max BLDG height: 60 ft
 Kzt=1.00 max

CONCRETE ATTACHMENT

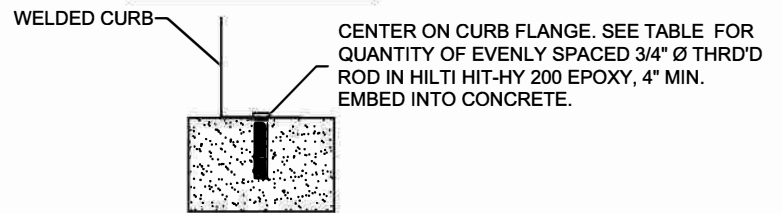


- NORMAL WEIGHT CONC SLAB
- f_c=4000 PSI MIN
- 6" MIN THICK CONC.
- SPECIAL INSPECTION REQUIRED (ESR-3187)

CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE *	
80-265-49	2 @ 34.5" o.c.	2 @ 19" o.c.	LXS
80-265-50	2 @ 34.5" o.c.	2 @ 29" o.c.	LXL
80-265-13	2 @ 61" o.c.	2 @ 25.25" o.c.	SUNLINE 3-6 TON
80-265-45	2 @ 58.38" o.c.	2 @ 28.19" o.c.	PRESTIGE SMALL
80-265-46	2 @ 72" o.c.	2 @ 41" o.c.	PRESTIGE LARGE
80-265-29	3 @ 34.69" o.c.	2 @ 39.5" o.c.	PREDATOR
80-265-19	3 @ 51.63" o.c.	2 @ 72" o.c.	SUNLINE ULTRA
80-265-18	3 @ 57.13" o.c.	2 @ 72" o.c.	SUNLINE MAGNA

CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE **	
80-265-49	5 @ 8.63" o.c.	3 @ 9.5" o.c.	LXS
80-265-50	5 @ 8.63" o.c.	4 @ 9.67" o.c.	LXL
80-265-13	5 @ 15.25" o.c.	3 @ 12.63" o.c.	SUNLINE 3-6 TON
80-265-45	5 @ 14.59" o.c.	3 @ 14.09" o.c.	PRESTIGE SMALL
80-265-46	5 @ 18" o.c.	4 @ 13.67" o.c.	PRESTIGE LARGE
80-265-29	9 @ 8.67" o.c.	5 @ 9.88" o.c.	PREDATOR
80-265-19	8 @ 14.75" o.c.	6 @ 14.4" o.c.	SUNLINE ULTRA
80-265-18	12 @ 10.39" o.c.	8 @ 10.29" o.c.	SUNLINE MAGNA


WOOD ATTACHMENT

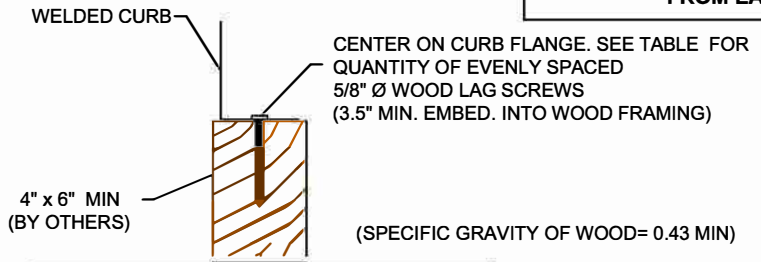


STEEL AND CONCRETE ANCHORS ARE 6" FROM EACH CORNER EVENLY SPACED

CURB KIT	NO. OF ANCHORAGE SCREWS REQUIRED		UNIT
	LONG SIDE	SHORT SIDE	
80-265-49	6 @ 7.7" o.c.	3 @ 11.5" o.c.	LXS
80-265-50	5 @ 9.63" o.c.	5 @ 8.25" o.c.	LXL
80-265-13	6 @ 13" o.c.	3 @ 14.63" o.c.	SUNLINE 3-6 TON
80-265-45	6 @ 12.48" o.c.	3 @ 16.09" o.c.	PRESTIGE SMALL
80-265-46	6 @ 15.2" o.c.	4 @ 15" o.c.	PRESTIGE LARGE
80-265-29	10 @ 8.15" o.c.	6 @ 8.7" o.c.	PREDATOR
80-265-19	8 @ 15.32" o.c.	6 @ 15.2" o.c.	SUNLINE ULTRA
80-265-18	14 @ 9.1" o.c.	8 @ 10.86" o.c.	SUNLINE MAGNA

CONCRETE OVER METAL DECK

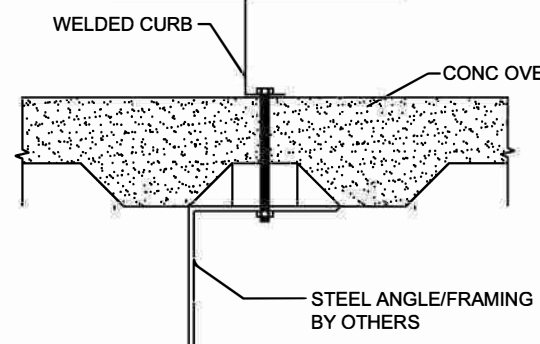

NOTE: FOR CONC OVER METAL DECK OVER STEEL FRAMING USE STEEL ATTACHMENT

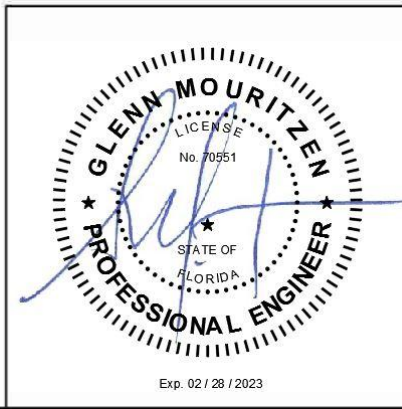

Exp. 02 / 28 / 2023

FOUR INCHES FROM EACH CORNER EVENLY SPACED.



1625 DIPLOMAT DRIVE
 CARROLTON, TX 75006

PHONE (972) 247-7447
 FAX (972) 243-0940

SUBMITTED TO: _____
 COMPANY: _____
 JOB NAME: _____
 EQUIPMENT: _____
 NOTES: _____

FORM NO: CB-25A

DATE: 3/29/2021	REV: 2	DRAWN BY: ALL
-----------------	--------	---------------

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-25A.

Will conform to wind load code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)







CALCULATED WIND ROOF CURBS FOR YORK UNITS

ZR, XN, XP 036-060
ZE, ZF 036-072

ProVent P/N	A	WEIGHT
80-265-1314	14"	117 Lbs
80-265-1318	18"	141 Lbs

Meets wind requirements for the following codes:
FBC 2020
based on ASCE 7-16.

Wind:
190 mph exposure D category III or IV building, max BLDG height: 60 ft
Kzt=1.00 max

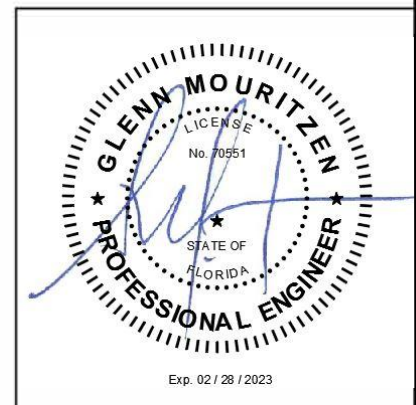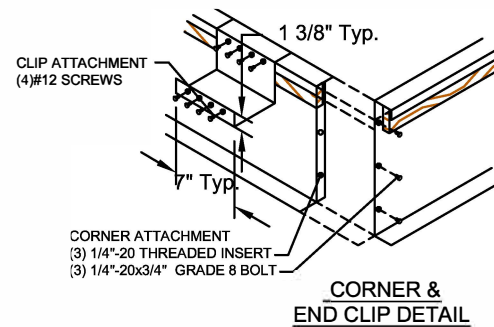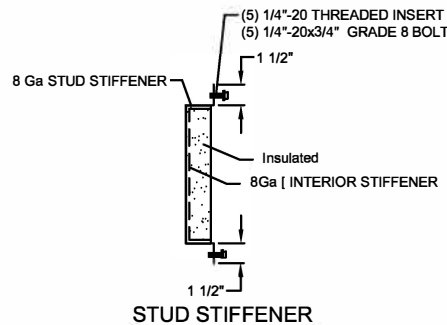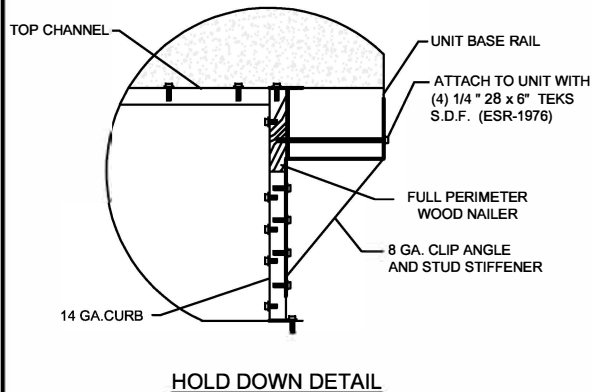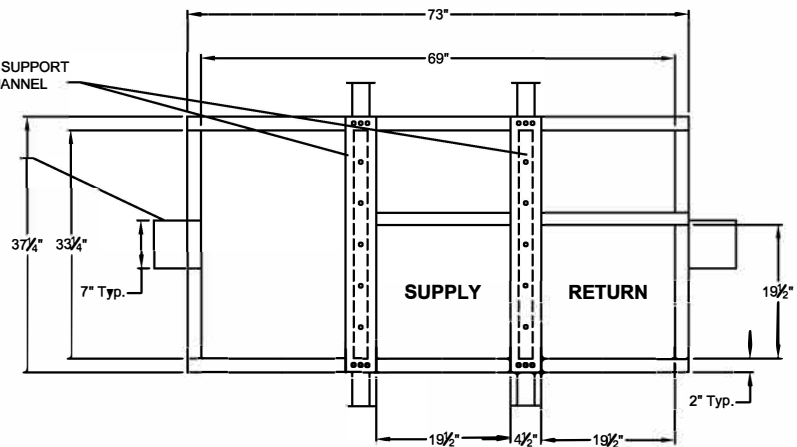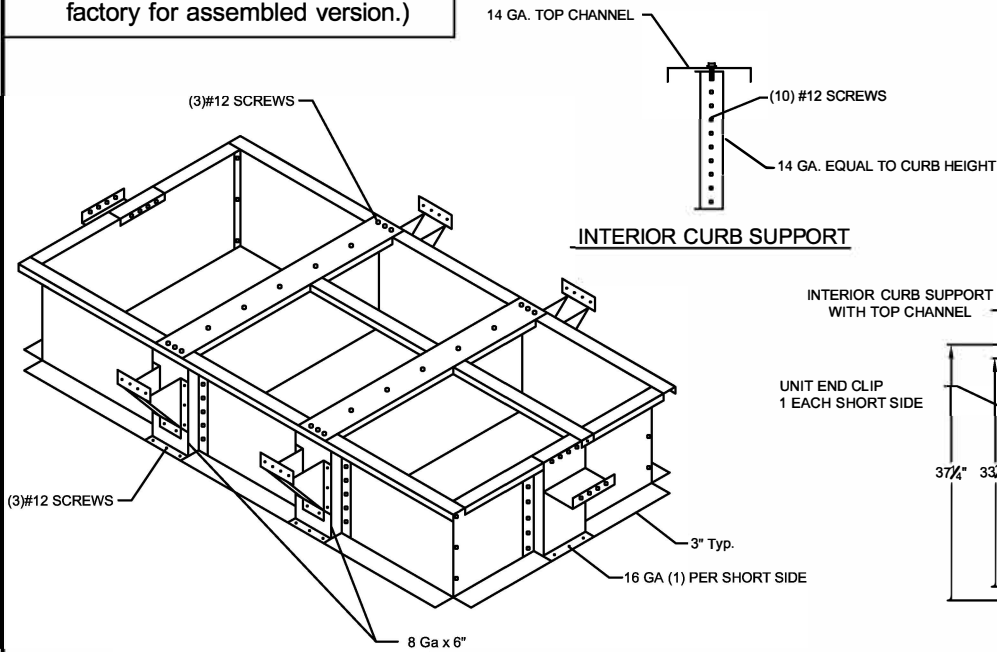

1625 DIPLOMAT DRIVE
CARROLTON, TX 75006

PHONE (972) 247-7447
FAX (972) 243-0940

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-94A

DATE:
3/29/2021

REV:
3

PART NUMBER:
80-265-13

DRAWN BY:
ALL




Client:	ProVent PV2101	Previous:	PV1807
Description:	CBKD-94	80-265-13**	
Unit:	ZR, XN, XP 036-060; ZE, ZF 036-072		

Curb Information

Hcurb =	18 in	(Height of curb)
Lcurb =	73 in	(Length of curb)
wcurb =	37.25 in	(Width of curb)
WGTCurb =	141 lbs	(Weight of curb)
# Clips long side =	2	# Clips short side = 1

Unit Information

WGTunit =	640 lbs	(Weight of Unit)
Wtmax =	166 lbs	(Maximum corner weight)
Wtmin =	76 lbs	(Minimum corner weight)
Hunit =	32.625 in	(Height of unit above curb)
Hcm =	16.3125 in	(Height to center of mass)
Lunit =	82.25 in	(Length of unit)
Wunit =	44.875 in	(Width of unit)

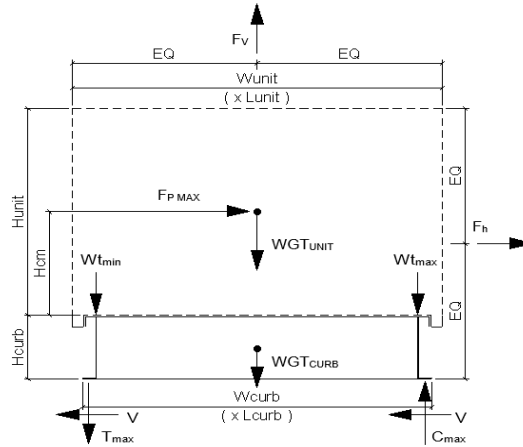

Seismic Loading - 2020 FBC/2018 IBC

Ss =	0.15	(Worst Case for state of Florida)
Fa =	2.4	(Worst case Site class E from Table 11.4-1 ASCE 7-16)
Sms =	0.360	(Fa*Ss)
Sds =	0.240	(2/3*Sms)
Ip =	1.5	(Importance Factor Category III or IV Building)
Fpmax =	0.576 WGTunit	(1.6*Sds*Ip)*WGTunit (Eq 13.3-2 ASCE 7-16)
FpmaxASD =	258 lbs	(0.7*Fpmax)
	(unit only)	FpmaxASD = 315 lbs (unit and curb)

Wind Loading - 2020 FBC/2018 IBC

Kz =	1.31	*** Exposure Category D *** (For 60 ft roof height, Exposure D - Table 26.10-1 ACSE 7-16)
Kzt =	1.00	(Max. assumed topographic factor)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
Ke =	1.00	(Ground Elevation Factor Table 26.9-1 ASCE 7-16)
V =	190	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)
GCr _(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr _(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	102.9 psf	= 0.00256*Kz*Kzt*Kd*Ke*V ² (Eq. 26.10-1 ASCE 7-10)
F _{h ASD trans} =	3392 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
F _{h ASD long} =	1851 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
F _{vert ASD} =	2374 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:		
Compression _{SEISMIC} =	456 lbs	= [FpmaxASD*Hcm+2*(1+0.14S _{DS})*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	94 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*WGTunit
Compression _{WIND} =	498 lbs	= [F _{h trans ASD} *Hcm+2*0.6*Wtmax*wcurb-F _{vert ASD} *wcurb/2]/wcurb
Tension _{WIND} =	2488 lbs	= Comp _{WIND} +Fvert-0.6*WGTunit
---> Negative values indicate opposite load.		

Longitudinal:		
Compression _{SEISMIC} =	401 lbs	= [FpmaxASD*Hcm+2*(1+0.14*S _{DS})*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	38 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*WGTunit
Compression _{WIND} =	-574 lbs	= [F _{h trans ASD} *Hcm+2*0.6*Wtmax*Lcurb-F _{vert ASD} *Lcurb/2]/Lcurb
Tension _{WIND} =	1416 lbs	= Comp _{WIND} +Fvert-0.6*WGTunit
---> Negative values indicate opposite load.		

Governing Reactions:

Transverse:	Comp _{MAX} =	498 lbs	---> Along long edge of curb.
(on long edge)	Tens _{MAX} =	2488 lbs	---> Along long edge of curb.
Longitudinal:	Comp _{MAX} =	401 lbs	---> Along short edge of curb.
(on short edge)	Tens _{MAX} =	1416 lbs	---> Along short edge of curb.
---> Negative values indicate opposite load.			




Curb Design

F_y = 50 ksi F_u = 65 ksi t = 0.0713 14 Gauge
E = 29500 ksi

Calculate Section Properties of Curb

A' = 18.000 in	a = 17.644 in = A' - (2r+t)
B' = 2.000 in	a' = 17.929 in = A' - t
C' = 0.000 in (0 if no lips)	b = 1.822 in = B' - [r+t/2+a(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 1.964 in = B' - [t/2+at/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = a[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = a[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.178 in (Distance between centroid and web centerline)	
I _x = 56.073 in (Moment of Inertia about X-Axis)	
I _y = 0.311 in (Moment of Inertia about Y-Axis)	
A = 1.55 in ²	
r _x = 6.02 in	
r _y = 0.448 in	
r _{min} = 0.448 in	

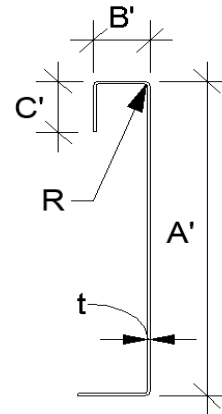

Axial Compression

P _u = 1.696 k	(Max Axial Comp)	Ω _c = 1.80
P _n /Ω _c = 31.332 k		
F _e = 65.88 ksi	$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$	$\lambda_c = \sqrt{\frac{F_y}{F_e}}$
λ _c = 0.87	$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$	$F_e = \frac{\pi^2 E}{(kl/r)^2}$
F _n = 36.39 ksi	$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$	
L _y = 37 in	Lateral unbraced length	
k _y L _y /r _y = 66	(assume k=0.8)	

Compression Check = O.K.

Check Web Crippling

h = 18 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 252.45 ≤ 200	C _R = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.388889 ≤ 2.0	C _h = 0.02	
P _n = 2.296 k	R/t = 1.50 ≤ 9.0		
P _n /Ω _w = 1.312 k			
Long side: P _{uTrans} = 0.249 k	O.K. # clips = 2		
Short side: P _{uLong} = 0.401 k	O.K. # clips = 1		

*****h/t > 200; use web stiffeners**

Check Web Stiffener

16Ga x 3/4" x 7" (C-channel)

width of stiffener = 7.000 in	ts = 0.0566 16 Gauge
web of stiff. w = 6.717 in	Rs = 0.0849 in
***Check w/ts ≤ 1.28√E/F _y	Ω _c = 1.70
w/ts = 118.675	
1.28√(E/F _y) = 31.091	--> w/ts over limit Use C3.7.2
P _n = 0.7(P _{wc} + A _e F _y) ≥ P _{wc}	
P _{wc} = 2.296 k	A _e = 0.380 in ²
P _n = 14.913 k	P _n /Ω = 8.773 k

O.K.

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T _{crnmax} = 848 lbs	Max(F _{pmaxASD} /4 -OR- F _{hASDtrans} /4 corner connections)
V _{crnmax} = 1244 lbs	(Max Ten/2 corner connections per side)
Bolt: Tall = 2480 lbs	Vall = 1096 lbs
Threaded Insert: Tall = 2860 lbs	Vall = 1714 lbs
# of Bolts required for Tension = 0.3	
# of Bolts required for Shear = 1.1	
# of Bolts Used = 2.0	***If combined fails: USE --> 3.0
Check Combined Stress in Bolts & Inserts: 0.738 O.K.	StressComb = 0.492 O.K.

Check 1/8" welded connection

<--- USE WELD Ω = 2.35

Assume L/t > 25: 25*t = 1.783 in	$\frac{P_n}{\Omega} = \frac{1}{\Omega} 0.75tLF_u \geq V_{req}$	$L_{req'd} = \frac{V_{req}\Omega}{0.75tF_u}$
L _{req'd} = 0.841 in		



Connection Unit to Curb Clip

#14 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$ in

$F_{u1} = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_{u2} = 65$ ksi

$d = 0.242$ in (screw diameter)

$d_w = 0.500$ in (nom. washer diameter)

$t_2/t_1 = 1.4$

For $t_2/t_1 \leq 1.0$:

$P_{ns} = 3028$ #

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 3028$ #

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ 4.36 k

$P_{ns} = 2.7t_1dF_{u1}$ 3.03 k

$P_{ns} = 2.7t_1dF_{u1}$ 3.03 k

$P_{ns} = 2.7t_2dF_{u2}$ 4.32 k

$P_{ns} = 2.7t_2dF_{u2}$ 4.32 k

$P_{ns}/\Omega = 1009$ # <- Controls

$P_{ss}/\Omega = 1045$ #

Tension:

$P_{not} = 1.360$ k (screw pull-out strength)

$P_{not} = 0.85t_c d F_{u2}$

$P_{nov} = 3.476$ k (screw pull-over strength)

$t_c = \min(t_1, t_2)$

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 453$ # <- Controls

$P_{ts}/\Omega = 1220$ #

(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	0.925	2	0.46	1009 #	2	6.00 in
Short side:	1.696	1	1.70	1009 #	2	6.00 in

clip width (in) = 7.00

clip height = 2.5 in

min spacing = 0.73 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

$F_y = 50$ ksi

$\Omega = 2.22$ bolt/screw connection

$A_{gv} = 0.463$ in²

$A_{nv} = 0.438$ in²


$A_{nt} = 0.080$ in²

$R_n/\Omega = 8.620$ k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

(AISI Sect. E5.3)

BSR O.K.

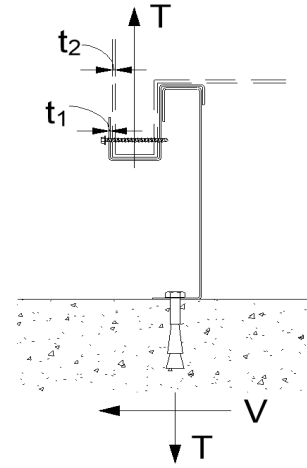

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: (0.6-0.14SDS)D + 0.7E

WIND: 0.6D + W

Transverse:	Uplift _{MAX} =	4077 lbs	Shear _{MAX} =	1696 lbs
Compression _{SEISMIC}	694 lbs	= [F _{pmaxASD} *(H _{cm} +H _{curb})+(1+0.14S _{DS})*(WGT _{unit+curb} /2)*w _{curb}]/w _{curb}		
Tension _{SEISMIC}	251 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*(WGT _{unit+curb})		
Compression _{WIND}	2172 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})+0.6*(WGT _{unit+curb} /2)*w _{curb} -F _{vertASD} *w _{curb}]/2/w _{curb}		
Tension _{WIND}	4077 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})-0.6*(WGT _{unit+curb} /2)*w _{curb} +F _{vertASD} *w _{curb}]/2/w _{curb}		
Longitudinal:	Uplift _{MAX} =	1823 lbs	Shear _{MAX} =	925 lbs
Compression _{SEISMIC}	552 lbs	= [F _{pmaxASD} *(H _{cm} +H _{curb})+(1+0.14S _{DS})*(WGT _{unit+curb} /2)*L _{curb}]/L _{curb}		
Tension _{SEISMIC}	109 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*(WGT _{unit+curb})		
Compression _{WIND}	-83 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})+0.6*(WGT _{unit+curb} /2)*L _{curb} -F _{vertASD} *L _{curb}]/2/L _{curb}		
Tension _{WIND}	1823 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})-0.6*(WGT _{unit+curb} /2)*L _{curb} +F _{vertASD} *L _{curb}]/2/L _{curb}		

Wood Attachment:

Use 5/8" ϕ wood lag screws

w/ 3.5" Min. Embed

Transverse:	Tall _{metal} = 946.67 lbs	Vall _{metal} = 1043.33 lbs
	Tall _{wood} = 1195.95 lbs	Vall _{wood} = 1024 lbs
	# of Screws Req'd for Uplift = 4.31	COMBINED LOADING: 0.902 O.K.
	# of Screws Req'd for Shear = 1.66	Screw Spacing = 13.0 in o.c.
	Total # of screws Required = 6	

Use 5/8" ϕ wood lag screws @ 13 in o.c. along long side of curb w/ 3.5" Min. Embed

Longitudinal:

# of Screws Req'd for Uplift = 1.9	COMBINED LOADING: 0.742 O.K.
# of Screws Req'd for Shear = 0.9	Screw Spacing = 14.6 in o.c.
Total # of screws Required = 3	

Use 5/8" ϕ wood lag screws @ 14.6 in o.c. along short side of curb w/ 3.5" Min. Embed

Steel Deck Attachment:

Use 5/8" ϕ A307 Bolts attached to steel angle below deck

Transverse:	Tall _{bolt} = 6903 lbs	Vall _{bolt} = 3682 lbs
	6903 lbs	3682 lbs
	# of Bolts Req'd for Uplift = 0.59	COMBINED LOADING: 0.218 O.K.
	# of Bolts Req'd for Shear = 0.46	Bolt Spacing = 61.0 in o.c.
	Total # of Bolts Required = 2	

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 61 in o.c. along long side of curb

Longitudinal:

# of Bolts Req'd for Uplift = 0.26	COMBINED LOADING: 0.066 O.K.
# of Bolts Req'd for Shear = 0.25	Req'd Min Spacing = 25.3 in o.c.
Total # of Bolts Required = 2	

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 25.3 in o.c. along short side of curb



For Concrete anchorage: SEISMIC (0.6-0.14SDS)D + 0.7Ω_oE (Ω_o = 2.5)

Concrete Attachment: 3/4" φ Hilti Hit-HY 200 adhesive anchors w/ 4" embed

Tall_{LRFD} = 1722 lbs Vall_{LRFD} = 2032 lbs α = (1 + 0.2SDS)D + 2.5E = 1.87

Tall_{ASD} = Tall_{LRFD}/α = 920.9 lbs Vall_{ASD} = Vall_{LRFD}/α = 1086.6 lbs (D = 0.465, E = 0.535)

Transverse:	Uplift _{MAX} = 4077 lbs	Shear _{MAX} = 1696 lbs
--------------------	----------------------------------	---------------------------------

Compression_{SEISMIC} = 1129 lbs = [2.5*FpmaxASD*(Hcm+Hcurb)+(1+0.14SDS)*(WGT_{unit+curb}/2)*wcurb]/wcurb

Tension_{SEISMIC} = 686 lbs = Comp_{SEISMIC} - [0.6-0.14SDS]*(WGT_{unit+curb})

Shear_{SEISMIC} = 394 lbs = 2.5*FpmaxASD/2

Min Bolts Req'd Uplift = 4.43 spacing = 12.25 in o.c. T_{applied} = 815.5 lbs

Min Bolts Req'd Shear = 2.00 spacing = 49 in o.c. V_{applied} = 212.0 lbs

Try using 5 bolts spaced at 15.25 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.08$
---	--

Use 5 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 15.3 in o.c. max. along long side of curb w/ 4" embed

Longitudinal:	Uplift _{MAX} = 1823 lbs	Shear _{MAX} = 1696 lbs
----------------------	----------------------------------	---------------------------------

Compression_{SEISMIC} = 774 lbs = [2.5*FpmaxASD*(Hcm+Hcurb)+(1+0.14SDS)*(WGT_{unit+curb}/2)*Lcurb]/Lcurb

Tension_{SEISMIC} = 331 lbs = Comp_{SEISMIC} - [0.6-0.14SDS]*(WGT_{unit+curb})

Shear_{SEISMIC} = 394 lbs = 2.5*FpmaxASD/2

Min Bolts Req'd Uplift = 1.98 spacing = 13.25 in o.c. T_{applied} = 607.5 lbs

Min Bolts Req'd Shear = 2.00 spacing = 13.25 in o.c. V_{applied} = 212.0 lbs

Try using 3 bolts spaced at 12.63 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.85$
---	--

Use 3 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 12.6 in o.c. max. along short side of curb w/ 4" embed

CURB DESIGN SUMMARY: CBKD-94 80-265-13**		Unit: ZR, XN, XP 036-060; ZE, ZF 036-072
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		
# OF CLIPS (LONG SIDE) - 2 clips with 2 - #14 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip		
# OF CLIPS (SHORT SIDE) - 1 clips with 2 - #14 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip		
CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
CURB ANCHORAGE	WOOD 5/8" φ lag screw w/ min. 3.5" embed (SGmin=0.43)	STEEL 5/8" φ A307 bolts to steel angle below
		CONCRETE 3/4" φ thr'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
LONG DIRECTION	6 @ 13 in o.c.	2 @ 61 in o.c.
SHORT DIRECTION	3 @ 14.63 in o.c.	2 @ 25.25 in o.c.
		5 @ 15.25 in o.c.
		3 @ 12.63 in o.c.