


**STEEL ATTACHMENT**

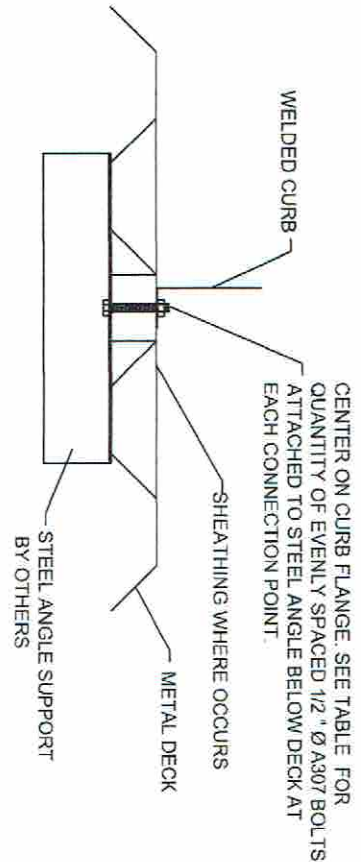

CURB	NO. OF ANCHORAGE BOLTS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	XX @ 2 @ 19" O.C.
LXL	2 @ 34.5" O.C.XX	2 @ 29" O.C.
SUN3672	2 @ 60" O.C.	2 @ 24.25" O.C.
PRD3715	2 @ 68.38" O.C.	2 @ 38.5" O.C.
PRS	2 @ 58.38" O.C.	2 @ 28.19" O.C.
PRL	2 @ 72" O.C.	2 @ 41" O.C.
SLU180	2 @ 102.25" O.C.	2 @ 71" O.C.
SLM1830	2 @ 113.25" O.C.	2 @ 71" O.C.

\* SIX INCHES FROM EACH CORNER EVENLY SPACED.  
\*\* CENTERED.

Meets seismic requirements for the following codes:  
CBC 2016  
IBC 2015


**ASSUMES:**  
CONC SLAB  
f<sub>c</sub> = 4000PSI MINIMUM  
6" MIN THICKNESS  
NORMAL WEIGHT CONCRETE  
OR SAND LIGHT WEIGHT  
CONCRETE ATTACHMENT  
WELDED CURB

ROOF ANCHORAGE DETAIL		
CBKD Series	CBWC Series	CBISC Series
LXS	LXS	LXS
LXL	LXL	LXL
SUN3672	SUN3672	SUN3672
PRD3715	PRD3715	PRD3715
PRS	PRS	PRS
PRL	PRL	PRL
SLU180	SLU180	SLU180
SLM1830	SLM1830	SLM1830



CURB	NO. OF ANCHORAGE BOLTS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	10 @ 3.73" O.C.	9 @ 2.38" O.C.
LXL	8 @ 4.93" O.C.	7 @ 4.83" O.C.
SUN3672	9 @ 7.5" O.C.	6 @ 4.85" O.C.
PRD3715	17 @ 4.27" O.C.	13 @ 3.21" O.C.
PRS	9 @ 7.3" O.C.	7 @ 4.7" O.C.
PRL	11 @ 7.2" O.C.	9 @ 5.13" O.C.
SLU180	16 @ 6.82" O.C.	13 @ 5.92" O.C.
SLM1830	18 @ 6.66" O.C.	13 @ 5.92" O.C.

**WOOD ATTACHMENT**

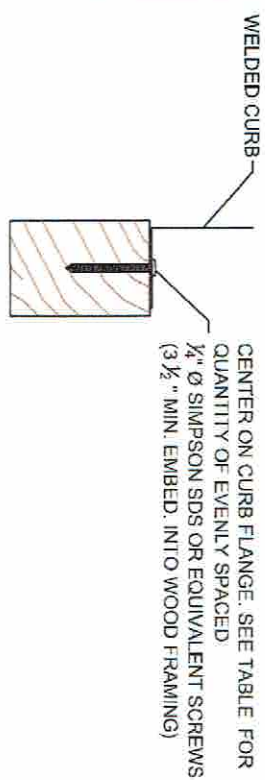

CURB	NO. OF ANCHORAGE SCREWS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	7 @ 6.42" O.C.	4 @ 7.67" O.C.
LXL	7 @ 6.42" O.C.	6 @ 6.8" O.C.
SUN3672	4 @ 21.33" O.C.	3 @ 14.13" O.C.
PRD3715	8 @ 10.34" O.C.	6 @ 8.5" O.C.
PRS	4 @ 20.79" O.C.	3 @ 16.09" O.C.
PRL	4 @ 25.33" O.C.	3 @ 22.5" O.C.
SLU180	7 @ 17.71" O.C.	7 @ 12.5" O.C.
SLM1830	8 @ 16.75" O.C.	6 @ 15" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE  
MIRA LOMA, CA 91725  
PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO: CB-60  
DATE: 07/31/18

REV: 3

DRAWN BY: ALL