



**MOUR GROUP**  
ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
619-727-4800

**Structural Calculations**  
**for**  
**CBISC-04 Series**  
**CBISCPRD3715\*\* SERIES**



**Prepared for:**

**PROVENT / RRS**

**3847 Wabash Drive**  
**Mira Loma, CA 91725**

**Date: July 13, 2022**

**Project Number: PV2203**

For wood, concrete and steel attachment see Roof Anchorage Detail, Form No. CB-62.

Welded isolation springs housing are standard. For bolted spring housing, neoprene pads and spring cups see Weldment and Bolting Detail, Form No. CB-61

## VIBRATION ISOLATION ROOF CURBS YORK UNITS

ZT, ZH, ZJ, ZR 037-150  
ZF, XP, ZB 078-150

PROVENT P/N	A	B	EST. WEIGHT
CBISCPRD371518**	8"	18"	365 Lbs
CBISCPRD371521**	11"	21"	387 Lbs
CBISCPRD371524**	14"	24"	410 Lbs

\*\*Note: Spring configuration must be added to part number at time of order


Meets seismic requirements for the following codes:  
CBC 2019  
IBC 2018

### FEATURES



- Roof curbs sides and ends are 14 ga.
- Fully welded construction.
- Gasketing package provided.
- Heat treated wood nailer provided.
- Insulated deck pans provided.
- Pitched curbs and taller curbs are available.
- CalDyn OSHPd pre-approved seismic restraints. (OPM-0401-13), (CQA).

### NOTES

- Attach ductwork to roof curb. Flanges of duct rest on top of the curb, Support ductwork below the curb.
- Thru the curb utilities are available. Contact your York distributor or Provent directly.

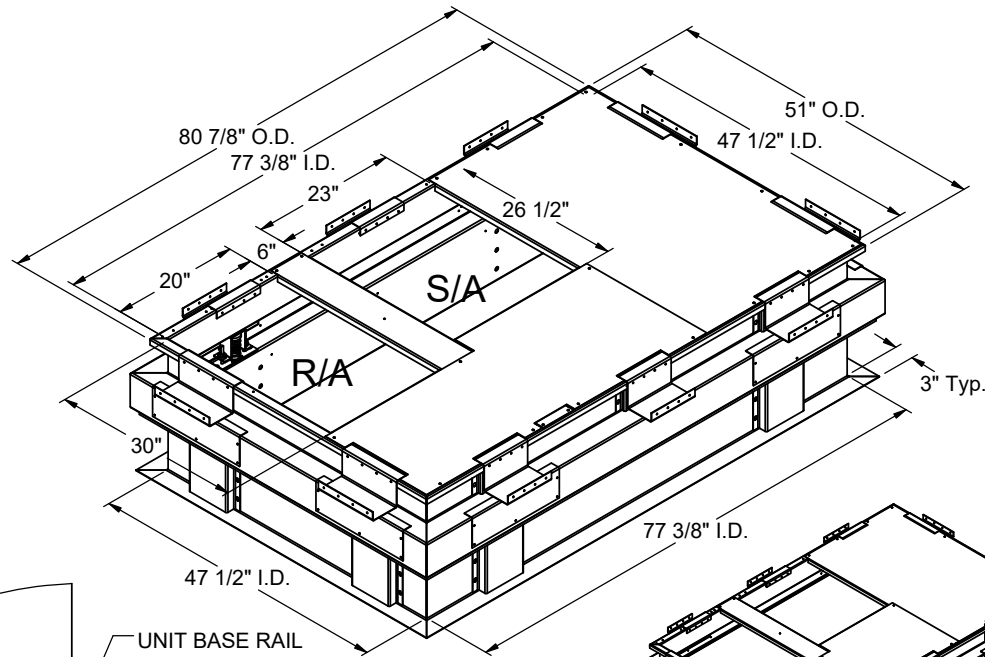

ATTACH TO CURB WITH (4) #10  
TEK SCREWS EACH SIDE

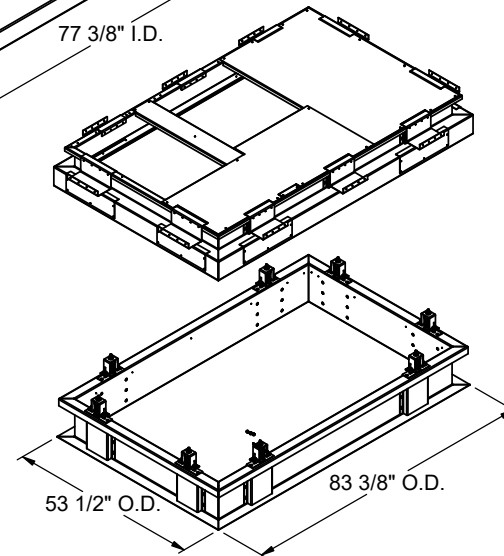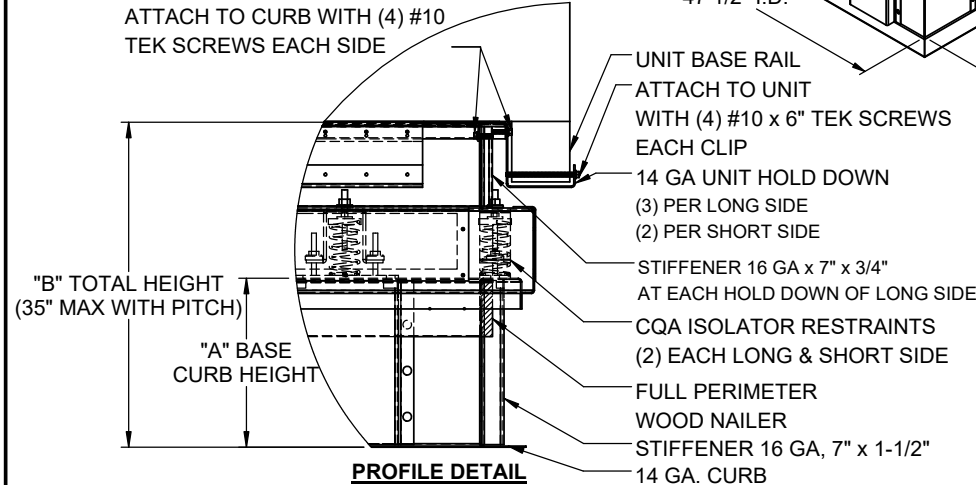

3847 WABASH DRIVE  
MIRA LOMA, CA 91752

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO:  
CBISC-04

DATE:  
6/30/2022


PART NUMBER:  
-

REV:  
4

DRAWN BY:  
FMM

**WELDMENT AND BOLTING DETAIL**

OPTIONAL  
WELD I.L.O.  
BOLTED STUD

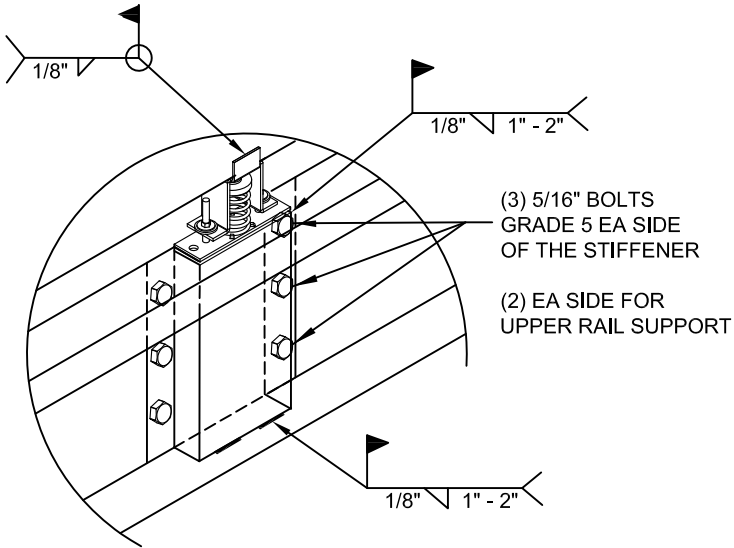


**BASE CURB SUPPORT**

(3) 5/16" BOLTS  
GRADE 5 EA SIDE  
OF THE STIFFENER  
  
(2) EA SIDE FOR  
UPPER RAIL SUPPORT

OPTIONAL BOTTOM  
BUMPER FOR:  
ISCALSLU180  
ISCALSLM1830

FOR JQA:  
3/16" Ø HOLE USE 1/2" Ø A307 BOLT  
WITH FLAT WASHER AND NUT

FOR JQB, JQBX, JQE, JQF:  
1/16" Ø HOLE USE 5/8" Ø A307 BOLT  
WITH FLAT WASHER AND NUT

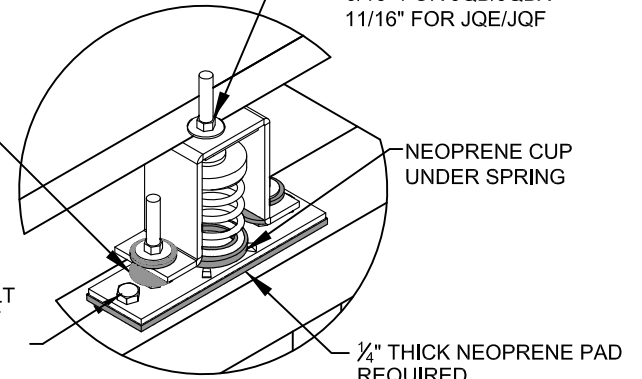

**FOR BOLT ON ISOLATORS**

HOLE FOR ISOLATOR STUD,  
W/ FLAT WASHER REQUIRED  
UNDER NUT  
7/16" FOR JQA  
9/16" FOR JQB/JQBX  
11/16" FOR JQE/JQF

NEOPRENE CUP  
UNDER SPRING

1/4" THICK NEOPRENE PAD  
REQUIRED



3847 WABASH DRIVE  
MIRA LOMA, CA 91725

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_


FORM NO:  
CB-61

DATE:  
02/08/18

REV:  
1

DRAWN BY:  
ALL

**STEEL ATTACHMENT**

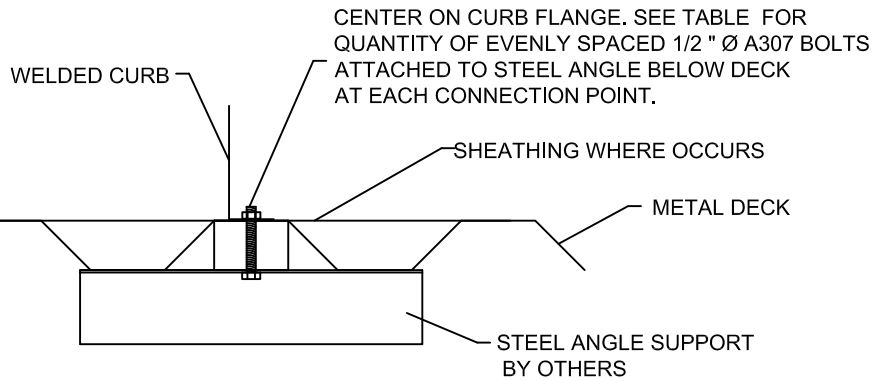


CURB	NO. OF ANCHORAGE BOLTS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	3 @ 19.25" O.C.	2 @ 23" O.C.
LXL	3 @ 19.25" O.C.	2 @ 33" O.C.
SUN3672	4 @ 21" O.C.	2 @ 27.25" O.C.
PRD3715	6 @ 14.28" O.C.	3 @ 20.75" O.C.
PRS	4 @ 20.46" O.C.	2 @ 31.13" O.C.
PRL	3 @ 36.13" O.C.	2 @ 44" O.C.
SLU180	4 @ 35.08" O.C.	3 @ 37" O.C.
SLM1830	5 @ 29.06" O.C.	4 @ 24.67" O.C.
SAV1518	4 @ 37.38" O.C.	3 @ 35.56" O.C.
SAV2025	4 @ 42.04" O.C.	3 @ 35.56" O.C.
SAV28	5 @ 35.63" O.C.	3 @ 35.56" O.C.

**ASSUMES:**

CONC SLAB  
 $f_c = 4000\text{PSI}$  MINIMUM  
 6" MIN THICKNESS  
 NORMAL WEIGHT CONCRETE  
 OR SAND LIGHT WEIGHT

**CONCRETE ATTACHMENT**

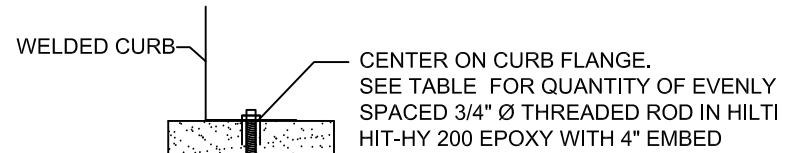


CURB	NO. OF ANCHORAGE BOLTS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	7 @ 6.42" O.C.	4 @ 7.67" O.C.
LXL	7 @ 6.42" O.C.	5 @ 8.25" O.C.
SUN3672	9 @ 7.88" O.C.	4 @ 9.08" O.C.
PRD3715	14 @ 5.49" O.C.	9 @ 5.19" O.C.
PRS	10 @ 6.82" O.C.	5 @ 7.78" O.C.
PRL	11 @ 7.23" O.C.	6 @ 8.8" O.C.
SLU180	12 @ 9.57" O.C.	8 @ 10.57" O.C.
SLM1830	18 @ 6.84" O.C.	11 @ 7.4" O.C.
SAV1518	12 @ 10.19" O.C.	6 @ 14.23" O.C.
SAV2025	14 @ 14.97" O.C.	6 @ 14.23" O.C.
SAV28	14 @ 10.96" O.C.	6 @ 14.23" O.C.

\* SIX INCHES FROM EACH CORNER EVENLY SPACED.  
 \*\* CENTERED.

ROOF ANCHORAGE DETAIL
<b>CBISC Series</b>
LXS
LXL
SUN3672
PRD3715
PRS
PRL
SLU180
SLM1830
SAV1518
SAV2025
SAV28

**WOOD ATTACHMENT**

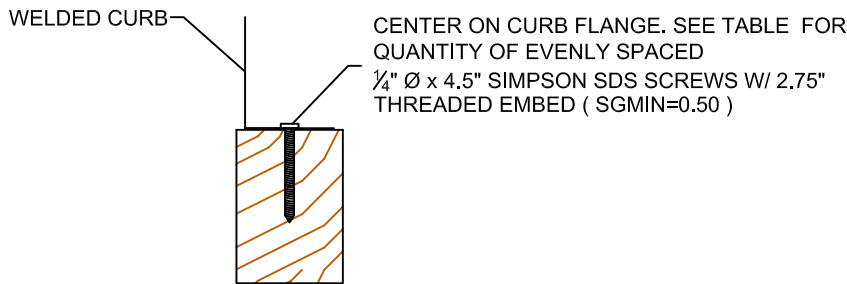

FOUR INCHES FROM EACH CORNER EVENLY SPACED

CURB	NO. OF ANCHORAGE SCREWS REQUIRED	
	LONG SIDE	SHORT SIDE
LXS	7 @ 7.08" O.C.	5 @ 6.75" O.C.
LXL	7 @ 7.08" O.C.	7 @ 6.17" O.C.
SUN3672	9 @ 8.38" O.C.	5 @ 7.81" O.C.
PRD3715	15 @ 5.38" O.C.	10 @ 5.06" O.C.
PRS	10 @ 7.26" O.C.	6 @ 7.03" O.C.
PRL	12 @ 6.93" O.C.	8 @ 6.86" O.C.
SLU180	14 @ 8.4" O.C.	10 @ 8.67" O.C.
SLM1830	19 @ 6.68" O.C.	13 @ 6.5" O.C.
SAV1518	13 @ 9.68" O.C.	9 @ 9.39" O.C.
SAV2025	15 @ 9.29" O.C.	9 @ 9.39" O.C.
SAV28	16 @ 9.77" O.C.	9 @ 9.39" O.C.



3847 WABASH DRIVE  
 MIRA LOMA, CA 91752  
 PHONE (951) 685-1101  
 FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
 COMPANY: \_\_\_\_\_  
 JOB NAME: \_\_\_\_\_  
 EQUIPMENT: \_\_\_\_\_  
 NOTES: \_\_\_\_\_

FORM NO:  
 CB-62

DATE:  
 6/30/2022

REV:  
 2

DRAWN BY:  
 FMM




Client:	ProVent PV2203	Upper curb rail
Project:	CBISC-04 Iso Curb	CBISCPRD3715
Unit:	ZT,ZR,ZJ 037-150; ZF,ZH,ZJ,ZR,XP,DH, DM,DF,DR,BP 078-150	

**Upper Curb Information**

Hcurb upper =	5.5 in	(Height of upper curb rail)
Lcurb =	80.875 in	(Length of upper curb)
wcurb =	51 in	(Width of upper curb)
WGTupper =	67 lbs	(Weight of upper curb)
# Clips long side =	3	# Clips short side = 2

**Unit Information**

WGTunit =	1736 lbs	(Weight of Unit)
Wtmax =	521 lbs	(Maximum corner weight)
Wtmin =	369 lbs	(Minimum corner weight)
Hunit =	50.75 in	(Height of unit above curb)
Hcm =	25.375 in	(Height to center of mass)
Lunit =	89 in	(Length of unit)
Wunit =	59 in	(Width of unit)

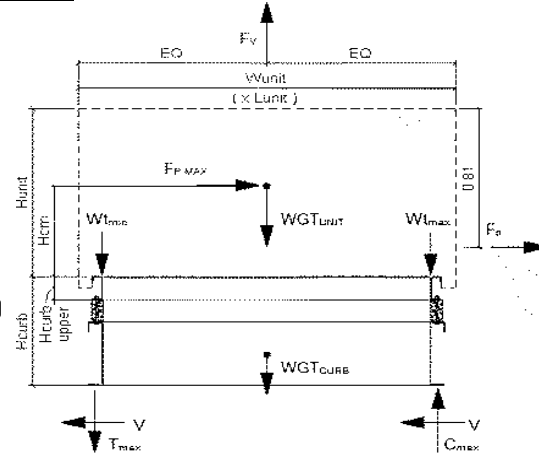

**Seismic Loading - 2018 IBC/2019 CBC**

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	5.130 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	6234 lbs	(0.7*Fpmax)
	(unit only)	FpmaxASD = 6475 lbs
		(unit + upper rail)

**Wind Loading - 2018 IBC/2019 CBC**

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.00	(Max. assumed topographic factor)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
Ke =	1.00	(Ground Elevation Factor Table 26.9-1 ASCE 7-16)
V =	110	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)
GCr <sub>(horiz)</sub> =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr <sub>(vert)</sub> =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	29.8 psf	= 0.00256*Kz*Kzt*Kd*Ke*V <sup>2</sup> (Eq. 26.10-1 ASCE 7-16)
F <sub>h</sub> ASD trans =	1179 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
F <sub>h</sub> ASD long =	782 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
F <sub>vert</sub> ASD =	976 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

**Upper Curb Loading**

**Transverse:**

Compression <sub>SEISMIC</sub> =	4476 lbs	= [FpmaxASD*Hcm + 2*(1+0.14S <sub>DS</sub> )*Wtmax*wcurb]/wcurb
Tension <sub>SEISMIC</sub> =	2895 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*wcurb]/wcurb
Compression <sub>WIND</sub> =	723 lbs	= [F <sub>h</sub> ASD trans *Hcm + 2*0.6*Wtmax*wcurb - F <sub>vert</sub> ASD*wcurb/2]/wcurb
Tension <sub>WIND</sub> =	632 lbs	= [F <sub>h</sub> ASD trans *Hcm - 2*0.6*Wtmin*wcurb + F <sub>vert</sub> ASD*wcurb/2]/wcurb

---> Negative values indicate opposite load.

**Longitudinal:**

Compression <sub>SEISMIC</sub> =	3330 lbs	= [FpmaxASD*Hcm + 2*(1+0.14S <sub>DS</sub> )*Wtmax*Lcurb]/Lcurb
Tension <sub>SEISMIC</sub> =	1749 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*Lcurb]/Lcurb
Compression <sub>WIND</sub> =	382 lbs	= [F <sub>h</sub> ASD long *Hcm + 2*0.6*Wtmax*Lcurb - F <sub>vert</sub> ASD*Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	291 lbs	= [F <sub>h</sub> ASD long *Hcm - 2*0.6*Wtmin*Lcurb + F <sub>vert</sub> ASD*Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

**Governing Reactions:**

<b>Transverse:</b>	Comp <sub>MAX</sub> = 4476 lbs	---> Along long edge of curb.
(on long edge)	Tens <sub>MAX</sub> = 2895 lbs	---> Along long edge of curb.
<b>Longitudinal:</b>	Comp <sub>MAX</sub> = 3330 lbs	---> Along short edge of curb.
(on short edge)	Tens <sub>MAX</sub> = 1749 lbs	---> Along short edge of curb.


---> Negative values indicate opposite load.

**Curb Design**

F<sub>y</sub> = 50 ksi      F<sub>u</sub> = 65 ksi  
E = 29500 ksi      t = 0.0713 14 Gauge

**Calculate Section Properties of Curb**

A' = <span style="border: 1px solid black; padding: 2px;">5.500</span> in	a = 5.144 in = A' - (2r+t)
B' = <span style="border: 1px solid black; padding: 2px;">1.750</span> in	a' = 5.429 in = A' - t
C' = <span style="border: 1px solid black; padding: 2px;">0.000</span> in (0 if no lips)	b = 1.572 in = B' - [r+t/2+α(r+t/2)]
α = <span style="border: 1px solid black; padding: 2px;">0.000</span> (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - (t/2+αt/2)
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.337 in (Distance between centroid and web centerline)	
I <sub>x</sub> = 2.687 in <sup>4</sup>	r <sub>x</sub> = 2.08 in
I <sub>y</sub> = 0.169 in <sup>4</sup>	r <sub>y</sub> = 0.521 in
A = 0.62 in <sup>2</sup>	r <sub>min</sub> = 0.521 in

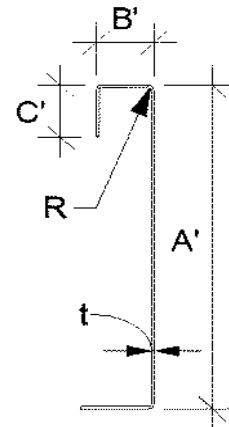

**Axial Compression**

Pa = 3.117 k (Max Axial Comp)      Ω<sub>c</sub> = 1.80  
P<sub>n</sub>/Ω<sub>c</sub> = 11.798 k  
F<sub>e</sub> = 54.67 ksi       $\lambda_c = \frac{F_y}{\sqrt{F_e}}$        $F_e = \frac{\pi^2 E}{(kl/r)^2}$   
λ<sub>c</sub> = 0.96       $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$       If λ<sub>c</sub> ≤ 1.5; F<sub>n</sub> = (0.658λ<sub>c</sub><sup>2</sup>) F<sub>y</sub>  
F<sub>n</sub> = 34.10 ksi      If λ<sub>c</sub> > 1.5; F<sub>n</sub> =  $\frac{0.877}{\lambda_c^2} F_y$   
L<sub>y</sub> = 47.50 in      Lateral unbraced length (assume k=0.8)  
k<sub>y</sub>L<sub>y</sub>/r<sub>y</sub> = 73

**Compression Check = O.K.**

**Check Web Crippling**

h = 5.5 in      -- Check limits:      C = 7.50  
t = 0.0713 in      h/t = 77.14 ≤ 200      C<sub>R</sub> = 0.08  
N = 7.00      N/t = 98.18 ≤ 210      C<sub>N</sub> = 0.12  
Ω<sub>w</sub> = 1.75      N/h = 1.273 ≤ 2.0      C<sub>h</sub> = 0.048  
P<sub>n</sub> = 1.947 k      R/t = 1.50 ≤ 12.0  
P<sub>n</sub>/Ω<sub>w</sub> = 1.112 k       $P_n = Ct^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$   
Long side: P<sub>u</sub>Trans = 1.119 k **web stiffener REQ'D** # clips = 3  
Short side: P<sub>u</sub>Long = 1.110 k      **O.K.** # clips = 2

**Check Web Stiffener**

16Ga x 1-3/16in x 7in (C-channel)      P<sub>n</sub> = 0.7(P<sub>wc</sub> + A<sub>e</sub>F<sub>y</sub>) ≥ P<sub>wc</sub>  
width of stiffener = 7.000 in      t<sub>s</sub> = 0.0566 16 Gauge      P<sub>wc</sub> = 1.947 k  
web of stiff. w = 6.717 in      R<sub>s</sub> = 0.0849 in      P<sub>n</sub> = 14.669 k  
\*\*\*Check w/ts ≤ 1.28VE/F<sub>y</sub>      Ω<sub>c</sub> = 1.70      A<sub>e</sub> = 0.380 in<sup>2</sup>  
w/ts = 118.675  
1.28v(E/F<sub>y</sub>) = 31.091      --> w/ts over limit      Use C3.7.2      P<sub>n</sub>/Ω<sub>c</sub> = 8.629 k      **O.K.**

**Corner Connections**

**1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts**

T<sub>crn</sub>max = 1619 lbs      Max(F<sub>pmaxASD</sub>/4 -OR- F<sub>hASDtrans</sub>/4 corner connections)  
V<sub>crn</sub>max = 2238 lbs      Max(Tens/2 -OR- Comp/2 corner connections per side)  
Bolt: Tall = 2480 lbs      Vall = 1208 lbs  
Threaded Insert: Tall = 2860 lbs      Vall = 1096 lbs  
# of Bolts required for Tension = 0.7  
# of Bolts required for Shear = 2.0  
# of Bolts Used = 4.0  
Check Combined Stress in Bolts & Inserts: 0.674 **O.K.**

**Check 1/8" welded connection**

<--- USE WELD      Ω = 2.35  
Assume L/t > 25: 25\*t = 1.783 in      P<sub>n</sub>/Ω =  $\frac{1}{\Omega} 0.75tLF_u \geq V_{req}$       L<sub>req'd</sub> =  $\frac{V_{req}\Omega}{0.75tF_u}$   
L<sub>req'd</sub> = 1.513 in



<b>Connection Unit to Curb Clip</b>	#10 SMS screw	$\Omega = 3.0$
$t_1 = 0.0713$ in (clip thickness)	$t_2/t_1 = 1.0$	$F_{u1} = 65$ ksi
$t_2 = 0.0713$ in (unit base rail thickness)		$F_{u2} = 65$ ksi
$d = 0.190$ in (screw diameter)	$d_w = 0.375$ in (nom. washer diameter)	


For  $t_2/t_1 \leq 1.0$ :  
**Shear:**  $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$  2.27 k  
**Tension:**  $P_{ns} = 2.7t_1dF_{u1}$  2.38 k  
 $P_{ns} = 2.7t_2dF_{u2}$  2.38 k  
 $P_{ns}/\Omega = 755 \#$   
 $P_{ss}/\Omega = 540 \#$  <- Controls  
 $P_{not} = 0.748$  k (screw pull-out strength)  
 $P_{nov} = 2.607$  k (screw pull-over strength)  
 $P_{ts}/\Omega = 249 \#$  <- Controls  
 $P_{ts}/\Omega = 820 \#$  (full tensile screw capacity)

For  $t_2/t_1 \geq 2.5$ :  
 $P_{ns} = 2377 \#$   
 $P_{ns} = 2.7t_1dF_{u1}$  2.38 k  
 $P_{ns} = 2.7t_2dF_{u2}$  2.38 k  
 $P_{not} = 0.85t_c d F_{u2}$   
 $t_c = \min(t_1, t_2)$   
 $P_{nov} = 1.5t_1 d_w F_{u1}$

	Shear (k)	# clips	$V_{clip}$ (k)	$V_{allow}$ (lb)	# screws	spacing
Long side:	3.117	3	1.04	540 #	4	2.00 in
Short side:	3.117	2	1.56	540 #	4	2.00 in

clip width (in) = 7.00  
 min spacing = 0.57 in  
 clip height = 2.5 in  
 edge distance = 0.5 in (min. 1.5d)

**Check Block shear rupture:** O.K.  
 $F_y = 50$  ksi  
 $A_{gv} = 0.463$  in<sup>2</sup>  
 $R_n/\Omega = 8.674$  k  
 $R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$  (AISI Sect. E5.3)  
 $\Omega = 2.22$  bolt/screw connection  
 $A_{nv} = 0.416$  in<sup>2</sup>  
 $A_{nt} = 0.082$  in<sup>2</sup>

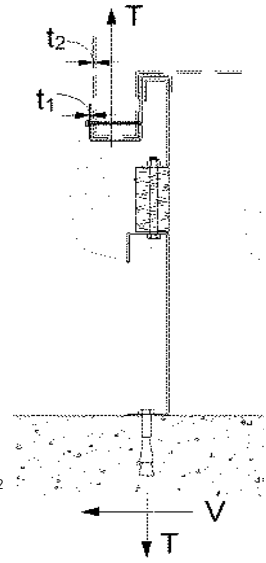


**Curb Loads** [copied from above]

<b>Transverse:</b> (on long edge)	Comp <sub>MAX</sub> = 5109 lbs Tens <sub>MAX</sub> = 3667 lbs Shear <sub>MAX</sub> = 6475 lbs
<b>Longitudinal:</b> (on short edge)	Comp <sub>MAX</sub> = 3661 lbs Tens <sub>MAX</sub> = 2219 lbs Shear <sub>MAX</sub> = 6475 lbs

**Loads at each Isolator** Type: CQA

<b>Transverse loading:</b> (on long edge)	Comp <sub>MAX</sub> = 2554.5 lbs Tens <sub>MAX</sub> = 1833.3 lbs Shear <sub>MAX</sub> = 809.3 lbs
<b>Longitudinal loading:</b> (on short edge)	Comp <sub>MAX</sub> = 1830.5 lbs Tens <sub>MAX</sub> = 1109.3 lbs Shear <sub>MAX</sub> = 809.3 lbs

Max compression force on isolator: 2.554 k ≤ 3.176 k **O.K.**  
 Max uplift on isolator: 1.833 k ≤ 3.176 k **O.K.**  
 Max shear on isolator: 0.809 k ≤ 1.163 k **O.K.**



**Forces on top bolt:**

Tension = 1.833 k  $d_b = 0.375$   
 Shear = 0.809 k  $d_w = 0.375$   
 per rail,  $t = 0.0713$  in  $7.0$  in

**Shear on curb rail:**  $P_n = teF_u$   $\Omega = 2.00$  (Appendix A, Section E3.1 AISI)

**Shear O.K.**  $P_n/\Omega = 4.635$  k  $e = 1.0$  in

**Net section rupture:**  $P_n = A_n F_t$   $\Omega = 2.22$  (Appendix A, Section E3.2 AISI)

$P_n/\Omega = 4.989$  k  $A_n = 0.116$  in  
**N.S.R. O.K.**  $F_t = (0.1 + 3d/s)F_u \leq F_u = 43.063$  ksi

**Bolt Bearing Strength:**  $P_n = C m_f d t F_u$   $\Omega = 2.50$  (Section E3.3.1 AISI)

$P_n/\Omega = 2.086$  k  $d/t = 5.26$   
**Bearing O.K.**  $C = 3.00$   $m_f = 1.00$

**Shear and tension in bolt:** (Appendix A, Section E3.4 AISI)

Tension  $P_{nt} = A_b F_{nt}$   $F_{nt} = 40.5$  ksi  $A_b = 0.1104$  in<sup>2</sup>  
 $P_{nt}/\Omega = 1.988$  k **Bolt tension O.K.**  $\Omega t = 2.25$  (Table E3.4-1, AISI)

Shear  $P_{nv} = A_b F_{nv}$   $F_{nv} = 24.0$  ksi  $\Omega v = 2.40$  (Table E3.4-1, AISI)  
 $P_{nv}/\Omega = 1.104$  k **Bolt shear O.K.**

**Combined Shear and tension in bolt:**

$F'_{nt} = 1.3F_{nt} - \frac{\Omega F_{nt}}{F_{nv}} f_v \leq F_{nt}$   $f_t = 16.60$  ksi  $f_v = 7.33$  ksi **O.K.**  
 $F'_{nt} = 22.97$  ksi  $F_{nv}/\Omega = 10.00$  ksi

$P'_{nt}/\Omega = 1.128$  k **No Good - Use Welds**

**Longitudinal weld loading:**  $L = 1.5P_n/\Omega = \frac{1}{\Omega} \left(1 - \frac{0.01L}{t_2}\right) L t_2 F_{u2} \geq V_{req}$   $\Omega = 2.55$   
 If  $L/t < 25$ :  $L/t = 21.04$   $t = 0.0713$  in  $P_n/\Omega = 2.153$  k

**Transverse weld loading:**  $t = 0.0713$  in  $P_n/\Omega = \frac{1}{\Omega} t L F_u \geq T_{req}$   $\Omega = 2.35$   
 $L = 1$   $F_u = 65$  ksi  $P_n/\Omega = 1.972$  k



Client: ProVent PV2203 Base curb  
Project: CBISC-04 Iso Curb CBISCPRD3715  
Unit: ZT,ZR,ZJ 037-150; ZF,ZH,ZJ,ZR,XP,DH, DM,DF,DR,BP 078-150

**Base Curb Information**

Hbase curb = 25 in (Height of base curb)  
Lcurb = 83.375 in (Length of base curb)  
wcurb = 53.5 in (Width of base curb)  
WGtbase = 343 lbs (Weight of base curb)  
# Springs long side = 2 # Springs short side = 2

**Unit Information**

WGtunit = 1736 lbs (Weight of Unit)  
Wt'max = 538 lbs (Wtmax+1/4\*WGtUpper)  
Wt'min = 386 lbs (Wtmin+1/4\*WGtUpper)  
Hunit = 50.75 in (Height of unit above curb)  
H'cm = 35.375 in (Hcm+10"\*(upper+spring))  
Lunit = 89 in (Length of unit)  
Wunit = 59 in (Width of unit)  
WGtunit+upper+base = 2146 lbs (Total weight)

**Seismic Loading - 2018 IBC/2019 CBC**

Ss = 2.85 (Worst case for majority of California)  
Fa = 1.20 (Default Site Class D - Table 11.4-1 ASCE 7-16)  
Ip = 1.50 (Importance Factor Category III Building)  
Sms = 3.420 (Fa\*Ss) ap = 2.5  
Sds = 2.280 (2/3\*Sms) Rp = 2  
Fpmax = 5.130 Wp (0.4\*ap\*Sds\*Ip)\*Wp\*3/Rp <= 1.6\*Sds\*Ip\*Wp  
FpmaxASD = 6475 lbs (0.7\*Fpmax) FpmaxASD = 7706 lbs  
(unit + upper rail) (unit + upper rail + base curb)

**Wind Loading - 2018 IBC/2019 CBC**

Kz = 1.13 (For 60 ft roof height, Exposure C - Table 26.10-1 ACSE 7-16)  
Kzt = 1.00 (Max. assumed topographic factor)  
Kd = 0.85 (Directionality factor Table 26.6-1 ASCE 7-16)  
Ke = 1.00 (Ground Elevation Factor Table 26.9-1 ASCE 7-16)  
V = 110 (Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)  
GCr(horiz) = 1.9 (Refer Sect 29.4.1 ASCE 7-16)  
GCr(vert) = 1.5 (Refer Sect 29.4.1 ASCE 7-16)  
qz = 29.8 psf = 0.00256\*Kz\*Kzt\*Kd\*Ke\*V<sup>2</sup> (Eq. 26.10-1 ASCE 7-16)  
Fh ASD trans = 1798 lbs = 0.6\*qz\*GCr\*Lunit\*(Hunit+Hbase curb+10") (Eq. 29.4-2)  
Fh ASD long = 1192 lbs = 0.6\*qz\*GCr\*Wunit\*(Hunit+Hbase curb+10")  
Fvert ASD = 976 lbs = 0.6\*qz\*GCr\*Lunit\*Wunit (Eq. 29.4-3)

**Base Curb Loading**

**Transverse:**

Compression<sub>SEISMIC</sub> = 5699 lbs = [FpmaxASD\*H'cm+2\*(1+0.14S<sub>DS</sub>)\*Wt'max\*wcurb]/wcurb  
Tension<sub>SEISMIC</sub> = 4065 lbs = [FpmaxASD\*H'cm-2\*(0.6-0.14S<sub>DS</sub>)\*Wt'min\*wcurb]/wcurb  
Compression<sub>WIND</sub> = 1345 lbs = [Fh ASD trans \*H'cm+2\*0.6\*Wt'max\*wcurb-Fvert ASD\*wcurb/2]/wcurb  
Tension<sub>WIND</sub> = 1214 lbs = [Fh ASD trans \*H'cm-2\*0.6\*Wt'min\*wcurb+Fvert ASD\*wcurb/2]/wcurb

---> Negative values indicate opposite load.

**Longitudinal:**


Compression<sub>SEISMIC</sub> = 4165 lbs = [FpmaxASD\*H'cm+2\*(1+0.14\*S<sub>DS</sub>)\*Wt'max\*Lcurb]/Lcurb  
Tension<sub>SEISMIC</sub> = 2531 lbs = [FpmaxASD\*H'cm-2\*(0.6-0.14S<sub>DS</sub>)\*Wt'min\*Lcurb]/Lcurb  
Compression<sub>WIND</sub> = 662 lbs = [Fh ASD long \*H'cm+2\*0.6\*Wt'max\*Lcurb-Fvert ASD\*Lcurb/2]/Lcurb  
Tension<sub>WIND</sub> = 531 lbs = [Fh ASD long \*H'cm-2\*0.6\*Wt'min\*Lcurb+Fvert ASD\*Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

**Governing Reactions:**

<b>Transverse:</b>	Comp <sub>MAX</sub> = 5699 lbs	---> Along long edge of curb.
(on long edge)	Tens <sub>MAX</sub> = 4065 lbs	---> Along long edge of curb.
<b>Longitudinal:</b>	Comp <sub>MAX</sub> = 4165 lbs	---> Along short edge of curb.
(on short edge)	Tens <sub>MAX</sub> = 2531 lbs	---> Along short edge of curb.

---> Negative values indicate opposite load.

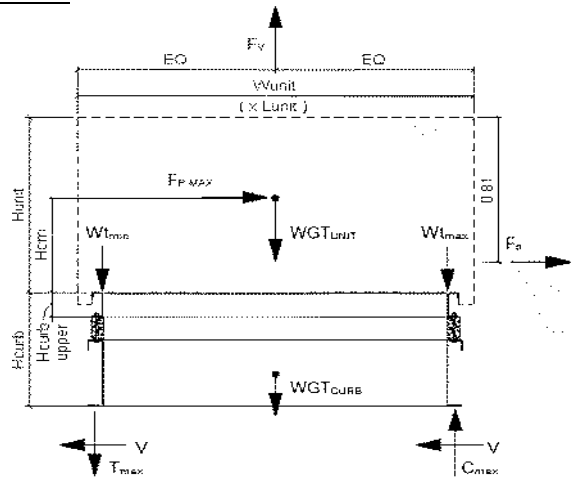






**Curb Design**

Fy = 50 ksi Fu = 65 ksi  
E = 29500 ksi t = 0.0713 14 Gauge

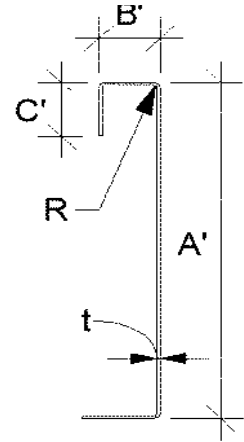

**Calculate Section Properties of Curb**

A' = 25.000 in	a = 24.644 in = A' - (2r+t)
B' = 1.750 in	a' = 24.929 in = A' - t
C' = 0.000 in (0 if no lips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
a = 0.000 in (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - (t/2+at/2)
R = 0.1069 (Inside bend radius)	c = 0.000 in = a[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = a[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.104 in (Distance between centroid and web centerline)	
Ix = 128.737 in	rx = 8.00 in
Iy = 0.218 in	ry = 0.329 in
A = 2.01 in <sup>2</sup>	rmin = 0.329 in

**Axial Compression**

Pu = 3.237 k (Max Axial Comp) Ωc = 1.80  
 Pn/Ωc = 6.940 k  
 Fe = 7.08 ksi  
 λc = 2.66  
 Fn = 6.21 ksi  
 Ly = 83.38 in  
 kyLy/ry = 203  
 Lateral unbraced length (assume k=0.8)

$$\lambda_c = \sqrt{\frac{F_y}{F_e}} \quad F_e = \frac{\pi^2 E}{(kl/r)^2}$$

If λc ≤ 1.5; Fn = (0.658λc<sup>2</sup>)Fy  
 If λc > 1.5; Fn =  $\frac{0.877}{\lambda_c^2} F_y$

**Compression Check = O.K.**

**Check Web Crippling**

h = 25 in -- Check limits: C = 4.00  
 t = 0.0713 in h/t = 350.63 ≤ 200 CR = 0.14  
 N = 7.00 N/t = 98.18 ≤ 210 CN = 0.35  
 Ωw = 1.75 N/h = 0.28 ≤ 2.0 Cn = 0.02  
 Pn = 2.105 k R/t = 1.50 ≤ 9.0  
 Pn/Ωw = 1.203 k  
 Long side: PuTrans = 1.900 k **web stiffener REQ'D** # clips = 3  
 Short side: PuLong = 2.083 k **web stiffener REQ'D** # clips = 2  
 \*\*\*h/t > 200; use web stiffeners

$$P_n = C t^2 F_y \sin(90) \left( 1 - C_R \sqrt{\frac{R}{t}} \right) \left( 1 + C_N \sqrt{\frac{N}{t}} \right) \left( 1 - C_h \sqrt{\frac{h}{t}} \right)$$

**Check Web Stiffener**

16Ga x 1.5in x 7in [C-channel]  
 width of stiffener = 7.000 in ts = 0.0566 16 Gauge  
 web of stiff. w = 6.717 in Rs = 0.0849 in  
 \*\*\*Check w/ts ≤ 1.28VE/Fys Ωc = 1.70  
 w/ts = 118.675  
 1.28v(E/Fys) = 31.091 --> w/ts over limit Use C3.7.2  
 Pn = 0.7(Pwc + AeFy) ≥ Pwc  
 Pwc = 2.105 k Ae = 0.380 in<sup>2</sup>  
 Pn = 14.780 k  
 Pn/Ωc = 8.694 k **O.K.**

**Corner Connections**

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts  
 Tcrnmax = 1927 lbs Max(FpmaxASD/4 -OR- FhASDtrans/4 corner connections)  
 Vcrnmax = 2850 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)  
 Bolt: Tall = 2480 lbs Vall = 1208 lbs  
 Threaded Insert: Tall = 2860 lbs Vall = 1096 lbs  
 # of Bolts required for Tension = 0.8  
 # of Bolts required for Shear = 2.6  
 # of Bolts Used = 4.0  
 Check Combined Stress in Bolts & Inserts: 0.844 **O.K.**

**Check 1/8" welded connection**

---- USE WELD Ω = 2.35  
 Assume L/t > 25: 25\*t = 1.783 in Pn/Ω =  $\frac{1}{\Omega} 0.75tL F_u \geq V_{req}$   
 Lreq'd = 1.927 in Lreq'd =  $\frac{V_{req} \Omega}{0.75t F_u}$



**Curb Loads** [copied from upper rail calcs]

<b>Transverse:</b> (on long edge)	Comp <sub>MAX</sub> = 5109 lbs Tens <sub>MAX</sub> = 3667 lbs Shear <sub>MAX</sub> = 6475 lbs
<b>Longitudinal:</b> (on short edge)	Comp <sub>MAX</sub> = 3661 lbs Tens <sub>MAX</sub> = 2219 lbs Shear <sub>MAX</sub> = 6475 lbs

**Loads at each Isolator** Type: **CQA**

<b>Transverse loading:</b> (on long edge) # isolators: 2	Comp <sub>MAX</sub> = 2554.5 lbs Tens <sub>MAX</sub> = 1833.3 lbs Shear <sub>MAX</sub> = 809.3 lbs
<b>Longitudinal loading:</b> (on short edge) # isolators: 2	Comp <sub>MAX</sub> = 1830.5 lbs Tens <sub>MAX</sub> = 1109.3 lbs Shear <sub>MAX</sub> = 809.3 lbs

Max compression force on isolator: 2.554 k ≤ 3.176 k **O.K.**  
 Max uplift on isolator: 1.833 k ≤ 3.176 k **O.K.**  
 Max shear on isolator: 0.809 k ≤ 1.163 k **O.K.**

**Forces on bottom bolts:**

$d_b = 0.5$  in  
 base curb,  $t = 0.0713$  in  
 Tension = 0.917 k / bolt  
 Shear = 0.405 k / bolt

**Shear on base curb:**  $P_n = t_e F_u$   $\Omega = 2.00$  (Appendix A, Section E3.1 AISI)  
 $P_n/\Omega = 4.635$  k  $e = 1.0$  in

**Shear O.K.**

**Net section rupture:**  $P_n = A_n F_t$   $\Omega = 2.22$  (Appendix A, Section E3.2 AISI)  
 $P_n/\Omega = 5.909$  k  $A_n = 0.107$  in

**N.S.R. O.K.**

**Bolt Bearing Strength:**  $P_n = C m_f d t F_u$   $\Omega = 2.50$  (Section E3.3.1 AISI)  
 $P_n/\Omega = 2.781$  k  $d/t = 7.01$

**Bearing O.K.**

**Shear and tension in bolt:** (Appendix A, Section E3.4 AISI)

Tension  $P_{nt} = A_b F_{nt}$   $F_{nt} = 45.0$  ksi  $A_b = 0.1963$  in<sup>2</sup>  
 $P_{nt}/\Omega = 3.927$  k **Bolt tension O.K.**  $\Omega t = 2.25$

Shear  $P_{nv} = A_b F_{nv}$   $F_{nv} = 27.0$  ksi  $\Omega v = 2.40$   
 $P_{nv}/\Omega = 2.209$  k **Bolt shear O.K.** **\*\*\*[Table E3.4-1, AISI]\*\*\***

**Combined Shear and tension in bolt:**

$F'_{nt} = 1.3 F_{nt} - \frac{\Omega F_{nt}}{F_{nv}} f_v \leq F_{nt}$   $f_t = 9.34$  ksi  $f_v = 2.06$  ksi  
 $F'_{nt} = 45.00$  ksi  $F_{nv}/\Omega = 11.25$  ksi  
 $P'_{nt} = A_b F'_{nt}$   $P'_{nt}/\Omega = 3.927$  k **Combined Not Applicable -> F'nt = Fnt**

**Connection of Curb to Supporting Structure**



**Roof Loading** SEISMIC: (0.6-0.14S<sub>DS</sub>)D + 0.7E WIND: 0.6D + W

<b>Transverse:</b>	Uplift <sub>MAX</sub> = 8395 lbs	Shear <sub>MAX</sub> = 3853 lbs
Compression <sub>SEISMIC</sub> =	10112 lbs	= [FpmaxASD*(H'cm+Hbase curb)+(1+0.14S <sub>DS</sub> )*WGT <sub>unit+upper+base</sub> *wcurb/2]/wcurb
Tension <sub>SEISMIC</sub> =	8395 lbs	= [FpmaxASD*(H'cm+Hbase curb)-(0.6-0.14S <sub>DS</sub> )*WGT <sub>unit+upper+base</sub> *wcurb/2]/wcurb
Compression <sub>WIND</sub> =	2184 lbs	= [F <sub>h ASD trans</sub> *(H'cm+Hbase curb)+0.6*WGT <sub>unit+upper+base</sub> *wcurb/2-F <sub>vert ASD</sub> *wcurb/2]/wcurb
Tension <sub>WIND</sub> =	1873 lbs	= [F <sub>h ASD trans</sub> *(H'cm+Hbase curb)-0.6*WGT <sub>unit+upper+base</sub> *wcurb/2+F <sub>vert ASD</sub> *wcurb/2]/wcurb
<b>Longitudinal:</b>	Uplift <sub>MAX</sub> = 5279 lbs	Shear <sub>MAX</sub> = 3853 lbs
Compression <sub>SEISMIC</sub> =	6996 lbs	= [FpmaxASD*(H'cm+Hbase curb)+(1+0.14S <sub>DS</sub> )*WGT <sub>unit+upper+base</sub> *Lcurb/2]/Lcurb
Tension <sub>SEISMIC</sub> =	5279 lbs	= [FpmaxASD*(H'cm+Hbase curb)-(0.6-0.14S <sub>DS</sub> )*WGT <sub>unit+upper+base</sub> *Lcurb/2]/Lcurb
Compression <sub>WIND</sub> =	1019 lbs	= [F <sub>h ASD long</sub> *(H'cm+Hbase curb)+0.6*WGT <sub>unit+upper+base</sub> *Lcurb/2-F <sub>vert ASD</sub> *Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	707 lbs	= [F <sub>h ASD long</sub> *(H'cm+Hbase curb)-0.6*WGT <sub>unit+upper+base</sub> *Lcurb/2+F <sub>vert ASD</sub> *Lcurb/2]/Lcurb

**Wood Attachment:** 1/4" φ x 4.5" Simpson SDS screw: w/ 2.75" threaded emt (SGmin = 0.43)

<b>Transverse:</b>	Tall <sub>metal</sub> = 997 lbs	Vall <sub>metal</sub> = 1097 lbs
	Tall <sub>wood</sub> = 760 lbs	Vall <sub>wood</sub> = 672 lbs
# of Screws Req'd for Uplift =	11.05	COMBINED LOADING: 0.966 O.K.
# of Screws Req'd for Shear =	5.73	Req'd Min Spacing = 5.38 in o.c.
Total # of screws required =	15	

Use 15 - 1/4" φ x 4.5" Simpson SDS screws @ 5.4 in o.c. along long side of curb w/ 2.75" threaded embed

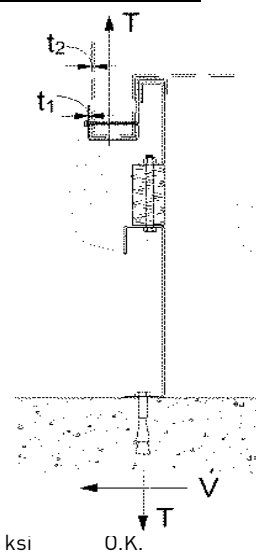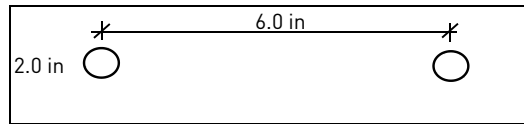



Longitudinal:

# of Screws Req'd for Uplift = 6.95      COMBINED LOADING: 0.924 O.K.  
# of Screws Req'd for Shear = 5.73      Screw Spacing = 5.06 in o.c.  
Total # of screws required = 10

Use 10 - 1/4" φ x 4.5" Simpson SDS screws @ 5.1 in o.c. along short side of curb w/ 2.75" threaded embed

**Steel Deck Attachment: 1/2" φ A307 Bolts to steel angle below deck**

Transverse:  
Tall<sub>bolt</sub> = 3927 lbs      Vall<sub>bolt</sub> = 2209 lbs  
Tall<sub>metal</sub> = 2086 lbs      Vall<sub>metal</sub> = 2192 lbs  
# of Bolts Req'd for Uplift = 4.02      COMBINED LOADING: 0.866 O.K.  
# of Bolts Req'd for Shear = 1.76      Bolt Spacing = 14.28 in o.c.  
Total # of bolts required = 6

Use 6 - 1/2" φ A307 Bolts to steel angle below deck @ 14.3 in o.c. along long side of curb

Longitudinal:

# of Bolts Req'd for Uplift = 2.53      COMBINED LOADING: 0.617 O.K.  
# of Bolts Req'd for Shear = 1.76      Bolt Spacing = 20.75 in o.c.  
Total # of bolts required = 3

Use 3 - 1/2" φ A307 Bolts to steel angle below deck @ 20.8 in o.c. along short side of curb

**For Concrete anchorage:** SEISMIC (0.6-0.14S<sub>DS</sub>)D + 0.7Ω<sub>e</sub>E      Ω<sub>o</sub> = 2.0

**Concrete Attachment: 3/4" φ thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed**

Tall<sub>LRFD</sub> = 1957 lbs      Vall<sub>LRFD</sub> = 4540 lbs      α = (1 + 0.2SDS)D + 2.5E = 1.708  
Tall<sub>ASD</sub> = Tall<sub>LRFD</sub>/α = 1146 lbs      Vall<sub>ASD</sub> = Vall<sub>LRFD</sub>/α = 2658 lbs      (D = 0.758, E = 0.242)  
Transverse: Uplift<sub>MAX</sub> = 17092 lbs      Shear<sub>MAX</sub> = 7706 lbs  
Compression<sub>SEISMIC</sub> = 18809 lbs      = [Ω<sub>o</sub>\*FpmaxASD\*(H'cm+Hbase curb)+(1+0.14S<sub>DS</sub>)\*WGT<sub>unit+curb+base</sub>\*wcurb/2]/wcurb  
Tension<sub>SEISMIC</sub> = 17092 lbs      = [Ω<sub>o</sub>\*FpmaxASD\*(H'cm+Hbase curb)-(0.6-0.14S<sub>DS</sub>)\*WGT<sub>unit+curb+base</sub>\*wcurb/2]/wcurb  
Shear<sub>SEISMIC</sub> = 7706 lbs      = Ω<sub>o</sub>\*FpmaxASD/2  
Min Bolts Req'd Uplift = 14.92 spacing = 5.10 in o.c.      T<sub>applied</sub> = 1220.8 lbs  
Min Bolts Req'd Shear = 2.90 spacing = 35.69 in o.c.      V<sub>applied</sub> = 335.1 lbs

Try using 14 bolts spaced at 5.49 in o.c.      COMBINED LOADING =  $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.19$

Use 14 - 3/4" φ thrd'd rods in Hilti Hit-HY 200 epoxy @ 5.5 in o.c. max. along long side of curb w/ 4" embed

Longitudinal: Uplift<sub>MAX</sub> = 10860 lbs      Shear<sub>MAX</sub> = 7706 lbs  
Compression<sub>SEISMIC</sub> = 12576 lbs      = [Ω<sub>o</sub>\*FpmaxASD\*(H'cm+Hbase curb)+(1+0.14S<sub>DS</sub>)\*WGT<sub>unit+curb+base</sub>\*Lcurb/2]/Lcurb  
Tension<sub>SEISMIC</sub> = 10860 lbs      = [Ω<sub>o</sub>\*FpmaxASD\*(H'cm+Hbase curb)-(0.6-0.14S<sub>DS</sub>)\*WGT<sub>unit+curb+base</sub>\*Lcurb/2]/Lcurb  
Shear<sub>SEISMIC</sub> = 7706 lbs      = Ω<sub>o</sub>\*FpmaxASD/2  
Min Bolts Req'd Uplift = 9.48 spacing = 4.61 in o.c.      T<sub>applied</sub> = 987.2 lbs  
Min Bolts Req'd Shear = 2.90 spacing = 20.75 in o.c.      V<sub>applied</sub> = 335.1 lbs

Try using 9 bolts spaced at 5.19 in o.c.      COMBINED LOADING =  $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.99$

Use 9 - 3/4" φ thrd'd rods in Hilti Hit-HY 200 epoxy @ 5.2 in o.c. max. along short side of curb w/ 4" embed

<b>CURB DESIGN SUMMARY:</b> CBISC-04 CBISCPRD3715		<b>Unit:</b> ZT,ZR,ZI 037-150;	
UPPER CURB RAIL THICKNESS: 0.0713 in 14 Gauge		ZF,ZH,ZJ,ZR,XP,DH, DM,DF,DR,BP	
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge			
# OF CLIPS (LONG SIDE) - 3 clips with 4 - #10 SMS screws each clip			
WEB STIFFENER: 16Ga x 1-3/16in x 7in (C-channel) stiffener at each clip			
# OF CLIPS (SHORT SIDE) - 2 clips with 4 - #10 SMS screws each clip			
WEB STIFFENER: NOT REQUIRED			
VIBRATION ISOLATOR TYPE: CQA      Top stud diameter: 3/8      (2) - CQA Isolators long side			
Anchor bolt diameter: 1/2      Anchor hole diameter: 9/16      (2) - CQA Isolators short side			
BASE CURB THICKNESS: 0.0713 in 14 Gauge		***Must weld top of CQA***	
WEB STIFFENER: 16Ga x 1.5in x 7in (C-channel) stiffener at each clip on base curb			
CORNER CONNECTION: Use minimum 4 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts			
<b>CURB ANCHORAGE</b>	<b>WOOD</b>	<b>STEEL</b>	
	1/4" φ x 4.5" Simpson SDS screws w/ 2.75" threaded embed (SGmin =	1/2" φ A307 Bolts to steel angle below deck	3/4" φ thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed
<b>LONG DIRECTION</b>	15 @ 5.38 in o.c.	6 @ 14.28 in o.c.	14 @ 5.49 in o.c.
<b>SHORT DIRECTION</b>	10 @ 5.06 in o.c.	3 @ 20.75 in o.c.	9 @ 5.19 in o.c.