




MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBKD-79 Series
KDKITSUN3672

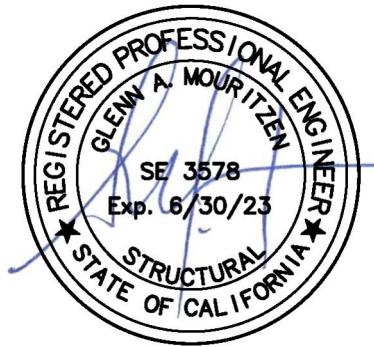

Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: October 1, 2021
Project Number: PV2101

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-60.




Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

STRUCTURALLY CALCULATED HOLD DOWN CLIPS FOR KNOCK-DOWN ROOF CURBS FOR YORK UNITS


ZR, XN, XP 036-060
ZE, ZF 036-072

ProVent P/N	A	WEIGHT	SEISMIC KIT P/N	WEIGHT
CBKDSUN367208	8"	67 Lbs	KDKITSUN3672	6 Lbs
CBKDSUN367211	11"	79 Lbs		
CBKDSUN367214	14"	91 Lbs		


Meets seismic requirements for the following codes:
CBC 2019
IBC 2018

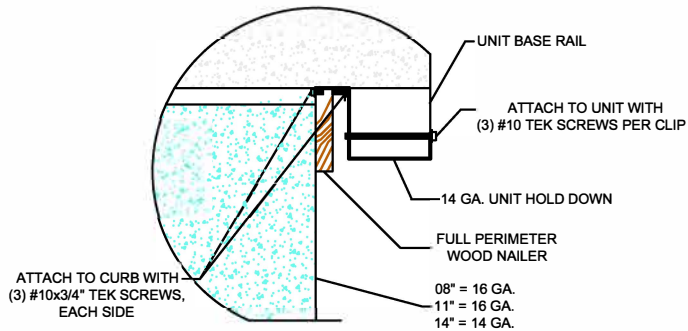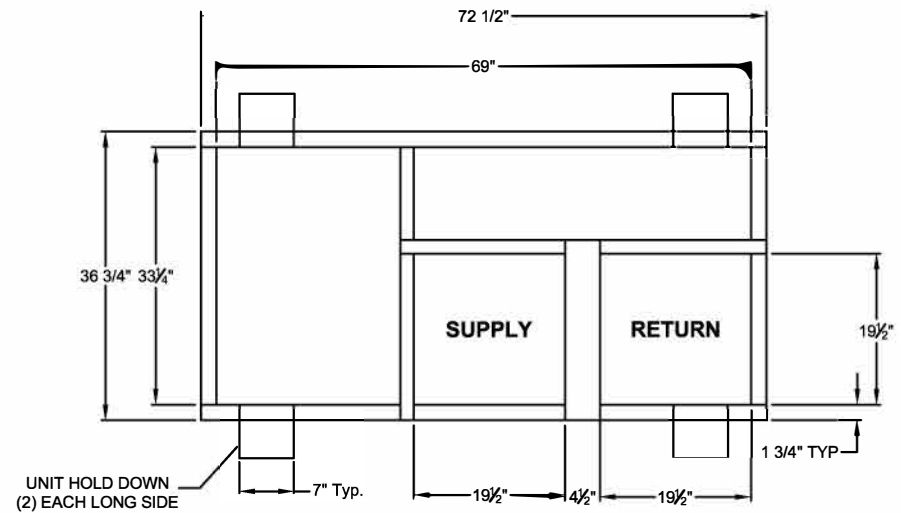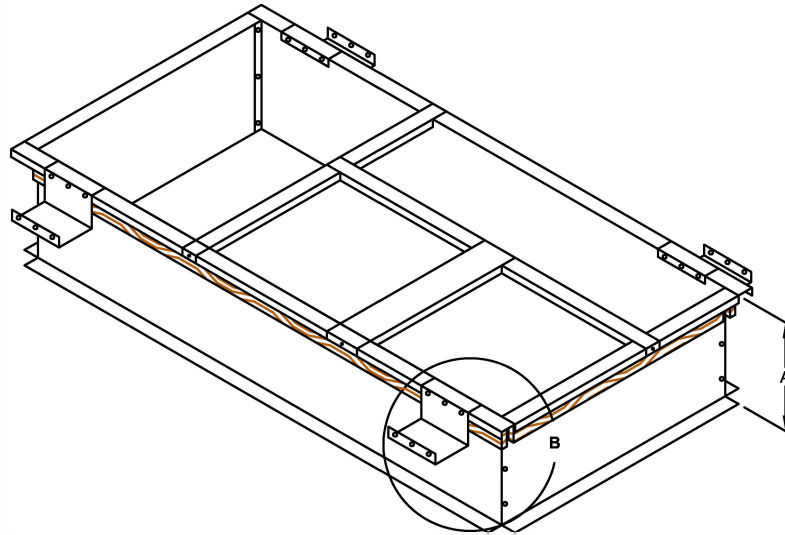

HOLD DOWN DETAIL

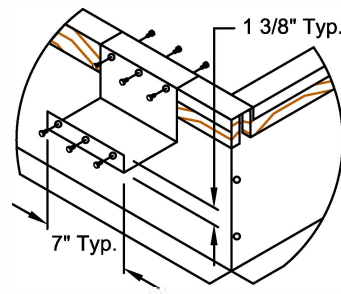

DETAIL B

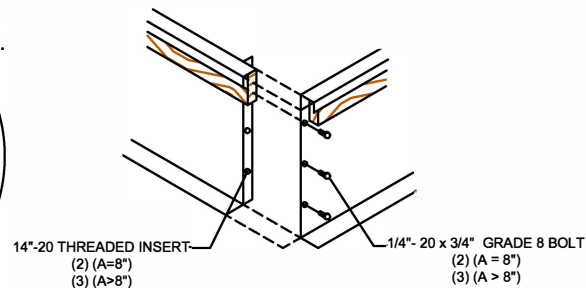

CORNER DETAIL



3847 WABASH DRIVE
MIRA LOMA, CA 91725
PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-79


DATE:
9/9/2021

REV:
6

PART NUMBER:
KDKITSUN3672

DRAWN BY:
ALL

STEEL ATTACHMENT

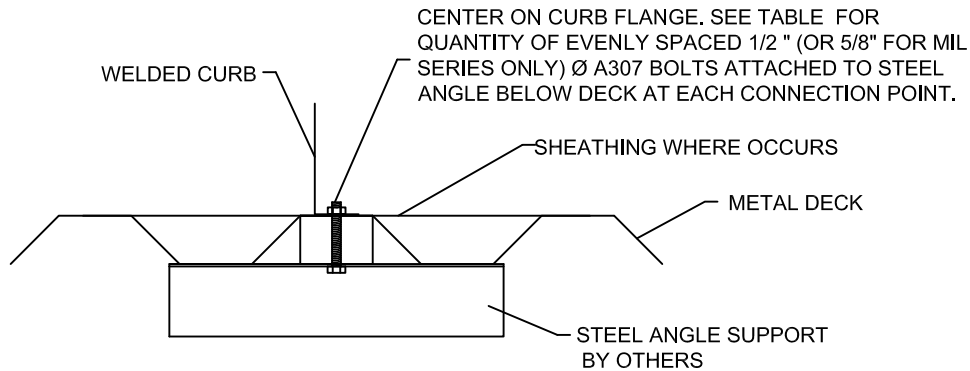

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 39" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SLU180	3 @ 51.38" O.C.	2 @ 71.5" O.C.
SLM1830	3 @ 56.88" O.C.	3 @ 35.75" O.C.


* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

ASSUMES:

CONC SLAB
f_c= 4000PSI MINIMUM
6" MIN THICKNESS
NORMAL WEIGHT CONCRETE
OR SAND LIGHT WEIGHT

CONCRETE ATTACHMENT

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 11.5" O.C.	3 @ 9.5" O.C.
LXL	4 @ 11.5" O.C.	3 @ 14.5" O.C.
SUN3672	4 @ 20.17" O.C.	3 @ 12.38" O.C.
PRD3715	9 @ 8.61" O.C.	7 @ 6.5" O.C.
PRS	5 @ 14.72" O.C.	4 @ 9.56" O.C.
PRL	6 @ 14.4" O.C.	5 @ 10.38" O.C.
SLU180	8 @ 14.68" O.C.	7 @ 11.92" O.C.
SLM1830	12 @ 10.34" O.C.	10 @ 7.94" O.C.


Meets seismic requirements for the following codes:
CBC 2019
IBC 2018

ROOF ANCHORAGE DETAIL

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SLU180	SLU180
SLM1830	SLM1830

WOOD ATTACHMENT

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø SIMPSON SDS OR EQUIVALENT SCREWS (3 1/2" MIN. EMBED. INTO WOOD FRAMING)

5/8" Ø LAG SCREW W/MIN. 3.5" EMBED (SGMIN=0.43) (FOR MIL SERIES ONLY)

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	9 @ 9.11" O.C.	8 @ 6.14" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.34" O.C.
PRL	5 @ 19" O.C.	4 @ 15.17" O.C.
SLU180	9 @ 13.34" O.C.	7 @ 12.58" O.C.
SLM1830	13 @ 9.81" O.C.	12 @ 6.86" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
10/07/2021

REV:
7

DRAWN BY:
FMM




Client:	ProVent PV2101	Previous:	PV1806
Description:	CBKD-79 14"	KDKITSUN3672	
Unit:	ZR 036-060, XP 036-060, ZF 036-072		

Curb Information

Hcurb =	14	in	(Height of curb)
Lcurb =	72.5	in	(Length of curb)
wcurb =	36.75	in	(Width of curb)
WGTCurb =	97	lbs	(Weight of curb)
# Clips long side =	2		
# Clips short side =	0		

Unit Information

WGUnit =	704	lbs	(Weight of Unit)
Wtmax =	234	lbs	(Maximum corner weight)
Wtmin =	96	lbs	(Minimum corner weight)
Hunit =	32.625	in	(Height of unit above curb)
Hcm =	16.3125	in	(Height to center of mass)
Lunit =	82.25	in	(Length of unit)
Wunit =	44.875	in	(Width of unit)

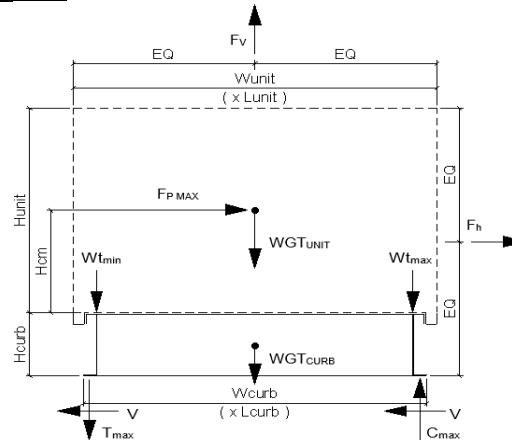

Seismic Loading - 2018 IBC/2019 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.2	Default Site Class D
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp/3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	843 lbs	(0.7*Fpmax)
	(unit only)	
		FpmaxASD = 959 lbs
		(unit and curb)

Wind Loading - 2018 IBC/2019 CBC

*** Exposure Category C ***

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr (horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr (vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	987 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	539 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	750 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:

Compression _{SEISMIC} =	991 lbs	= [FpmaxASD*Hcm+2*(1+0.14S _{DS})*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	320 lbs	= [FpmaxASD*Hcm-2*(0.6-0.14S _{DS})*Wtmin*wcurb]/wcurb
Compression _{WIND} =	344 lbs	= [Fh ASD trans*Hcm+2*0.6*Wtmax*wcurb-Fvert ASD*wcurb/2]/wcurb
Tension _{WIND} =	698 lbs	= [Fh ASD trans*Hcm-2*0.6*Wtmin*wcurb+Fvert ASD*wcurb/2]/wcurb

----> Negative values indicate opposite load.

Longitudinal:

Compression _{SEISMIC} =	807 lbs	= [FpmaxASD*Hcm+2*(1+0.14*S _{DS})*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	136 lbs	= [FpmaxASD*Hcm-2*(0.6-0.14S _{DS})*Wtmin*Lcurb]/Lcurb
Compression _{WIND} =	27 lbs	= [Fh ASD long*Hcm+2*0.6*Wtmax*Lcurb-Fvert ASD*Lcurb/2]/Lcurb
Tension _{WIND} =	381 lbs	= [Fh ASD long*Hcm-2*0.6*Wtmin*Lcurb+Fvert ASD*Lcurb/2]/Lcurb

----> Negative values indicate opposite load.

Governing Reactions:

Transverse:	Comp _{MAX} =	991	lbs	----> Along long edge of curb.
(on long edge)	Tens _{MAX} =	698	lbs	----> Along long edge of curb.
Longitudinal:	Comp _{MAX} =	807	lbs	----> Along short edge of curb.
(on short edge)	Tens _{MAX} =	381	lbs	----> Along short edge of curb.

----> Negative values indicate opposite load.




Curb Design

F_y = 50 ksi F_u = 65 ksi
E = 29500 ksi t = 0.0713 14 Gauge

Calculate Section Properties of Curb

A' = 14.000 in	a = 13.644 in = A' - (2r+t)
B' = 1.750 in	a' = 13.929 in = A' - t
C' = 0.000 in (0 if no lips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - (t/2+αt/2)
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
I _x = 27.499 in ⁴	r _x = 4.73 in
I _y = 0.204 in ⁴	r _y = 0.407 in
A = 1.23 in ²	r _{min} = 0.407 in

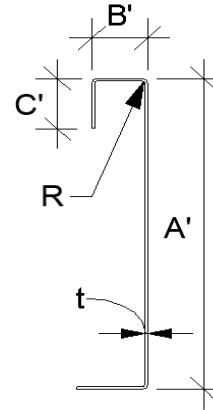

Axial Compression

P_u = 0.494 k (Max Axial Comp) Ω_c = 1.80
P_n/Ω_c = 17.057 k
F_e = 30.16 ksi $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c ≤ 1.5; F_n = (0.658<sup>λ_c²) F_y
λ_c = 1.29 If λ_c > 1.5; F_n = $\frac{0.877}{\lambda_c^2} F_y$
F_n = 24.98 ksi
L_y = 50 in Lateral unbraced length
k_yL_y/r_y = 98 (assume k=0.8)</sup>

$$\lambda_c = \sqrt{\frac{F_y}{F_e}} \quad F_e = \frac{\pi^2 E}{(kl/r)^2}$$

Compression Check = O.K.

Check Web Crippling

h = 14 in -- Check limits: C = 4.00
t = 0.0713 in h/t = 196.35 ≤ 200 C_R = 0.14
N = 7.00 N/t = 98.18 ≤ 210 C_N = 0.35
Ω_w = 1.75 N/h = 0.5 ≤ 2.0 C_h = 0.02
P_n = 2.422 k R/t = 1.50 ≤ 9.0
P_n/Ω_w = 1.384 k
Long side: P_{u trans} = 0.496 k **O.K.** # clips = 2
Short side: P_{u Long} = 0.403 k **O.K.** # clips = 2

$$P_n = C t^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}} \right) \left(1 + C_N \sqrt{\frac{N}{t}} \right) \left(1 - C_h \sqrt{\frac{h}{t}} \right)$$

Check Web Stiffener

16Ga x 3/4" x 7" [C-channel]
width of stiffener = 7.000 in t_s = 0.0566 16 Gauge
web of stiff. w = 6.717 in R_s = 0.0849 in
***Check w/t_s ≤ 1.28√E/F_y Ω_c = 1.70
w/t_s = 118.675
1.28√(E/F_y) = 31.091 --> w/t_s over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc}
P_{wc} = 2.422 k A_e = 0.380 in²
P_n = 15.002 k P_n/Ω = 8.825 k

Not Req'd

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T_{crnmax} = 247 lbs Max[F_{pmaxASD}/4 -OR- F_{hASDtrans}/4 corner connections]
V_{crnmax} = 496 lbs Max[Tens/2 -OR- Comp/2 corner connections per side]
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.1
of Bolts required for Shear = 0.4
of Bolts Used = 2.0
Check Combined Stress in Bolts & Inserts: 0.255 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.783 in $\frac{P_n}{\Omega} = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$ $L_{req'd} = \frac{V_{req} \Omega}{0.75 t F_u}$
L_{req'd} = 0.335 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$ in

$F_{u1} = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_{u2} = 65$ ksi

$d = 0.190$ in (screw diameter)

$d_w = 0.375$ in (nom. washer diameter)

$t_2/t_1 = 1.4$

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ 3.86 k

$P_{ns} = 2.7t_1dF_{u1}$ 2.38 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{ns}/\Omega = 792$ #

$P_{ss}/\Omega = 540$ # <- Controls

Tension: $P_{not} = 1.068$ k (screw pull-out strength)

$P_{nov} = 2.607$ k (screw pull-over strength)

$P_{ts}/\Omega = 356$ # <- Controls

$P_{ts}/\Omega = 820$ #

(full tensile screw capacity)

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2377$ #


$P_{ns} = 2.7t_1dF_{u1}$ 2.38 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{not} = 0.85t_c d F_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 1.5t_1 d_w F_{u1}$

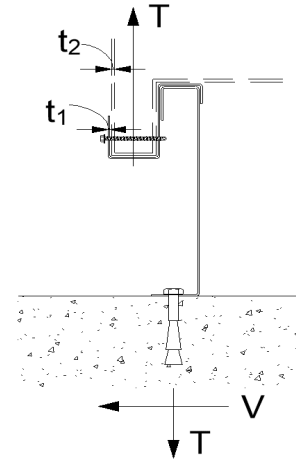

Check Block shear rupture: O.K.

$F_y = 50$ ksi

$A_{gv} = 0.463$ in²

$R_n/\Omega = 7.500$ k

BSR O.K.

$\Omega = 2.22$ bolt/screw connection

$A_{nv} = 0.443$ in²

$A_{nt} = 0.042$ in²

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

(AISI Sect. E5.3)

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

Transverse: Uplift_{MAX} = 949 lbs Shear_{MAX} = 494 lbs

Compression_{SEISMIC} = 1319 lbs $= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$

Tension_{SEISMIC} = 678 lbs $= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$

Compression_{WIND} = 680 lbs $= [F_{h ASD trans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vert ASD} * w_{curb}/2] / w_{curb}$

Tension_{WIND} = 949 lbs $= [F_{h ASD trans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vert ASD} * w_{curb}/2] / w_{curb}$

Longitudinal: Uplift_{MAX} = 360 lbs Shear_{MAX} = 479 lbs

Compression_{SEISMIC} = 929 lbs $= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$

Tension_{SEISMIC} = 288 lbs $= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$

Compression_{WIND} = 90 lbs $= [F_{h ASD long} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vert ASD} * L_{curb}/2] / L_{curb}$

Tension_{WIND} = 360 lbs $= [F_{h ASD long} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vert ASD} * L_{curb}/2] / L_{curb}$

Wood Attachment: 1/4" ϕ x 3.5" Simpson SDS screws w/ 2.25" threaded emt (SGmin = 0.43)

Tall_{metal} = 997 lbs

Vall_{metal} = 1097 lbs

Transverse: Tall_{wood} = 616 lbs

Vall_{wood} = 672 lbs

of Screws Req'd for Uplift = 1.54

COMBINED LOADING: 0.569 O.K.

of Screws Req'd for Shear = 0.73

Screw Spacing = 21.5 in o.c.

Total # of screws Required = 4

1/4" ϕ x 3.5" Simpson SDS screws @ 21.5 in o.c. along long side of curb w/ 2.25" threaded embed

Longitudinal:

of Screws Req'd for Uplift = 0.6

COMBINED LOADING: 0.433 O.K.

of Screws Req'd for Shear = 0.7

Screw Spacing = 14.4 in o.c.

Total # of screws Required = 3

1/4" ϕ x 3.5" Simpson SDS screws @ 14.4 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment: 1/2" ϕ A307 Bolts to steel angle below deck

Tall_{bolt} = 3927 lbs

Vall_{bolt} = 2209 lbs

Transverse: Tall_{metal} = 2086 lbs

Vall_{metal} = 2192 lbs

of Bolts Req'd for Uplift = 0.45

COMBINED LOADING: 0.111 O.K.

of Bolts Req'd for Shear = 0.23

Bolt Spacing = 60.5 in o.c.

Total # of Bolts Required = 2

1/2" ϕ A307 Bolts to steel angle below deck @ 60.5 in o.c. along long side of curb

Longitudinal:

of Bolts Req'd for Uplift = 0.17

COMBINED LOADING: 0.042 O.K.

of Bolts Req'd for Shear = 0.22

Req'd Min Spacing = 24.8 in o.c.

Total # of Bolts Required = 2

1/2" ϕ A307 Bolts to steel angle below deck @ 24.8 in o.c. along short side of curb



For Concrete anchorage: SEISMIC $(0.6-0.14S_{DS})D + 0.7\Omega_o E$ $\Omega_o = 2.0$

Concrete Attachment: 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed

$$Tall_{LRFD} = 1957 \text{ lbs} \quad Vall_{LRFD} = 4540 \text{ lbs} \quad \alpha = (1 + 0.2SDS)D + 2.5E = 1.708$$

$$Tall_{ASD} = Tall_{LRFD}/\alpha = 1146 \text{ lbs} \quad Vall_{ASD} = Vall_{LRFD}/\alpha = 2658 \text{ lbs} \quad (D = 0.758, E = 0.242)$$

Transverse:	Uplift_{MAX} =	1469 lbs	Shear_{MAX} =	959 lbs
--------------------	-------------------------------	-----------------	------------------------------	----------------

$$\begin{aligned} \text{Compression}_{SEISMIC} &= 2110 \text{ lbs} &= [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb} \\ \text{Tension}_{SEISMIC} &= 1469 \text{ lbs} &= [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb} \\ \text{Shear}_{SEISMIC} &= 959 \text{ lbs} &= \Omega_o * F_{pmaxASD} / 2 \\ \text{Min Bolts Req'd Uplift} &= 1.28 \text{ spacing} = 60.50 \text{ in o.c.} & \text{Applied} = 489.7 \text{ lbs} \\ \text{Min Bolts Req'd Shear} &= 2.00 \text{ spacing} = 60.50 \text{ in o.c.} & \text{Applied} = 159.8 \text{ lbs} \end{aligned}$$

Try using 3 bolts spaced at 30.25 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.49$
---	--

Use 3 - 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy @ 30.3 in o.c. max. along long side of curb w/ 4" embed

Longitudinal:	Uplift_{MAX} =	689 lbs	Shear_{MAX} =	959 lbs
----------------------	-------------------------------	----------------	------------------------------	----------------

$$\begin{aligned} \text{Compression}_{SEISMIC} &= 1330 \text{ lbs} &= [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb} \\ \text{Tension}_{SEISMIC} &= 689 \text{ lbs} &= [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb} \\ \text{Shear}_{SEISMIC} &= 959 \text{ lbs} &= \Omega_o * F_{pmaxASD} / 2 \\ \text{Min Bolts Req'd Uplift} &= 0.60 \text{ spacing} = 12.38 \text{ in o.c.} & \text{Applied} = 229.8 \text{ lbs} \\ \text{Min Bolts Req'd Shear} &= 2.00 \text{ spacing} = 24.75 \text{ in o.c.} & \text{Applied} = 159.8 \text{ lbs} \end{aligned}$$

Try using 3 bolts spaced at 12.38 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.26$
---	--

Use 3 - 3/4" ϕ thrd'd rods in Hilti Hit-HY 200 epoxy @ 12.4 in o.c. max. along short side of curb w/ 4" embed

CURB DESIGN SUMMARY: CBKD-79 KDKITSUN3672			Unit: ZR 036-060, XP 036-060, ZF 036-072
CURB RAIL THICKNESS: 0.0713 in 14 Gauge			
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge			
# OF CLIPS (LONG SIDE) - 2 clips with 2 - #10 SMS screws each clip			
WEB STIFFENER: NOT REQUIRED			
# OF CLIPS (SHORT SIDE) - 2 clips with 2 - #10 SMS screws each clip			
WEB STIFFENER: NOT REQUIRED			
CORNER CONNECTION: Use 2 - 1/4" ϕ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts			
CURB ANCHORAGE	WOOD	STEEL	CONCRETE
	1/4" ϕ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	1/2" ϕ A307 Bolts to steel angle below deck	3/4" ϕ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
LONG DIRECTION	4 @ 21.5 in o.c.	2 @ 60.5 in o.c.	3 @ 30.25 in o.c.
SHORT DIRECTION	3 @ 14.38 in o.c.	2 @ 24.75 in o.c.	3 @ 12.38 in o.c.