



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations

for

CBKD-152 Series

CBKDLXS SERIES**



Prepared for:

PROVENT / RRS

**3847 Wabash Drive
Mira Loma, CA 91725**

Date: September 26, 2023

Project Number: PV2312

For wood, concrete, and steel attachments, see Roof Anchorage Detail, Form no. CB-60.



KNOCK-DOWN ROOF CURBS FOR YORK UNITS

P***A ALL MODELS


PROVENT P/N	A	EST. WEIGHT	SEISMIC KIT P/N	WEIGHT
CBKDLXS08	8"	43 Lbs.	KDKITLX	5 Lbs.
CBKDLXS11	11"	54 Lbs.		
CBKDLXS14	14"	65 Lbs.		

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021


Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

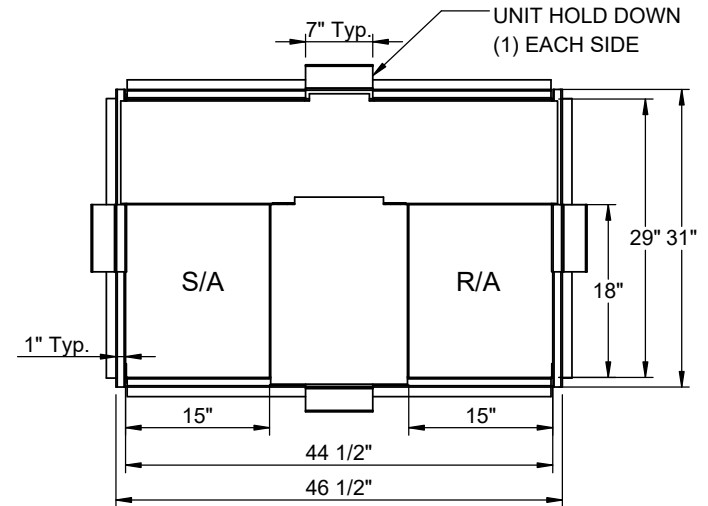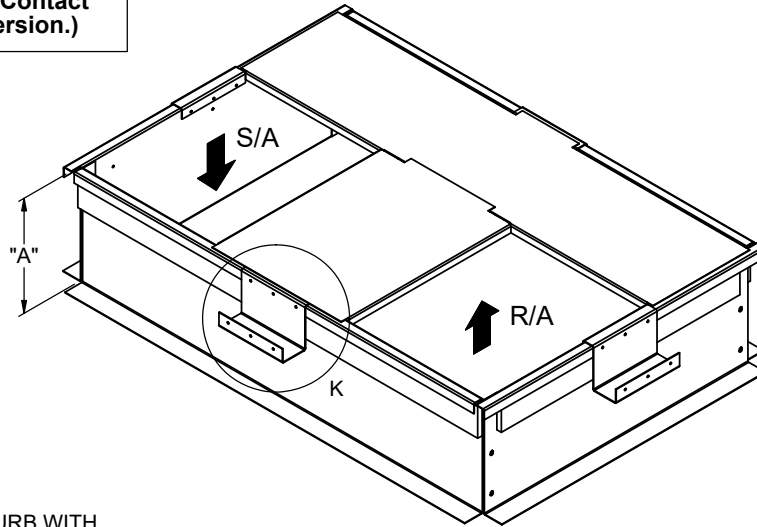

ATTACH TO CURB WITH (3) #10x 1/2" TEK SCREWS, EACH SIDE

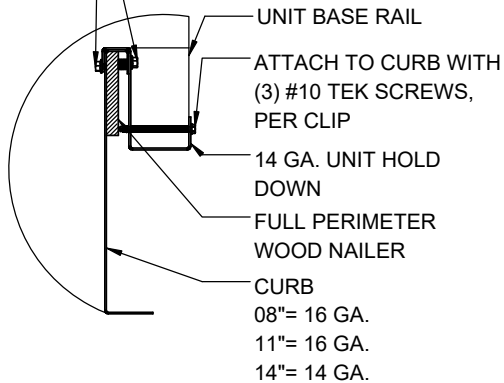


HOLD DOWN DETAIL

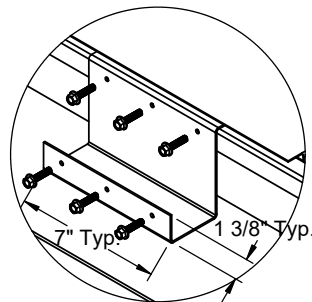

DETAIL K

1/4-20 X 3/4" GRADE 8 BOLT
(2) (A= 8")
(3) (A> 8")

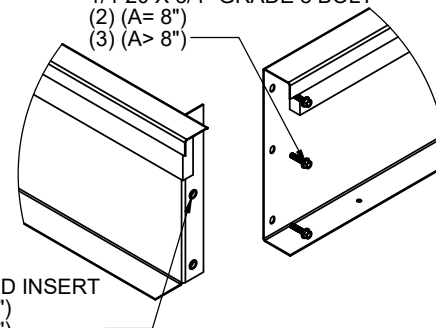

1/4"-20 THREADED INSERT
(2) (A= 8")
(3) (A> 8")

CORNER DETAIL



3847 WABASH DR.
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-152

PART NUMBER:
KDKITLXS SERIES


DATE:
7/14/2023

REV:
8

DRAWN BY:
JG

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

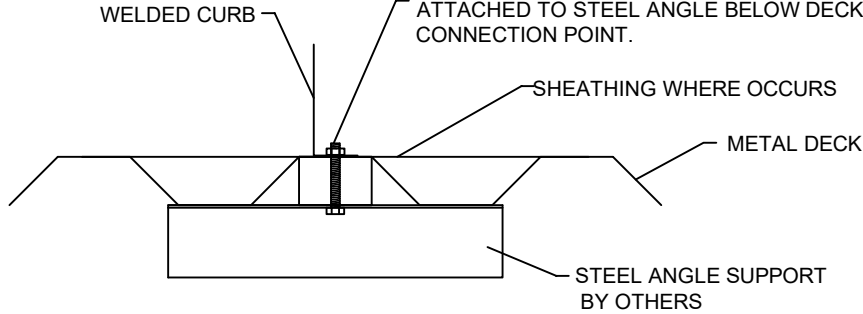

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SAV1518	3 @ 54.56" O.C.	2 @ 68.13" O.C.
SAV2025	3 @ 61.56" O.C.	2 @ 68.13" O.C.
SAV28	3 @ 69.75" O.C.	2 @ 68.13" O.C.

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

ASSUMES:


CONC SLAB
f_c= 4000PSI MINIMUM
4" MIN THICKNESS
NORMAL WEIGHT CONCRETE
MIN. 7-1/4" EDGE DISTANCE

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

ROOF ANCHORAGE DETAIL

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SAV1518	SAV1518
SAV2025	SAV2025
SAV28	SAV28


CONCRETE ATTACHMENT



NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19.0" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	4 @ 22.96" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	3 @ 36" O.C.	2 @ 41.5" O.C.
SAV1518	4 @ 36.38" O.C.	2 @ 68.13" O.C.
SAV2025	4 @ 41.04" O.C.	3 @ 34.06" O.C.
SAV28	5 @ 34.88" O.C.	3 @ 34.06" O.C.

WOOD ATTACHMENT

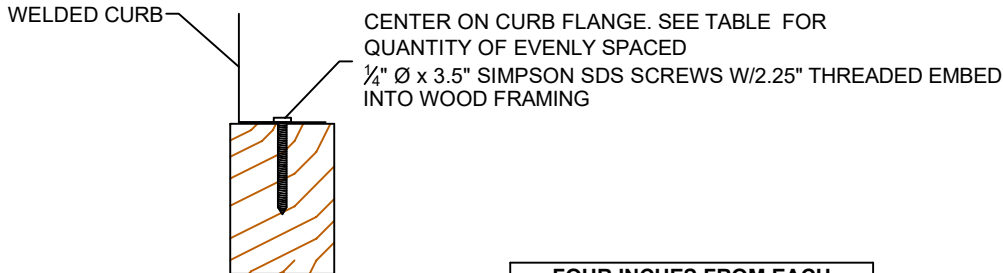

FOUR INCHES FROM EACH CORNER EVENLY SPACED

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	7 @ 12.15" O.C.	5 @ 10.75" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.35" O.C.
PRL	6 @ 15.2" O.C.	4 @ 15.17" O.C.
SAV1518	6 @ 22.63" O.C.	5 @ 18.03" O.C.
SAV2025	7 @ 21.19" O.C.	5 @ 18.03" O.C.
SAV28	8 @ 20.5" O.C.	5 @ 18.03" O.C.



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
8/28/2023

REV:
10

DRAWN BY:
FMM




Client:	ProVent	PV2312
Description:	CBPKD-152	LXS
Unit:	ALL P***A MODELS	

Curb Information

Hcurb =	14	in	(Height of curb)
Lcurb =	46.5	in	(Length of curb)
wcurb =	31	in	(Width of curb)
WGTCurb =	70	lbs	(Weight of curb)
# Clips long side =	1		
# Clips short side =	1		

Unit Information

WGTunit =	521	lbs	(Oper. Weight of Unit)
Wtmax =	156	lbs	(Maximum corner weight)
Wtmin =	111	lbs	(Minimum corner weight)
Hunit =	49	in	(Height of unit above curb)
Hcm =	24.5	in	(Height to center of mass)
Lunit =	51.25	in	(Length of unit)
Wunit =	35.75	in	(Width of unit)

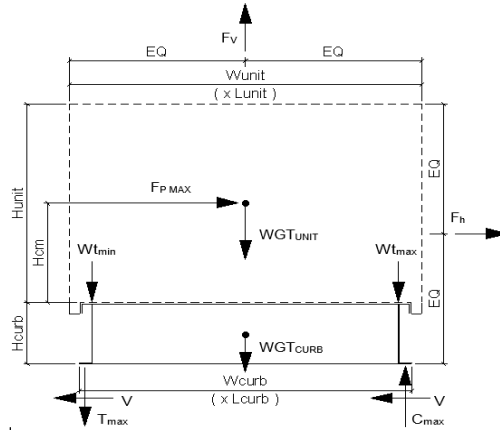

Seismic Loading - 2021 IBC/2022 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	624 lbs	(0.7*Fpmax)
	(unit only)	
		ap = 2.5
		Rp = 6
		FpmaxASD = 707 lbs
		(unit and curb)

Wind Loading - 2021 IBC/2022 CBC

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ACSE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 25.5-1D, ASCE7-16)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5	psf = 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	831	lbs = 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	580	lbs = 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	372	lbs = 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:

Compression _{SEISMIC} =	905	lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	431	lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*wcurb]/wcurb
Compression _{WIND} =	658	lbs	= [Fh ASD trans *Hcm + 2*0.6*Wtmax*wcurb - Fvert ASD *wcurb/2]/wcurb
Tension _{WIND} =	710	lbs	= [Fh ASD trans *Hcm - 2*0.6*Wtmin*wcurb + Fvert ASD *wcurb/2]/wcurb

---> Negative values indicate opposite load.

Longitudinal:

Compression _{SEISMIC} =	741	lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	266	lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*Lcurb]/Lcurb
Compression _{WIND} =	307	lbs	= [Fh ASD long *Hcm + 2*0.6*Wtmax*Lcurb - Fvert ASD *Lcurb/2]/Lcurb
Tension _{WIND} =	359	lbs	= [Fh ASD long *Hcm - 2*0.6*Wtmin*Lcurb + Fvert ASD *Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

Governing Reactions:

Transverse: (on long edge)	Comp _{MAX} =	905	lbs	---> Along long edge of curb.
	Tens _{MAX} =	710	lbs	---> Along long edge of curb.
Longitudinal: (on short edge)	Comp _{MAX} =	741	lbs	---> Along short edge of curb.
	Tens _{MAX} =	359	lbs	---> Along short edge of curb.


---> Negative values indicate opposite load.

Curb Design

F_y = 50 ksi F_u = 65 ksi
E = 29500 ksi t = 0.0566 **16 Gauge**

Calculate Section Properties of Curb

A' = 14.000 in	a = 13.717 in = A' - (2r+t)
B' = 1.000 in	a' = 13.943 in = A' - t
C' = 0.000 in (0 if no lips)	b = 0.859 in = B' - [r+t/2+α(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 0.972 in = B' - (t/2+αt/2)
R = 0.0849 (Inside bend radius)	c = 0.000 in = α(C' - (r+t/2))
t = 0.0566 in	c' = 0.000 in = α(C' - t/2)
r' = 0.113 in = R+t/2	u = 0.178 in = πr/2
x = 0.060 in (Distance between centroid and web centerline)	
I _x = 17.874 in ⁴	r _x = 4.47 in
I _y = 0.031 in ⁴	r _y = 0.187 in
A = 0.89 in ²	r _{min} = 0.187 in

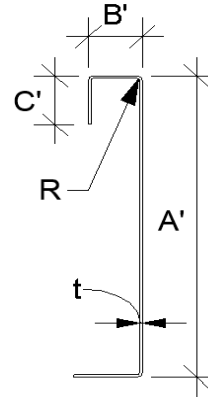

Axial Compression

P_u = 0.416 k (Max Axial Comp) Ω_c = 1.80
P_n/Ω_c = 3.516 k
F_e = 8.08 ksi $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c ≤ 1.5; F_n = (0.658λ_c²) F_y
λ_c = 2.49 $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c > 1.5; F_n = $\frac{0.877}{\lambda_c^2} F_y$ λ_c = $\sqrt{\frac{F_y}{F_e}}$ F_e = $\frac{\pi^2 E}{(kl/r)^2}$
F_n = 7.08 ksi
L_y = 45 in Lateral unbraced length
k_yL_y/r_y = 190 (assume k=0.8)

Compression Check = O.K.

Check Web Crippling

h = 14 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0566 in	h/t = 247.35 ≤ 260	C _R = 0.14	
N = 7.00	N/t = 123.67 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.5 ≤ 2.0	C _h = 0.02	
P _n = 1.591 k	R/t = 1.50 ≤ 9.0		

P_n/Ω_w = 0.909 k P_n = C t² F_y sin(90) (1 - C_R √(R/t)) (1 + C_N √(N/t)) (1 - C_h √(h/t))
Long side: P_{uTrans} = 0.905 k **O.K.** # clips = 1
Short side: P_{uLong} = 0.741 k **O.K.** # clips = 1

Check Web Stiffener

16Ga x 3/4" x 6" (C-channel)
width of stiffener = 6.000 in t_s = 0.0566 **16 Gauge**
web of stiff. w = 5.717 in R_s = 0.0849 in
***Check w/ts ≤ 1.28√E/F_y Ω_c = 1.70
w/ts = 101.007
1.28√(E/F_y) = 31.091 --> w/ts over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc} A_e = 0.324 in²
P_{wc} = 1.591 k P_n/Ω = 7.317 k
P_n = 12.439 k

Not Req'd

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T_{crnmax} = 208 lbs Max(F_{pmaxASD}/4 -OR- F_{hASDtrans}/4 corner connections)
V_{crnmax} = 453 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.1
of Bolts required for Shear = 0.4
of Bolts Used = 3.0
Check Combined Stress in Bolts & Inserts: 0.153 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.415 in P_n/Ω = $\frac{1}{\Omega} 0.75tLF_u \geq V_{req}$ L_{req'd} = $\frac{V_{req}\Omega}{0.75tF_u}$
L_{req'd} = 0.385 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0566$ in
 $t_2 = 0.1017$ in (unit base rail thickness)
 $d = 0.190$ in (screw diameter)
 $t_2/t_1 = 1.8$

$Fu_1 = 65$ ksi
 $Fu_2 = 65$ ksi
 $dw = 0.375$ in (nom. washer diameter)

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$
 $P_{ns} = 2.7t_1dF_{u1}$
 $P_{ns} = 2.7t_2dF_{u2}$

$P_{ns} = 1887$ #
 3.86 k
 1.89 k
 3.39 k

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2.7t_1dF_{u1}$
 $P_{ns} = 2.7t_2dF_{u2}$

$P_{ns} = 1887$ #
 1.89 k
 3.39 k

Tension:

$P_{not} = 1.068$ k (screw pull-out strength)
 $P_{nov} = 2.069$ k (screw pull-over strength)
 $P_{ts}/\Omega = 356$ # <- Controls
 $P_{ts}/\Omega = 820$ #

$P_{not} = 0.85t_c dF_{u2}$
 $t_c = \min(t_1, t_2)$
 $P_{nov} = 1.5t_1d_wF_{u1}$


(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	0.831	1	0.83	540 #	2	6.00 in
Short side:	0.624	1	0.62	540 #	2	6.00 in
clip width (in) =	7.00		clip height =	1.4 in		
min spacing =	0.57 in		edge distance =	0.5 in (min. 1.5d)		

Check Block shear rupture:

O.K.
 $F_y = 50$ ksi
 $A_{gv} = 0.368$ in²
 $R_n/\Omega = 5.954$ k

thinnest part = 0.0566 AISI BSR applies
 $\Omega = 2.22$ bolt/screw connection
 $A_{nv} = 0.352$ in²
 $A_{nt} = 0.034$ in²
 $R_n = 0.6F_yA_{gv} + F_uA_{nt} \leq 0.6F_uA_{nv} + F_uA_{nt}$
 (AISI Sect. E5.3)

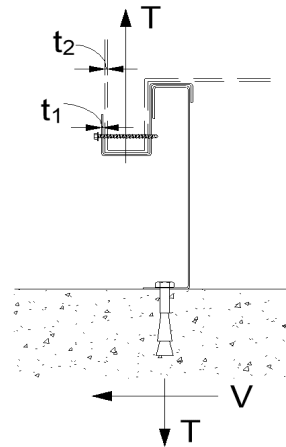

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

	Uplift _{MAX}	Shear _{MAX}
Transverse:	1041 lbs	416 lbs
Compression _{SEISMIC}	1268 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension _{SEISMIC}	796 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression _{WIND}	1023 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vertASD} * w_{curb}/2] / w_{curb}$
Tension _{WIND}	1041 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vertASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	503 lbs	354 lbs
Compression _{SEISMIC}	976 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension _{SEISMIC}	503 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression _{WIND}	471 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vertASD} * L_{curb}/2] / L_{curb}$
Tension _{WIND}	489 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vertASD} * L_{curb}/2] / L_{curb}$

Wood Attachment: **1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded emb** (SGmin = 0.43)

Transverse: $T_{allmetal} = 997$ lbs, $V_{allmetal} = 1097$ lbs
 $T_{allwood} = 616$ lbs, $V_{allwood} = 672$ lbs
 # of Screws Req'd for Uplift = 1.69
 # of Screws Req'd for Shear = 0.62
 Total # of screws Required = 3
 COMBINED LOADING: 0.770 O.K.
 Screw Spacing = 19.3 in o.c.

1/4" φ x 3.5" Simpson SDS screws @ 19.3 in o.c. along long side of curb w/ 2.25" threaded embed

Longitudinal: # of Screws Req'd for Uplift = 0.8
 # of Screws Req'd for Shear = 0.5
 Total # of screws Required = 2
 COMBINED LOADING: 0.671 O.K.
 Screw Spacing = 23.0 in o.c.

1/4" φ x 3.5" Simpson SDS screws @ 23 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment:

1/2" φ A307 Bolts to steel angle below deck

Transverse: $T_{allbolt} = 3927$ lbs, $V_{allbolt} = 2209$ lbs
 $T_{allmetal} = 2086$ lbs, $V_{allmetal} = 2192$ lbs
 # of Bolts Req'd for Uplift = 0.50
 # of Bolts Req'd for Shear = 0.19
 Total # of Bolts Required = 2
 COMBINED LOADING: 0.119 O.K.
 Bolt Spacing = 34.5 in o.c.

1/2" φ A307 Bolts to steel angle below deck @ 34.5 in o.c. along long side of curb


Longitudinal: # of Bolts Req'd for Uplift = 0.24
 # of Bolts Req'd for Shear = 0.16
 Total # of Bolts Required = 2
 COMBINED LOADING: 0.044 O.K.
 Req'd Min Spacing = 19.0 in o.c.

1/2" φ A307 Bolts to steel angle below deck @ 19 in o.c. along short side of curb



For Concrete anchorage: SEISMIC (0.6-0.14S_{DS})D + 0.7Ω_eE Ω_o = 2.0
Concrete Attachment: 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed

Epoxy: Hilti HIT-HY 200 V3 (ICC ESR 4868)
 f_c = 3000 psi
 h = 4 in (concrete thickness, t_{min} = h_{ef} + 2do) O.K.
 h_{ef} = 2.75 in (effective embedment)
 da = 0.5 in (anchor diameter) do = 0.625 in (hole diameter)
 n = 2 (number of dummy anchors to check capacity with spacing effect)
 s = 16.9 in (initial spacing estimate)
 tk_{cr} / uncr = 1135 2220 psi (from ESR 4868, Table 14, Temp range B)
 tk_{cr} / uncr = 1156 2261 psi If f'_c > 2500, multiply by (f'_c/2500)^{0.1}
 c_{Na} = 7.15 in (min. edge distance for full capacity); c_{Na} = 10d_a√(τ_{uncr}/1100)

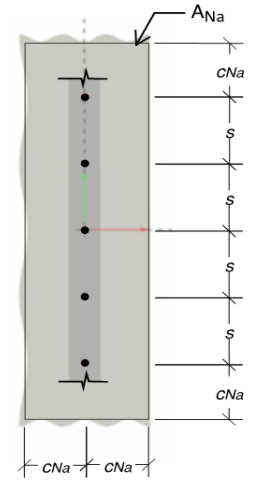

Tension:
 Bond strength $N_{ag} = \frac{A_{Na}}{A_{Na0}} \phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} N_{ba}$ (ACI318-14, 17.4.5.1b)
 ***Bond strength will govern over concrete breakout
 A_{Na} = 408.98 in² N_{ba} = λ_a τ_{cr} π d_a h_{ef} α_{n,seismic} α_{n,seismic} = 0.99
 A_{Na0} = 204.49 in² N_{ag} = 9886 lbs (group) λ_a = 1.0
 N_{ba} = 4943 lbs φN_{ag} = 4820 lbs (group) α_a = 1.0 for normal weight conc; U.b for light

Breakout strength
 $N_{cbg} = \frac{A_{Nc}}{A_{Nco}} \phi_{ec,N} \phi_{ed,N} \phi_{cp,N} N_b$ N_b = λ_a k_c √f'_c h_{ef}^{1.5}
 A_{Nc} = 207.4875 in² N_b = 4246 lbs φ_{conc} = 0.75
 A_{Nco} = 68.0625 in² k_c = 17 φ_{bond} = 0.65
 N_{cbg} = 12945 lbs (group) φ_{seis} = 0.75
 φN_{cbg} = 7281 lbs (group) φ_{steel} = 0.65
Shear: V_{sa,eq} = 4940 (from ESR4868, Table 11) α_{v,seismic} = 0.6
Steel strength φV_{sa,eq} = 1927

Tall_{LRFD} = 2410 lbs (anchor) Vall_{LRFD} = 3067 lbs α = (1 + 0.2SDS)D + 2.5E
 Tall_{ASD} = Tall_{LRFD}/α = 1411 lbs Vall_{ASD} = Vall_{LRFD}/α = 1796 lbs D = 0.758 E = 0.242 α = 1.709

Transverse: Uplift_{MAX} = 1674 lbs Shear_{MAX} = 707 lbs
 Compression_{SEISMIC} = 2147 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}
 Tension_{SEISMIC} = 1674 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}
 Shear_{SEISMIC} = 707 lbs = Ω_o*F_{pmaxASD}/2
 Min Bolts Req'd Uplift = 1.19 spacing = 17.25 in o.c. T_{applied} = 837.1 lbs
 Min Bolts Req'd Shear = 2.00 spacing = 34.50 in o.c. V_{applied} = 176.9 lbs
 Try using 2 bolts spaced at 34.50 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.69$ O.K.

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 34.5 in o.c. max. along long side of curb w/ 2.75in embed
Longitudinal: Uplift_{MAX} = 1088 lbs Shear_{MAX} = 707 lbs
 Compression_{SEISMIC} = 1561 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}
 Tension_{SEISMIC} = 1088 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}
 Shear_{SEISMIC} = 707 lbs = Ω_o*F_{pmaxASD}/2
 Min Bolts Req'd Uplift = 0.77 spacing = 9.50 in o.c. T_{applied} = 544.2 lbs
 Min Bolts Req'd Shear = 2.00 spacing = 19.00 in o.c. V_{applied} = 176.9 lbs
 Try using 2 bolts spaced at 19.00 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.48$ O.K.

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 19 in o.c. max. along short side of curb w/ 2.75in embed

CURB DESIGN SUMMARY:		CBPKD-152 LX5	Unit:	ALL P***A MODELS
CURB RAIL THICKNESS:		0.0566 in	16 Gauge	
UNIT CLIP THICKNESS:		0.0566 in	16 Gauge	
# OF CLIPS (LONG SIDE) - 1 clips with 2 - #10 SMS screws each clip				
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip				
# OF CLIPS (SHORT SIDE) - 1 clips with 2 - #10 SMS screws each clip				
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip				
CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts				
CURB ANCHORAGE	WOOD	1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	STEEL	1/2" φ A307 Bolts to steel angle below deck
	CONCRETE			1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed
LONG DIRECTION		3 @ 19.25 in o.c.		2 @ 34.5 in o.c.
SHORT DIRECTION		2 @ 23 in o.c.		2 @ 19 in o.c.