



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBKD-141 Series
CBKDPRL SERIES**



Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: September 26, 2023

Project Number: PV2312






For wood, concrete, and steel attachments, see Roof Anchorage Detail, Form no. CB-60.

STRUCTURALLY CALCULATED HOLD DOWN CLIPS FOR KNOCK-DOWN ROOF CURBS FOR DIRECT FIT (SUN CORE) LARGE CABINET UNITS

ZX08-14; XX08-12; XYA7, ZYA7
ZY07-12; XY07-09; ZL08-14

Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

PROVENT P/N	A	EST. WEIGHT	SEISMIC KIT P/N	WEIGHT
CBKDPRL08	8"	115 Lbs.	KDKITPRL	60 Lbs.
CBKDPRL11	11"	129 Lbs.		
CBKDPRL14	14"	144 Lbs.		
14 GA UNIT HOLD DOWN (2) EACH SIDE			Meets seismic requirements for the following codes: CBC 2022 IBC 2021	

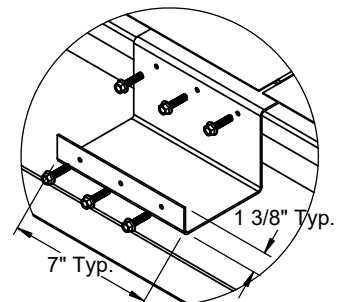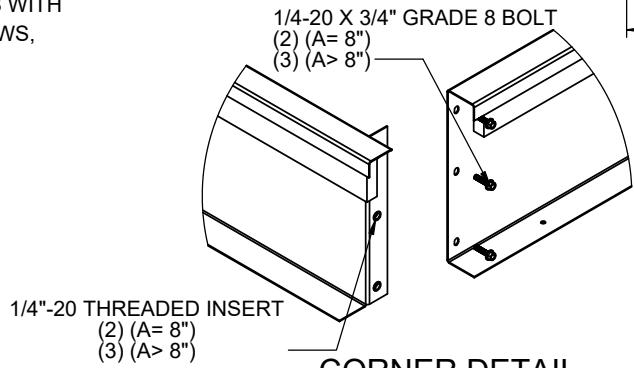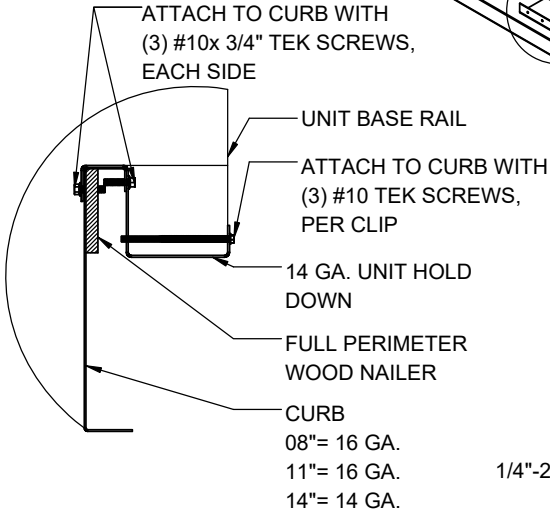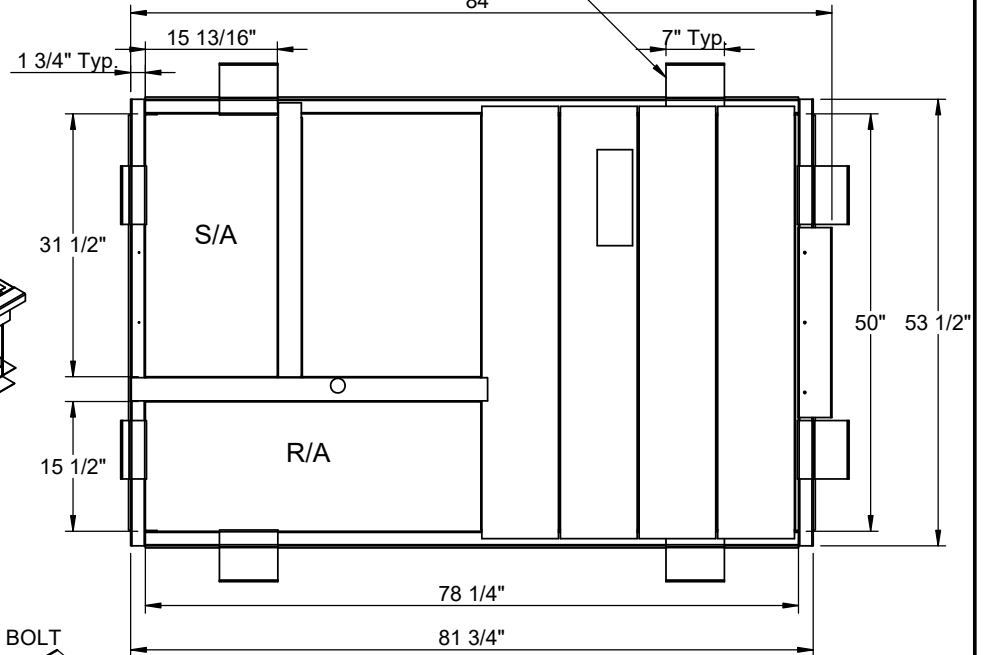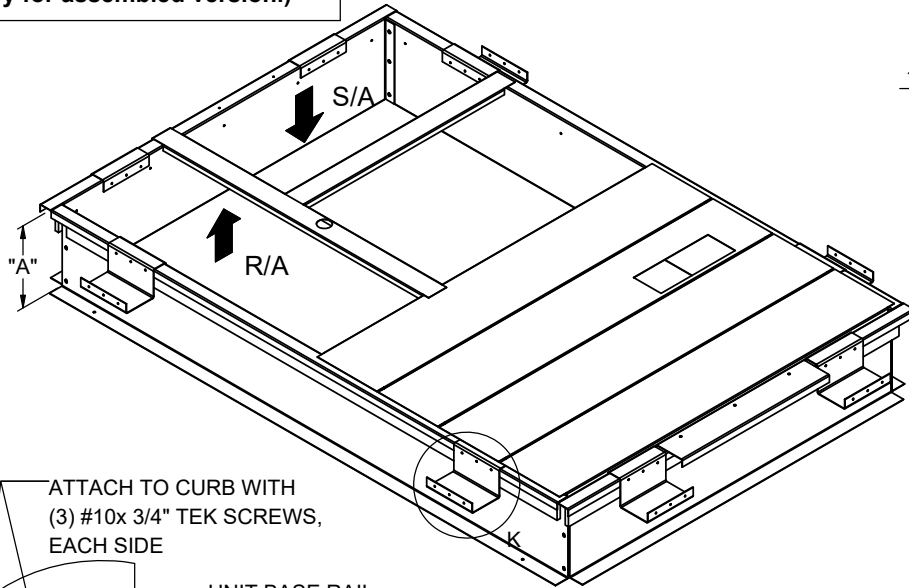

HOLD DOWN DETAIL

CORNER DETAIL

DETAIL K



3847 WABASH DR.
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-141

PART NUMBER:
KDKITPRL SERIES


DATE:
7/18/2023

REV:
8

DRAWN BY:
JG

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

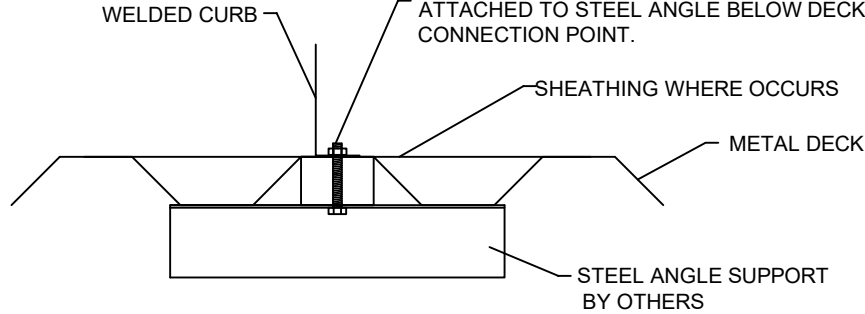

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SAV1518	3 @ 54.56" O.C.	2 @ 68.13" O.C.
SAV2025	3 @ 61.56" O.C.	2 @ 68.13" O.C.
SAV28	3 @ 69.75" O.C.	2 @ 68.13" O.C.

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

ASSUMES:


CONC SLAB
f_c= 4000PSI MINIMUM
4" MIN THICKNESS
NORMAL WEIGHT CONCRETE
MIN. 7-1/4" EDGE DISTANCE

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

ROOF ANCHORAGE DETAIL

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SAV1518	SAV1518
SAV2025	SAV2025
SAV28	SAV28


CONCRETE ATTACHMENT



NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19.0" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	4 @ 22.96" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	3 @ 36" O.C.	2 @ 41.5" O.C.
SAV1518	4 @ 36.38" O.C.	2 @ 68.13" O.C.
SAV2025	4 @ 41.04" O.C.	3 @ 34.06" O.C.
SAV28	5 @ 34.88" O.C.	3 @ 34.06" O.C.

WOOD ATTACHMENT

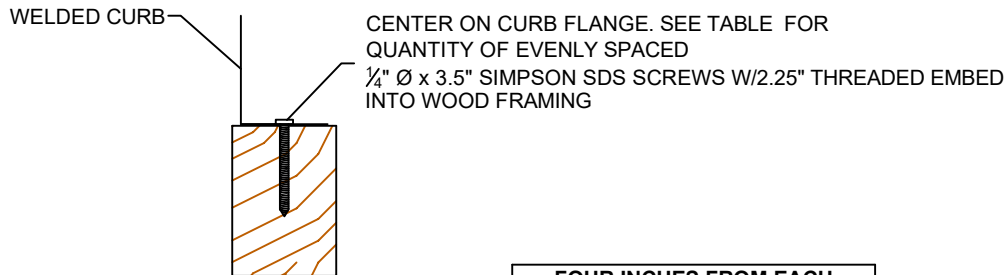

FOUR INCHES FROM EACH CORNER EVENLY SPACED

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	7 @ 12.15" O.C.	5 @ 10.75" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.35" O.C.
PRL	6 @ 15.2" O.C.	4 @ 15.17" O.C.
SAV1518	6 @ 22.63" O.C.	5 @ 18.03" O.C.
SAV2025	7 @ 21.19" O.C.	5 @ 18.03" O.C.
SAV28	8 @ 20.5" O.C.	5 @ 18.03" O.C.



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
8/28/2023

REV:
10

DRAWN BY:
FMM




Client:	ProVent	PV2312
Description:	CBPKD-141	PRL
Unit:	ZX, ZL 08-14; XX 08-12; XY/ZY A7; ZY 07-12; XY 07-09	

Curb Information

Hcurb =	14 in	(Height of curb)
Lcurb =	84 in	(Length of curb)
wcurb =	53.5 in	(Width of curb)
WGTCurb =	204 lbs	(Weight of curb)
# Clips long side =	2	
# Clips short side =	2	

Unit Information

WGTunit =	1318 lbs	(Oper. Weight of Unit)
Wtmax =	395 lbs	(Maximum corner weight)
Wtmin =	280 lbs	(Minimum corner weight)
Hunit =	55.3 in	(Height of unit above curb)
Hcm =	27.65 in	(Height to center of mass)
Lunit =	87.2 in	(Length of unit)
Wunit =	61.7 in	(Width of unit)

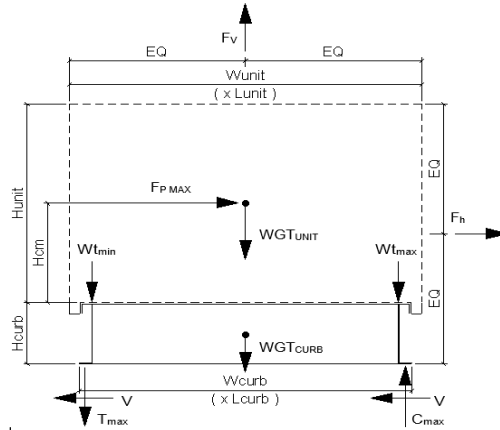

Seismic Loading - 2021 IBC/2022 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	1578 lbs	(0.7*Fpmax)
	(unit only)	
		ap = 2.5
		Rp = 6
		FpmaxASD = 1822 lbs
		(unit and curb)

Wind Loading - 2021 IBC/2022 CBC

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ACSE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 25.5-1D, ASCE7-16)
GCr(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16)
Fh ASD trans =	1556 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
Fh ASD long =	1101 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD =	1093 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:

Compression _{SEISMIC} =	1859 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	658 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*wcurb]/wcurb
Compression _{WIND} =	732 lbs	= [Fh ASD trans *Hcm + 2*0.6*Wtmax*wcurb - Fvert ASD *wcurb/2]/wcurb
Tension _{WIND} =	1015 lbs	= [Fh ASD trans *Hcm - 2*0.6*Wtmin*wcurb + Fvert ASD *wcurb/2]/wcurb

---> Negative values indicate opposite load.

Longitudinal:

Compression _{SEISMIC} =	1563 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	362 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*Lcurb]/Lcurb
Compression _{WIND} =	290 lbs	= [Fh ASD long *Hcm + 2*0.6*Wtmax*Lcurb - Fvert ASD *Lcurb/2]/Lcurb
Tension _{WIND} =	573 lbs	= [Fh ASD long *Hcm - 2*0.6*Wtmin*Lcurb + Fvert ASD *Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

Governing Reactions:

Transverse:	Comp _{MAX} =	1859 lbs	---> Along long edge of curb.
(on long edge)	Tens _{MAX} =	1015 lbs	---> Along long edge of curb.
Longitudinal:	Comp _{MAX} =	1563 lbs	---> Along short edge of curb.
(on short edge)	Tens _{MAX} =	573 lbs	---> Along short edge of curb.


---> Negative values indicate opposite load.

Curb Design

Fy = 50 ksi Fu = 65 ksi
E = 29500 ksi t = 0.0713 **14 Gauge**

Calculate Section Properties of Curb

A' = 14.000 in	a = 13.644 in = A' - (2r+t)
B' = 1.750 in	a' = 13.929 in = A' - t
C' = 0.000 in (0 if no lips)	b = 1.572 in = B' - [r+t/2+α(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - (t/2+αt/2)
R = 0.1069 (Inside bend radius)	c = 0.000 in = α(C' - (r+t/2))
t = 0.0713 in	c' = 0.000 in = α(C' - t/2)
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
Ix = 27.499 in ⁴	rx = 4.73 in
Iy = 0.204 in ⁴	ry = 0.407 in
A = 1.23 in ²	rmin = 0.407 in

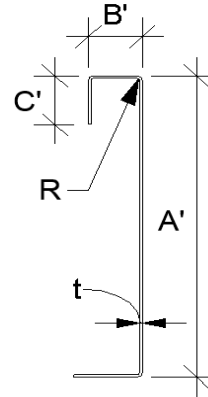

Axial Compression

Pu = 0.789 k (Max Axial Comp) Ωc = 1.80
Pn/Ωc = 17.057 k
Fe = 30.16 ksi If λc ≤ 1.5; Fn = (0.658λc²) Fy λc = √(Fy/Fe) Fe = (π²E)/(kl/r)²
λc = 1.29 If λc > 1.5; Fn = (0.877/λc²) Fy
Fn = 24.98 ksi
Ly = 50 in Lateral unbraced length
kyLy/r_y = 98 (assume k=0.8)

Compression Check = O.K.

Check Web Crippling

h = 14 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 196.35 ≤ 260	C _R = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.5 ≤ 2.0	C _h = 0.02	
P _n = 2.422 k	R/t = 1.50 ≤ 9.0		

P_n/Ω_w = 1.384 k P_n = Ct²F_ysin(90) (1 - C_R√(R/t)) (1 + C_N√(N/t)) (1 - C_h√(h/t))
Long side: P_{U_{Trans}} = 0.929 k **O.K.** # clips = 2
Short side: P_{U_{Long}} = 0.781 k **O.K.** # clips = 2

Check Web Stiffener

16Ga x 3/4" x 6" (C-channel)
width of stiffener = 6.000 in ts = 0.0566 **16 Gauge**
web of stiff. w = 5.717 in Rs = 0.0849 in
***Check w/ts ≤ 1.28√E/Fys Ωc = 1.70
w/ts = 101.007
1.28√(E/Fys) = 31.091 --> w/ts over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc} Ae = 0.324 in²
P_{wc} = 2.422 k P_n/Ω = 7.659 k
P_n = 13.021 k

Not Req'd

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts
Tcrnmax = 455 lbs Max(F_{pmaxASD}/4 -OR- F_{hASDtrans}/4 corner connections)
Vcrnmax = 929 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.2
of Bolts required for Shear = 0.8
of Bolts Used = 3.0
Check Combined Stress in Bolts & Inserts: 0.318 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.783 in P_n/Ω = (1/Ω) 0.75tL Fu ≥ V_{req} L_{req'd} = (V_{req}Ω)/(0.75tFu)
L_{req'd} = 0.628 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$ in
 $t_2 = 0.1017$ in (unit base rail thickness)
 $d = 0.190$ in (screw diameter)
 $t_2/t_1 = 1.4$

$F_{u1} = 65$ ksi
 $F_{u2} = 65$ ksi
 $dw = 0.375$ in (nom. washer diameter)

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ $P_{ns} = 2377$ #
 $P_{ns} = 2.7t_1dF_{u1}$ 3.86 k
 $P_{ns} = 2.7t_2dF_{u2}$ 2.38 k
 3.39 k

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2377$ #
 $P_{ns} = 2.7t_1dF_{u1}$ 2.38 k
 $P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

Tension:

$P_{not} = 1.068$ k (screw pull-out strength)
 $P_{nov} = 2.607$ k (screw pull-over strength)
 $P_{ts}/\Omega = 356$ # <- Controls
 $P_{ts}/\Omega = 820$ #

$P_{not} = 0.85t_c dF_{u2}$
 $t_c = \min(t_1, t_2)$
 $P_{nov} = 1.5t_1 d_w F_{u1}$


(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	1.578	2	0.79	540 #	2	6.00 in
Short side:	1.578	2	0.79	540 #	2	6.00 in
clip width (in) =	7.00		clip height =	1.4 in		
min spacing =	0.57 in		edge distance =	0.5 in (min. 1.5d)		

Check Block shear rupture:

O.K.
 $F_y = 50$ ksi
 $A_{gv} = 0.463$ in²
 $R_n/\Omega = 7.500$ k

thinnest part = 0.0713 AISI BSR applies
 $\Omega = 2.22$ bolt/screw connection
 $A_{nv} = 0.443$ in² $A_{nt} = 0.042$ in²
 $R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$
 (AISI Sect. E5.3)

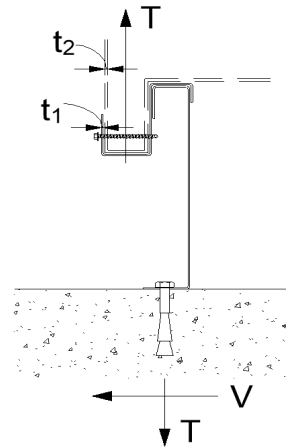

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

Transverse:	Uplift _{MAX} =	1301 lbs	Shear _{MAX} =	911 lbs
Compression _{SEISMIC} =	2422 lbs	= $[F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$		
Tension _{SEISMIC} =	1205 lbs	= $[F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$		
Compression _{WIND} =	1121 lbs	= $[F_{hASDtrans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vertASD} * w_{curb}/2] / w_{curb}$		
Tension _{WIND} =	1301 lbs	= $[F_{hASDtrans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vertASD} * w_{curb}/2] / w_{curb}$		
Longitudinal:	Uplift _{MAX} =	690 lbs	Shear _{MAX} =	911 lbs
Compression _{SEISMIC} =	1907 lbs	= $[F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$		
Tension _{SEISMIC} =	690 lbs	= $[F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$		
Compression _{WIND} =	456 lbs	= $[F_{hASDlong} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vertASD} * L_{curb}/2] / L_{curb}$		
Tension _{WIND} =	636 lbs	= $[F_{hASDlong} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vertASD} * L_{curb}/2] / L_{curb}$		

Wood Attachment: **1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded emb** (SGmin = 0.43)

Transverse: $T_{allmetal} = 997$ lbs $V_{allmetal} = 1097$ lbs
 $T_{allwood} = 616$ lbs $V_{allwood} = 672$ lbs
 # of Screws Req'd for Uplift = 2.11 COMBINED LOADING: 0.867 O.K.
 # of Screws Req'd for Shear = 1.36 Screw Spacing = 25.3 in o.c.
 Total # of screws Required = 4

1/4" φ x 3.5" Simpson SDS screws @ 25.3 in o.c. along long side of curb w/ 2.25" threaded embed

Longitudinal: # of Screws Req'd for Uplift = 1.1 COMBINED LOADING: 0.825 O.K.
 # of Screws Req'd for Shear = 1.4 Screw Spacing = 22.8 in o.c.
 Total # of screws Required = 3

1/4" φ x 3.5" Simpson SDS screws @ 22.8 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment:

1/2" φ A307 Bolts to steel angle below deck

Transverse: $T_{allbolt} = 3927$ lbs $V_{allbolt} = 2209$ lbs
 $T_{allmetal} = 2086$ lbs $V_{allmetal} = 2192$ lbs
 # of Bolts Req'd for Uplift = 0.62 COMBINED LOADING: 0.216 O.K.
 # of Bolts Req'd for Shear = 0.42 Bolt Spacing = 72.0 in o.c.
 Total # of Bolts Required = 2

1/2" φ A307 Bolts to steel angle below deck @ 72 in o.c. along long side of curb

Longitudinal: # of Bolts Req'd for Uplift = 0.33 COMBINED LOADING: 0.123 O.K.
 # of Bolts Req'd for Shear = 0.42 Req'd Min Spacing = 41.5 in o.c.
 Total # of Bolts Required = 2

1/2" φ A307 Bolts to steel angle below deck @ 41.5 in o.c. along short side of curb



For Concrete anchorage: SEISMIC (0.6-0.14S_{DS})D + 0.7Ω_e, E Ω_o = 2.0

Concrete Attachment: 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed

Epoxy: Hilti HIT-HY 200 V3 (ICC ESR 4868)

f_c = 3000 psi
 h = 4 in (concrete thickness, t_{min} = h_{ef} + 2do) O.K.
 h_{ef} = 2.75 in (effective embedment)
 da = 0.5 in (anchor diameter) do = 0.625 in (hole diameter)
 n = 2 (number of dummy anchors to check capacity with spacing effect)
 s = 16.9 in (initial spacing estimate)
 tk_{cr} / uncr = 1135 2220 psi (from ESR 4868, Table 14, Temp range B)
 tk_{cr} / uncr = 1156 2261 psi If f'_c > 2500, multiply by (f'_c/2500)^{0.1}
 c_{Na} = 7.15 in (min. edge distance for full capacity); c_{Na} = 10d_a√(τ_{uncr}/1100)

Tension:

Bond strength

***Bond strength will govern over concrete breakout

$N_{ag} = \frac{A_{Na}}{A_{Na0}} \phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} N_{ba}$ (ACI318-14, 17.4.5.1b)
 $\phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} = 1.0$
 A_{Na} = 408.98 in²
 A_{Na0} = 204.49 in²
 N_{ba} = 4943 lbs N_{ba} = λ_a τ_{cr} π d_a h_{ef} α_{n,seismic} α_{n,seismic} = 0.99
 N_{ag} = 9886 lbs (group) λ_a = 1.0
 φN_{ag} = 4820 lbs (group) CONTROLS λ_a = 1.0 for normal weight conc; U.b for tight

Breakout strength

$N_{cbg} = \frac{A_{Nc}}{A_{Nco}} \phi_{ec,N} \phi_{ed,N} \phi_{cp,N} N_b$ N_b = λ_a k_c √f'_c h_{ef}^{1.5}
 A_{Nc} = 207.4875 in² N_b = 4246 lbs φ_{conc} = 0.75
 A_{Nco} = 68.0625 in² k_c = 17 φ_{bond} = 0.65
 N_{cbg} = 12945 lbs (group) φ_{seis} = 0.75
 φN_{cbg} = 7281 lbs (group) φ_{steel} = 0.65
 V_{sa,eq} = 4940 (from ESR4868, Table 11) α_{v,seismic} = 0.6
 φV_{sa,eq} = 1927

Shear:

Steel strength

Tall_{LRFD} = 2410 lbs (anchor) Vall_{LRFD} = 3067 lbs α = (1 + 0.2SDS)D + 2.5E
 Tall_{ASD} = Tall_{LRFD}/α = 1411 lbs Vall_{ASD} = Vall_{LRFD}/α = 1796 lbs D = 0.758 E = 0.242 α = 1.709

Transverse: Uplift_{MAX} = 2623 lbs Shear_{MAX} = 1822 lbs

Compression_{SEISMIC} = 3841 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}
 Tension_{SEISMIC} = 2623 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}
 Shear_{SEISMIC} = 1822 lbs = Ω_o*F_{pmaxASD}/2
 Min Bolts Req'd Uplift = 1.86 spacing = 36.00 in o.c. T_{applied} = 1311.5 lbs
 Min Bolts Req'd Shear = 2.00 spacing = 72.00 in o.c. V_{applied} = 455.5 lbs

Try using 2 bolts spaced at 72.00 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.18$ O.K.


Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 72 in o.c. max. along long side of curb w/ 2.75in embed

Longitudinal: Uplift_{MAX} = 1593 lbs Shear_{MAX} = 1822 lbs

Compression_{SEISMIC} = 2811 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}
 Tension_{SEISMIC} = 1593 lbs = [Ω_o*F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}
 Shear_{SEISMIC} = 1822 lbs = Ω_o*F_{pmaxASD}/2
 Min Bolts Req'd Uplift = 1.13 spacing = 20.75 in o.c. T_{applied} = 796.5 lbs
 Min Bolts Req'd Shear = 2.00 spacing = 41.50 in o.c. V_{applied} = 455.5 lbs

Try using 2 bolts spaced at 41.50 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.82$ O.K.

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 41.5 in o.c. max. along short side of curb w/ 2.75in embed

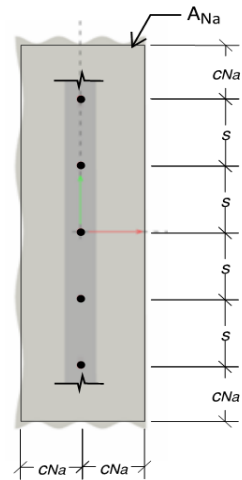

CURB DESIGN SUMMARY:		Unit:
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		ZX, ZL 08-14; XX 08-12; XY/ZY A7;
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		ZY 07-12; XY 07-09
# OF CLIPS (LONG SIDE) - 2 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip		
# OF CLIPS (SHORT SIDE) - 2 clips with 2 - #10 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip		
CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
CURB ANCHORAGE	WOOD	STEEL
	1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	1/2" φ A307 Bolts to steel angle below deck
		CONCRETE
		1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed
LONG DIRECTION	4 @ 25.33 in o.c.	2 @ 72 in o.c.
SHORT DIRECTION	3 @ 22.75 in o.c.	2 @ 41.5 in o.c.