




MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120

619-727-4800

Structural Calculations
for
CBKD Series Roof Curbs
CBKD-163A (80-265-46)
2020 Florida Building Code requirements

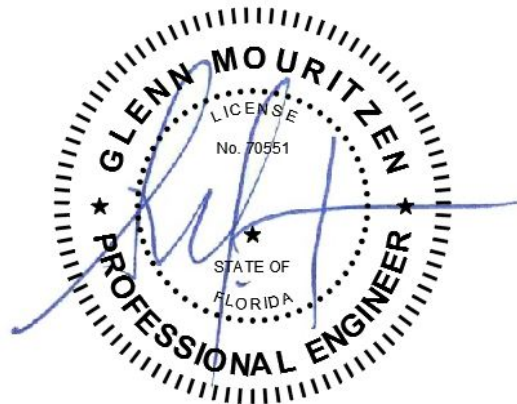


Exp. 02 / 28 / 2023

Prepared for:
PROVENT
3847 Wabash Drive
Mira Loma, CA 91725

Date: May 19, 2021
Project Number: PV2101

STEEL ATTACHMENT

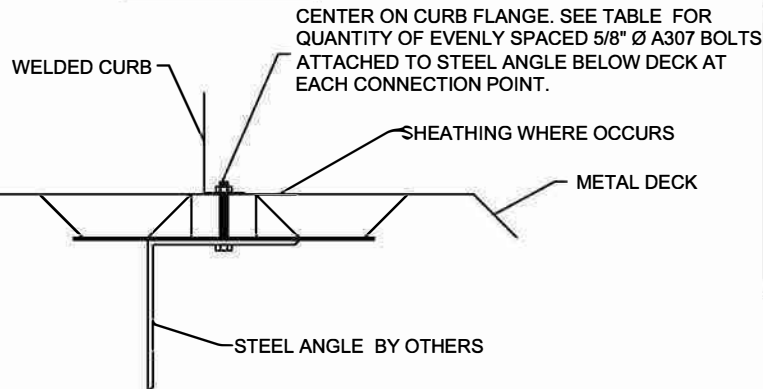


CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE *	
80-265-49	2 @ 34.5" o.c.	2 @ 19" o.c.	LXS
80-265-50	2 @ 34.5" o.c.	2 @ 29" o.c.	LXL
80-265-13	2 @ 61" o.c.	2 @ 25.25" o.c.	SUNLINE 3-6 TON
80-265-45	2 @ 58.38" o.c.	2 @ 28.19" o.c.	PRESTIGE SMALL
80-265-46	2 @ 72" o.c.	2 @ 41" o.c.	PRESTIGE LARGE
80-265-29	3 @ 34.69" o.c.	2 @ 39.5" o.c.	PREDATOR
80-265-19	3 @ 51.63" o.c.	2 @ 72" o.c.	SUNLINE ULTRA
80-265-18	3 @ 57.13" o.c.	2 @ 72" o.c.	SUNLINE MAGNA

WIND LOAD ROOF ANCHORAGE DETAIL

Meets wind requirements for the following codes:
FBC 2020
based on ASCE 7-16.

Wind:
190 mph exposure D category III or IV
building, max BLDG height: 60 ft
Kzt=1.00 max


CONCRETE ATTACHMENT

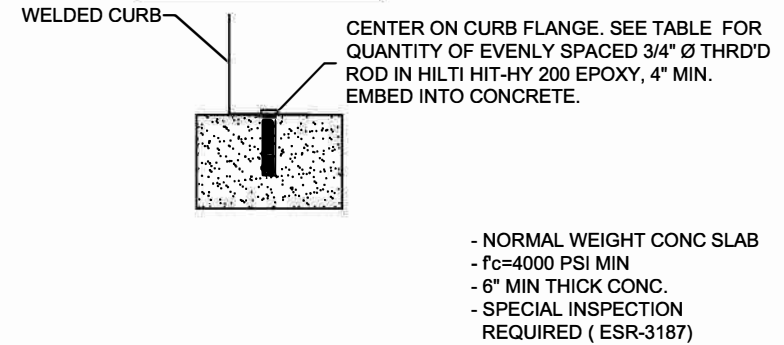

- NORMAL WEIGHT CONC SLAB
- $f_c=4000$ PSI MIN
- 6" MIN THICK CONC.
- SPECIAL INSPECTION REQUIRED (ESR-3187)

CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE **	
80-265-49	5 @ 8.63" o.c.	3 @ 9.5" o.c.	LXS
80-265-50	5 @ 8.63" o.c.	4 @ 9.67" o.c.	LXL
80-265-13	5 @ 15.25" o.c.	3 @ 12.63" o.c.	SUNLINE 3-6 TON
80-265-45	5 @ 14.59" o.c.	3 @ 14.09" o.c.	PRESTIGE SMALL
80-265-46	5 @ 18" o.c.	4 @ 13.67" o.c.	PRESTIGE LARGE
80-265-29	9 @ 8.67" o.c.	5 @ 9.88" o.c.	PREDATOR
80-265-19	8 @ 14.75" o.c.	6 @ 14.4" o.c.	SUNLINE ULTRA
80-265-18	12 @ 10.39" o.c.	8 @ 10.29" o.c.	SUNLINE MAGNA

WOOD ATTACHMENT

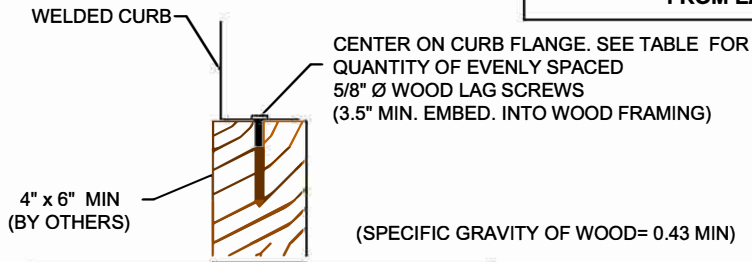


CURB KIT	NO. OF ANCHORAGE SCREWS REQUIRED		UNIT
	LONG SIDE	SHORT SIDE	
80-265-49	6 @ 7.7" o.c.	3 @ 11.5" o.c.	LXS
80-265-50	5 @ 9.63" o.c.	5 @ 8.25" o.c.	LXL
80-265-13	6 @ 13" o.c.	3 @ 14.63" o.c.	SUNLINE 3-6 TON
80-265-45	6 @ 12.48" o.c.	3 @ 16.09" o.c.	PRESTIGE SMALL
80-265-46	6 @ 15.2" o.c.	4 @ 15" o.c.	PRESTIGE LARGE
80-265-29	10 @ 8.15" o.c.	6 @ 8.7" o.c.	PREDATOR
80-265-19	8 @ 15.32" o.c.	6 @ 15.2" o.c.	SUNLINE ULTRA
80-265-18	14 @ 9.1" o.c.	8 @ 10.86" o.c.	SUNLINE MAGNA


FOUR INCHES FROM EACH CORNER EVENLY SPACED.

STEEL AND CONCRETE ANCHORS ARE 6" FROM EACH CORNER EVENLY SPACED

CONCRETE OVER METAL DECK

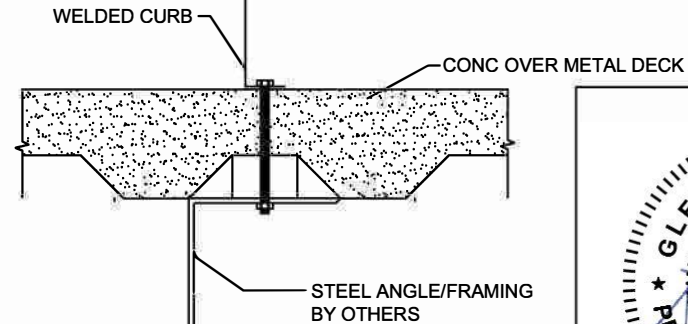

NOTE: FOR CONC OVER METAL DECK OVER STEEL FRAMING USE STEEL ATTACHMENT

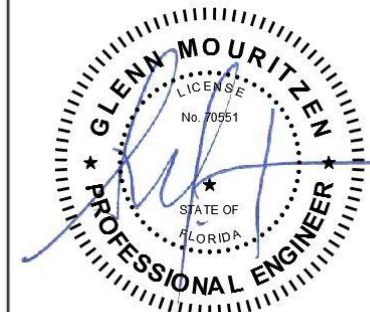

Exp. 02 / 28 / 2023

RRS ROOFTOP SYSTEMS

1625 DIPLOMAT DRIVE
CARROLTON, TX 75006

PHONE (972) 247-7447
FAX (972) 243-0940

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:

CB-25A

DATE:
3/29/2021

REV:
2

DRAWN BY:
ALL

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-25A.

Will conform to wind load code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)


CALCULATED WIND ROOF CURBS FOR YORK UNITS

ZX 08-14; XX 08-12; XY A7; ZY A7
ZY 07-12; XY 07-09; ZL 08-14

ProVent P/N	A	WEIGHT
80-265-4614	14"	136 Lbs
80-265-4618	18"	160 Lbs



Meets wind requirements for the following codes:
FBC 2020
based on ASCE 7-16.

Wind:
190 mph exposure D category III or IV building, max BLDG height: 60 ft
Kzt=1.00 max

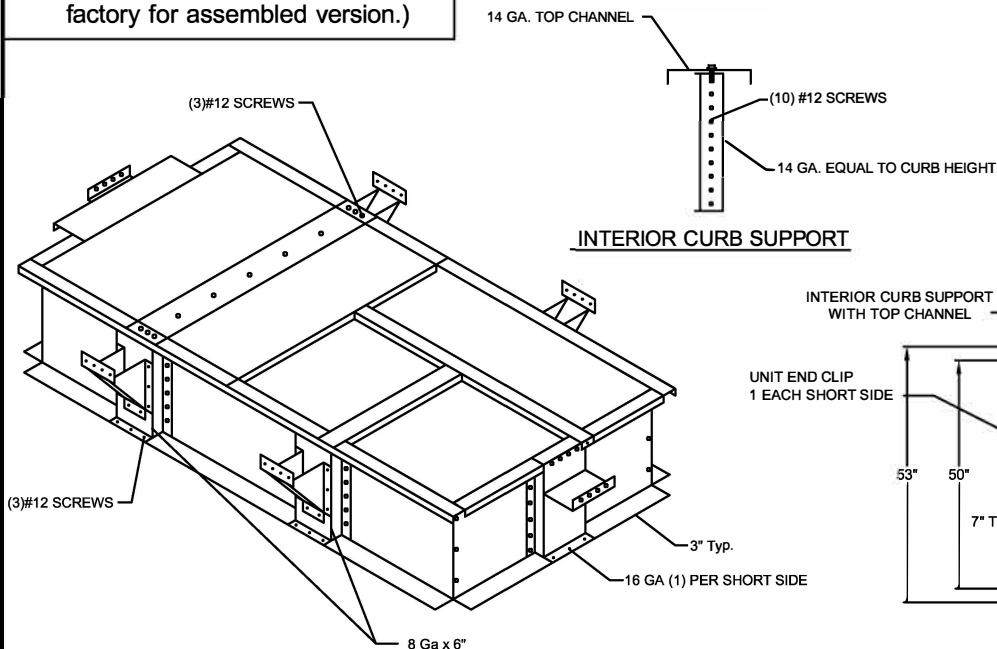


INTERIOR CURB SUPPORT WITH TOP CHANNEL



UNIT END CLIP
1 EACH SHORT SIDE

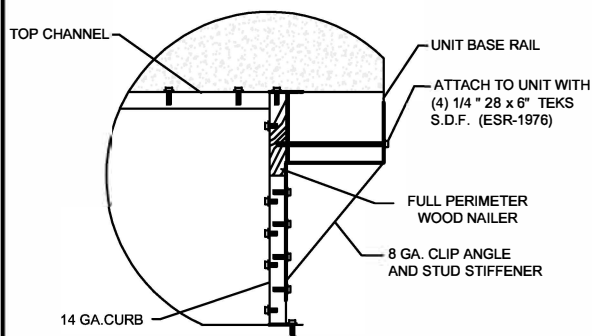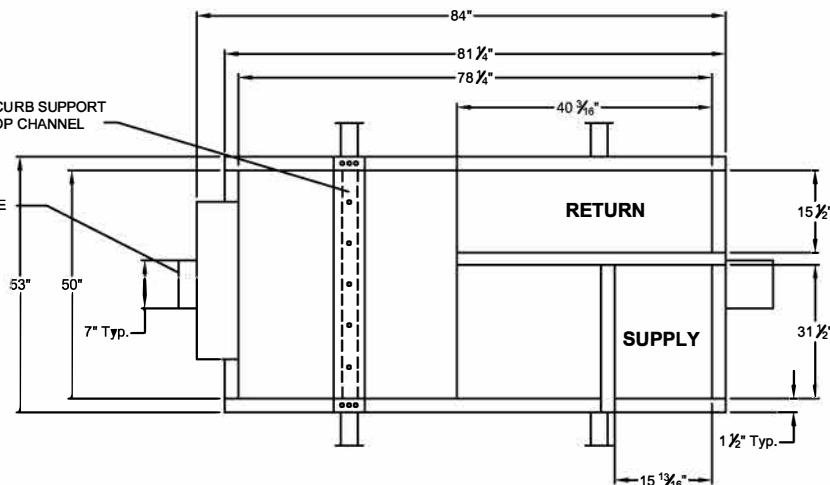

HOLD DOWN DETAIL

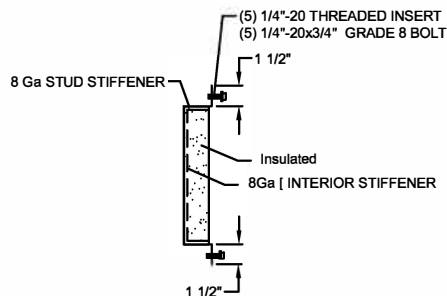

STUD STIFFENER

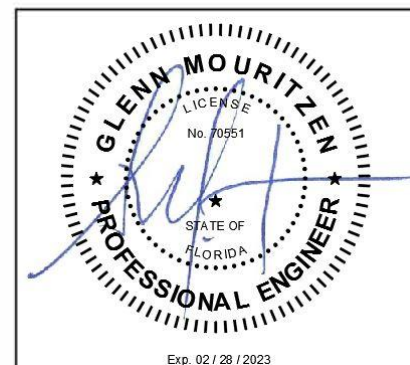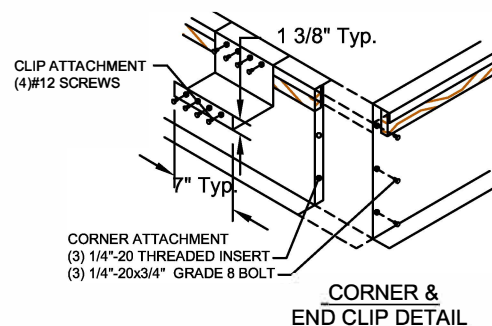

RRS ROOFTOP
SYSTEMS

1625 DIPLOMAT DRIVE
CARROLTON, TX 75006

PHONE (972) 247-7447
FAX (972) 243-0940

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBKD-163A

DATE:
3/29/2021

REV:
3

PART NUMBER:
80-265-46

DRAWN BY:
ALL




Client:	ProVent PV2101	Previous:	PV1807
Description:	CBKD-163	80-265-46**	
Unit:	ZX 08-14; XX 08-12; ZY 07-12; XY 07-09		

Curb Information

Hcurb =	18	in	(Height of curb)
Lcurb =	84	in	(Length of curb)
wcurb =	53	in	(Width of curb)
WGTcurb =	160	lbs	(Weight of curb)
# Clips long side =	2		
# Clips short side =	1		

Unit Information

WGTunit =	1008	lbs	(Weight of Unit)
Wtmax =	213	lbs	(Maximum corner weight)
Wtmin =	154	lbs	(Minimum corner weight)
Hunit =	40.56	in	(Height of unit above curb)
Hcm =	20.28	in	(Height to center of mass)
Lunit =	87.1875	in	(Length of unit)
Wunit =	61.69	in	(Width of unit)

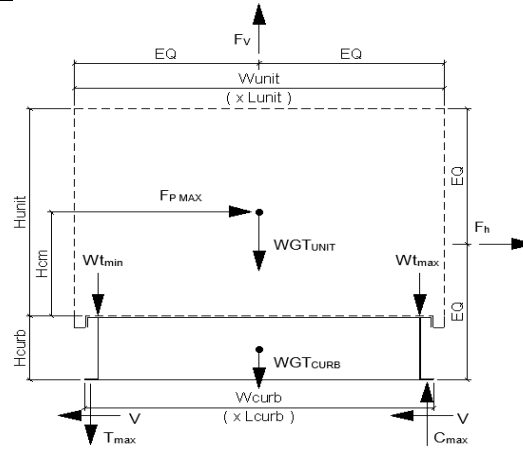

Seismic Loading - 2020 FBC/2018 IBC

Ss =	0.15	(Worst Case for state of Florida)
Fa =	2.4	(Worst case Site class E from Table 11.4-1 ASCE 7-16)
Sms =	0.360	(Fa*Ss)
Sds =	0.240	(2/3*Sms)
Ip =	1.5	(Importance Factor Category III or IV Building)
Fpmax =	0.576 WGTunit	(1.6*Sds*Ip)*WGTunit (Eq 13.3-2 ASCE 7-16)
FpmaxASD =	406 lbs	(0.7*Fpmax)
	(unit only)	
FpmaxASD =	471 lbs	(unit and curb)

Wind Loading - 2020 FBC/2018 IBC

Kz =	1.31	*** Exposure Category D ***
Kzt =	1.00	(For 60 ft roof height, Exposure D - Table 26.10-1 ACSE 7-16)
Kd =	0.85	(Max. assumed topographic factor)
Ke =	1.00	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	190	(Ground Elevation Factor Table 26.9-1 ASCE 7-16)
GCr(horiz) =	1.9	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 26.5-1D - ASCE7-16)
GCr(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	102.9	psf
Fh ASD trans =	4159	lbs
Fh ASD long =	2943	lbs
Fvert ASD =	3459	lbs

Curb Loading

Transverse:		
Compression _{SEISMIC} =	596 lbs	= [FpmaxASD*Hcm+2*(1+0.14S _{DS})*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	25 lbs	= Comp _{SEISMIC} - (0.6-0.14S _{DS})*WGTunit
Compression _{WIND} =	118 lbs	= [F _{h transASD} *Hcm+2*0.6*Wtmax*wcurb-F _{vertASD} *wcurb/2]/wcurb
Tension _{WIND} =	2972 lbs	= Comp _{WIND} +F _{vert} -0.6*WGTunit
---> Negative values indicate opposite load.		
Longitudinal:		
Compression _{SEISMIC} =	538 lbs	= [FpmaxASD*Hcm+2*(1+0.14*S _{DS})*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	-32 lbs	= Comp _{SEISMIC} - (0.6-0.14S _{DS})*WGTunit
Compression _{WIND} =	-764 lbs	= [F _{h transASD} *Hcm+2*0.6*Wtmax*Lcurb-F _{vertASD} *Lcurb/2]/Lcurb
Tension _{WIND} =	2091 lbs	= Comp _{WIND} +F _{vert} -0.6*WGTunit
---> Negative values indicate opposite load.		

Governing Reactions:

Transverse:	Comp _{MAX} =	596	lbs	---> Along long edge of curb.
(on long edge)	Tens _{MAX} =	2972	lbs	---> Along long edge of curb.
Longitudinal:	Comp _{MAX} =	538	lbs	---> Along short edge of curb.
(on short edge)	Tens _{MAX} =	2091	lbs	---> Along short edge of curb.
---> Negative values indicate opposite load.				




Curb Design

F_y = 50 ksi F_u = 65 ksi t = 0.0713 14 Gauge
E = 29500 ksi

Calculate Section Properties of Curb

A' = 18.000 in	a = 17.644 in = A' - (2r + t)
B' = 1.500 in	a' = 17.929 in = A' - t
C' = 0.000 in (0 if no lips)	b = 1.322 in = B' - [r + t/2 + a(r + t/2)]
a = 0.000 in (0 - no Lip; 1 w/ lip)	b' = 1.464 in = B' - [t/2 + at/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = a[C' - (r + t/2)]
t = 0.0713 in	c' = 0.000 in = a(C' - t/2)
r' = 0.143 in = R + t/2	u = 0.224 in = πr/2
x = 0.104 in (Distance between centroid and web centerline)	
I _x = 50.343 in (Moment of Inertia about X-Axis)	
I _y = 0.133 in (Moment of Inertia about Y-Axis)	
A = 1.48 in ²	
r _x = 5.84 in	
r _y = 0.300 in	
r _{min} = 0.300 in	

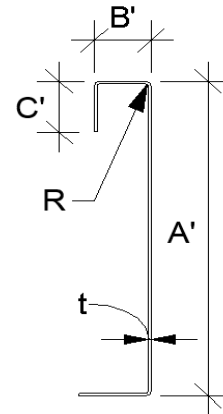

Axial Compression

P _u = 2.080 k	(Max Axial Comp)	Ω _c = 1.80
P _n /Ω _c = 6.999 k		
F _e = 9.72 ksi	$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$	$\lambda_c = \sqrt{\frac{F_y}{F_e}}$
λ _c = 2.27	If λ _c ≤ 1.5; F _n = (0.658λ _c ²) F _y	F _e = $\frac{\pi^2 E}{(kl/r)^2}$
F _n = 8.52 ksi	If λ _c > 1.5; F _n = $\frac{0.877}{\lambda_c^2} F_y$	
L _y = 65 in	Lateral unbraced length	
k _y L _y /r _y = 173	(assume k=0.8)	

Compression Check = **O.K.**

Check Web Crippling

h = 18 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 252.45 ≤ 200	C _R = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.388889 ≤ 2.0	C _h = 0.02	
P _n = 2.296 k	R/t = 1.50 ≤ 9.0		
P _n /Ω _w = 1.312 k			
Long side: P _{u trans} = 0.298 k	O.K. # clips = 2	$P_n = C t^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$	
Short side: P _{u Long} = 0.538 k	O.K. # clips = 1		

***h/t > 200; use web stiffeners

Check Web Stiffener

16Ga x 3/4" x 7" [C-channel]

width of stiffener = 7.000 in	ts = 0.0566 16 Gauge
web of stiff. w = 6.717 in	Rs = 0.0849 in
***Check w/ts ≤ 1.28√E/F _y	Ω _c = 1.70
w/ts = 118.675	
1.28√E/F _y = 31.091	--> w/ts over limit Use C3.7.2
P _n = 0.7(P _{wc} + A _e F _y) ≥ P _{wc}	
P _{wc} = 2.296 k	A _e = 0.380 in ²
P _n = 14.913 k	P _n /Ω = 8.773 k

O.K.

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T _{crn max} = 1040 lbs	Max(F _{p max ASD} /4 - OR - F _{h ASD trans} /4 corner connections)
V _{crn max} = 1486 lbs	(Max Ten/2 corner connections per side)
Bolt: Tall = 2480 lbs	Vall = 1096 lbs
Threaded Insert: Tall = 2860 lbs	Vall = 1714 lbs
# of Bolts required for Tension = 0.4	
# of Bolts required for Shear = 1.4	
# of Bolts Used = 2.0	***If combined fails: USE --> 3.0
Check Combined Stress in Bolts & Inserts: 0.888 O.K.	StressComb = 0.592 O.K.

Check 1/8" welded connection

<--- USE WELD Ω = 2.35

Assume L/t > 25: 25*t = 1.783 in	$P_n/\Omega = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$	$L_{req} d = \frac{V_{req} \Omega}{0.75 t F_u}$
L _{req} d = 1.005 in		



Connection Unit to Curb Clip

#12 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$ in

$F_u1 = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_u2 = 65$ ksi

$d = 0.216$ in (screw diameter)

$d_w = 0.375$ in (nom. washer diameter)

$t_2/t_1 = 1.4$

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$

$P_{ns} = 2703$ #

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2703$ #

$P_{ns} = 2.7t_1dF_{u1}$ 2.70 k

$P_{ns} = 2.7t_1dF_{u1}$ 2.70 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.86 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.86 k

$P_{ns}/\Omega = 901$ #

$P_{ss}/\Omega = 840$ # <- Controls

Tension: $P_{not} = 1.214$ k (screw pull-out strength)

$P_{not} = 0.85t_c dF_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 2.607$ k (screw pull-over strength)

$P_{nov} = 1.5t_1d_wF_{u1}$

$P_{ts}/\Omega = 405$ # <- Controls

$P_{ts}/\Omega = 845$ #

(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	1.472	2	0.74	840 #	2	6.00 in
Short side:	2.080	1	2.08	840 #	3	3.00 in

clip width (in) = 7.00

clip height = 2.5 in

min spacing = 0.65 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$ ksi

$\Omega = 2.22$ bolt/screw connection

$A_{gv} = 0.463$ in²

$A_{nv} = 0.425$ in²


$A_{nt} = 0.081$ in²

$R_n/\Omega = 8.647$ k

$R_n = 0.6F_yA_{gv} + F_uA_{nt} \leq 0.6F_uA_{nv} + F_uA_{nt}$

(AISI Sect. E5.3)

BSR O.K.

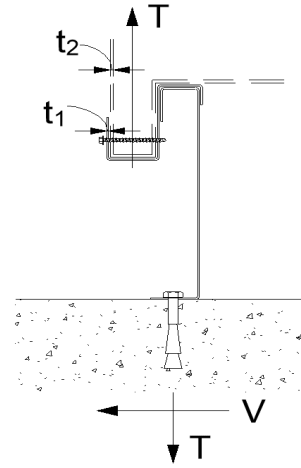

Connection of Curb to Supporting Structure

Roof Loading: SEISMIC: (0.6-0.14SDS)D + 0.7E

WIND: 0.6D + W

Transverse:	Uplift _{MAX} =	4383 lbs	Shear _{MAX} =	2080 lbs
Compression _{SEISMIC} =	944 lbs	= [F _{pmaxASD} *(H _{cm} +H _{curb})+{1+0.14S _{DS} }*(WGT _{unit+curb} /2)*w _{curb}]/w _{curb}		
Tension _{SEISMIC} =	282 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*(WGT _{unit+curb})		
Compression _{WIND} =	1625 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})+0.6*(WGT _{unit+curb} /2)*w _{curb} -F _{vertASD} *w _{curb}]/2]/w _{curb}		
Tension _{WIND} =	4383 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})-0.6*(WGT _{unit+curb} /2)*w _{curb} +F _{vertASD} *w _{curb}]/2]/w _{curb}		
Longitudinal:	Uplift _{MAX} =	2720 lbs	Shear _{MAX} =	1472 lbs
Compression _{SEISMIC} =	818 lbs	= [F _{pmaxASD} *(H _{cm} +H _{curb})+{1+0.14S _{DS} }*(WGT _{unit+curb} /2)*L _{curb}]/L _{curb}		
Tension _{SEISMIC} =	157 lbs	= Comp _{SEISMIC} -(0.6-0.14S _{DS})*(WGT _{unit+curb})		
Compression _{WIND} =	-38 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})+0.6*(WGT _{unit+curb} /2)*L _{curb} -F _{vertASD} *L _{curb}]/2]/L _{curb}		
Tension _{WIND} =	2720 lbs	= [F _{htransASD} *(H _{cm} +H _{curb})-0.6*(WGT _{unit+curb} /2)*L _{curb} +F _{vertASD} *L _{curb}]/2]/L _{curb}		

Wood Attachment: Use 5/8" ϕ wood lag screws w/ 3.5" Min. Embed

Tall_{metal} = 946.67 lbs

Vall_{metal} = 1043.33 lbs

Transverse: Tall_{wood} = 1195.95 lbs

Vall_{wood} = 1024 lbs

of Screws Req'd for Uplift = 4.63

COMBINED LOADING: 0.975 O.K.

of Screws Req'd for Shear = 2.03

Screw Spacing = 15.2 in o.c.

Total # of screws Required = 6

Use 5/8" ϕ wood lag screws @ 15.2 in o.c. along long side of curb

Longitudinal:

of Screws Req'd for Uplift = 2.9

COMBINED LOADING: 0.862 O.K.

of Screws Req'd for Shear = 1.4

Screw Spacing = 15.0 in o.c.

Total # of screws Required = 4

Use 5/8" ϕ wood lag screws @ 15 in o.c. along short side of curb

Steel Deck Attachment: Use 5/8" ϕ A307 Bolts attached to steel angle below deck

Tall_{bolt} = 6903 lbs

Vall_{bolt} = 3682 lbs

Transverse: Tall_{bolt} = 6903 lbs

Vall_{bolt} = 3682 lbs

of Bolts Req'd for Uplift = 0.64

COMBINED LOADING: 0.269 O.K.

of Bolts Req'd for Shear = 0.56

Bolt Spacing = 72.0 in o.c.

Total # of Bolts Required = 2

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 72 in o.c. along long side of curb

Longitudinal:

of Bolts Req'd for Uplift = 0.39

COMBINED LOADING: 0.135 O.K.

of Bolts Req'd for Shear = 0.40

Req'd Min Spacing = 41.0 in o.c.

Total # of Bolts Required = 2

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 41 in o.c. along short side of curb



MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
(619)727-4800
Page 4 of 4

For Concrete anchorage: SEISMIC (0.6-0.14SDS)D + 0.7Ω_oE (Ω_o = 2.5)

Concrete Attachment: 3/4" φ Hilti Hit-HY 200 adhesive anchors w/ 4" embed

$$T_{all,LRFD} = 1722 \text{ lbs} \quad V_{all,LRFD} = 2032 \text{ lbs} \quad \alpha = (1 + 0.2SDS)D + 2.5E = 1.87$$

$$T_{all,ASD} = T_{all,LRFD}/\alpha = 920.9 \text{ lbs} \quad V_{all,ASD} = V_{all,LRFD}/\alpha = 1086.6 \text{ lbs} \quad (D = 0.465, E = 0.535)$$

Transverse:	Uplift_{MAX} =	4383 lbs	Shear_{MAX} =	2080 lbs
--------------------	-------------------------------	-----------------	------------------------------	-----------------

$$\text{Compression}_{SEISMIC} = 1454 \text{ lbs} = [2.5 * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * (WGT_{unit+curb}/2) * w_{curb}] / w_{curb}$$

$$\text{Tension}_{SEISMIC} = 792 \text{ lbs} = \text{Comp}_{SEISMIC} - [0.6 - 0.14S_{DS}] * (WGT_{unit+curb})$$

$$\text{Shear}_{SEISMIC} = 589 \text{ lbs} = 2.5 * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 4.76 \text{ spacing} = 15.00 \text{ in o.c.} \quad T_{applied} = 876.7 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 60 \text{ in o.c.} \quad V_{applied} = 231.1 \text{ lbs}$$

Try using 5 bolts spaced at 18.00 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.16$
--	--

Use 5 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 18 in o.c. max. along long side of curb w/ 4" embed

Longitudinal:	Uplift_{MAX} =	2720 lbs	Shear_{MAX} =	2080 lbs
----------------------	-------------------------------	-----------------	------------------------------	-----------------

$$\text{Compression}_{SEISMIC} = 1140 \text{ lbs} = [2.5 * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * (WGT_{unit+curb}/2) * L_{curb}] / L_{curb}$$

$$\text{Tension}_{SEISMIC} = 479 \text{ lbs} = \text{Comp}_{SEISMIC} - [0.6 - 0.14S_{DS}] * (WGT_{unit+curb})$$

$$\text{Shear}_{SEISMIC} = 589 \text{ lbs} = 2.5 * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 2.95 \text{ spacing} = 14.5 \text{ in o.c.} \quad T_{applied} = 680.1 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 29 \text{ in o.c.} \quad V_{applied} = 231.1 \text{ lbs}$$

Try using 4 bolts spaced at 13.67 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.95$
--	--

Use 4 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 13.7 in o.c. max. along short side of curb w/ 4" embed

CURB DESIGN SUMMARY: CBKD-163 80-265-46**		Unit: ZX 08-14; XX 08-12; ZY 07-12; XY 07-09
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		
# OF CLIPS (LONG SIDE) - 2 clips with 2 - #12 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip		
# OF CLIPS (SHORT SIDE) - 1 clips with 3 - #12 SMS screws each clip		
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip		
CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
CURB ANCHORAGE	WOOD 5/8" φ lag screw w/ min. 3.5" embed (SGmin=0.43)	STEEL 5/8" φ A307 bolts to steel angle below
		CONCRETE 3/4" φ thr'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
LONG DIRECTION	6 @ 15.2 in o.c.	2 @ 72 in o.c.
SHORT DIRECTION	4 @ 15 in o.c.	2 @ 41 in o.c.
		5 @ 18 in o.c.
		4 @ 13.67 in o.c.