



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBWC-119 Series
CBWCLXL SERIES**



Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: September 25, 2023

Project Number: PV2312

For wood, concrete, and steel attachments, see Roof Anchorage Detail, Form No. CB-60.

FEATURES

- Roof curb sides and ends are 16 Ga. galvanized steel.
- Gasketing package provided.
- Heat treated wood nailer provided.
- Insulated deck pans provided.
- Pitched curbs and taller curbs are available.

NOTES




- Attach ductwork to roof curb. Flanges of duct rest on top of curb. Support ductwork below the curb.
- Thru the curbs utilities are available. Contact your York distributor or ProVent directly.

STRUCTURALLY CALCULATED WELDED ROOF CURBS FOR LX SERIES LARGE CHASSIS UNITS


P***B ALL MODELS

PROVENT P/N	A	EST. WEIGHT
CBWCLXL08	8"	74 Lbs.
CBWCLXL11	11"	85 Lbs.
CBWCLXL14	14"	97 Lbs.
CBWCLXL24	24"	171 Lbs.


Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

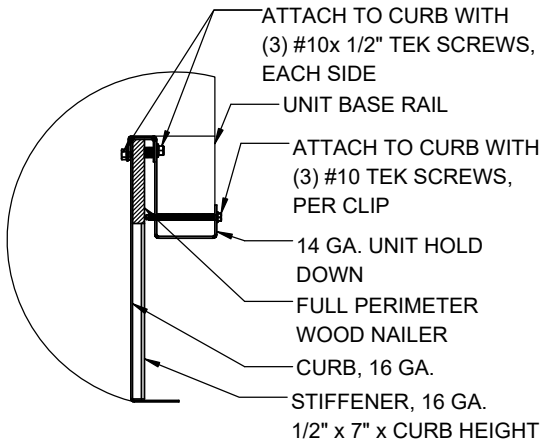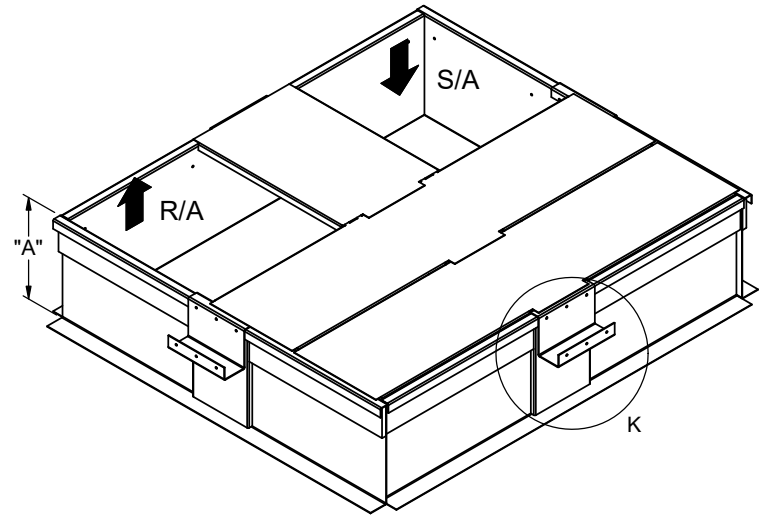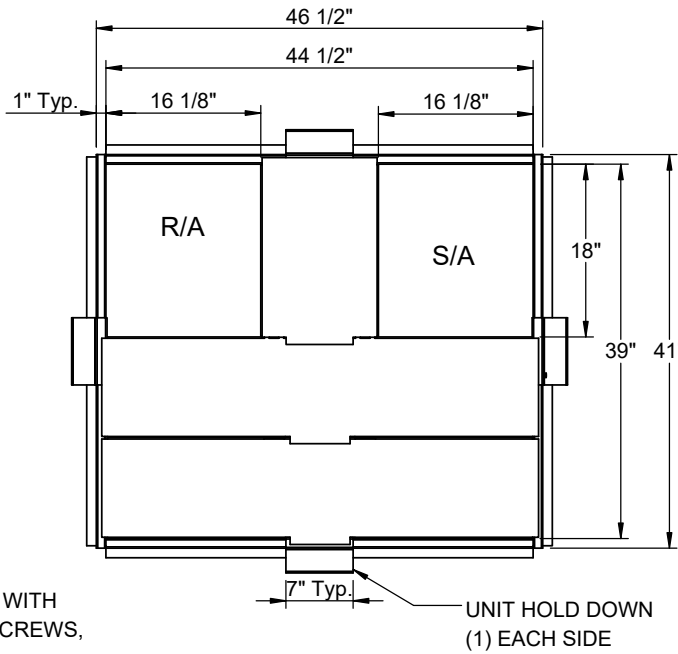

HOLD DOWN DETAIL

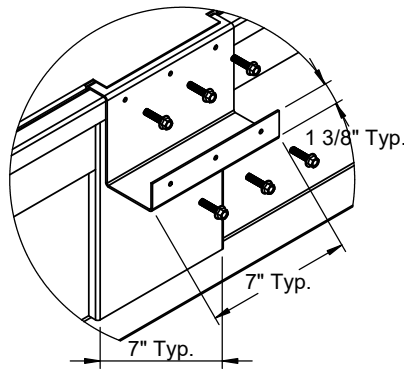

DETAIL K

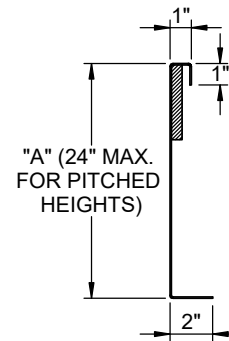

CURB DETAIL



3847 WABASH DR.
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBWC-119

PART NUMBER:
CBWCLXL SERIES


DATE:
7/24/2023

REV:
7

DRAWN BY:
JG

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

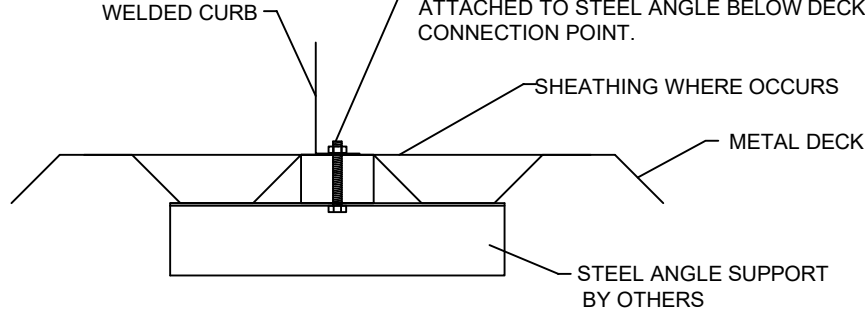

NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SAV1518	3 @ 54.56" O.C.	2 @ 68.13" O.C.
SAV2025	3 @ 61.56" O.C.	2 @ 68.13" O.C.
SAV28	3 @ 69.75" O.C.	2 @ 68.13" O.C.

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

ASSUMES:


CONC SLAB
f_c= 4000PSI MINIMUM
4" MIN THICKNESS
NORMAL WEIGHT CONCRETE
MIN. 7-1/4" EDGE DISTANCE

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

ROOF ANCHORAGE DETAIL

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SAV1518	SAV1518
SAV2025	SAV2025
SAV28	SAV28


CONCRETE ATTACHMENT



NO. OF ANCHORAGE BOLTS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19.0" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 24.75" O.C.
PRD3715	4 @ 22.96" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	3 @ 36" O.C.	2 @ 41.5" O.C.
SAV1518	4 @ 36.38" O.C.	2 @ 68.13" O.C.
SAV2025	4 @ 41.04" O.C.	3 @ 34.06" O.C.
SAV28	5 @ 34.88" O.C.	3 @ 34.06" O.C.

WOOD ATTACHMENT

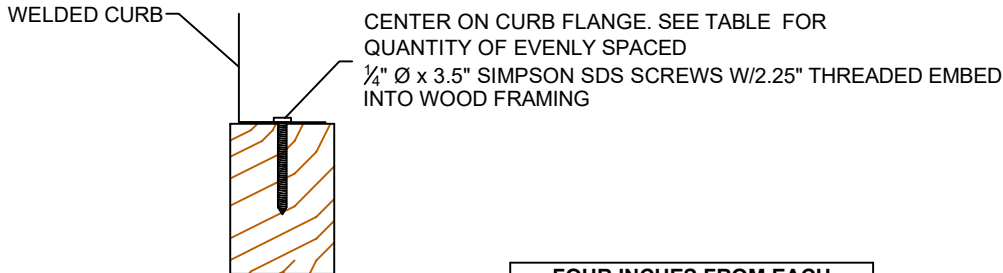

FOUR INCHES FROM EACH CORNER EVENLY SPACED

NO. OF ANCHORAGE SCREWS REQUIRED

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	7 @ 12.15" O.C.	5 @ 10.75" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.35" O.C.
PRL	6 @ 15.2" O.C.	4 @ 15.17" O.C.
SAV1518	6 @ 22.63" O.C.	5 @ 18.03" O.C.
SAV2025	7 @ 21.19" O.C.	5 @ 18.03" O.C.
SAV28	8 @ 20.5" O.C.	5 @ 18.03" O.C.



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
8/28/2023

REV:
10

DRAWN BY:
FMM




Client:	ProVent	PV2312
Description:	CBWC-119	LXL
Unit:	ALL P***B MODELS	

Curb Information

Hcurb =	24	in	(Height of curb)
Lcurb =	46.5	in	(Length of curb)
wcurb =	41	in	(Width of curb)
WGTCurb =	171	lbs	(Weight of curb)
# Clips long side =	1		
# Clips short side =	1		

Unit Information

WGTunit =	656	lbs	(Oper. Weight of Unit)
Wtmax =	180	lbs	(Maximum corner weight)
Wtmin =	139	lbs	(Minimum corner weight)
Hunit =	55	in	(Height of unit above curb)
Hcm =	27.5	in	(Height to center of mass)
Lunit =	51.25	in	(Length of unit)
Wunit =	45.75	in	(Width of unit)

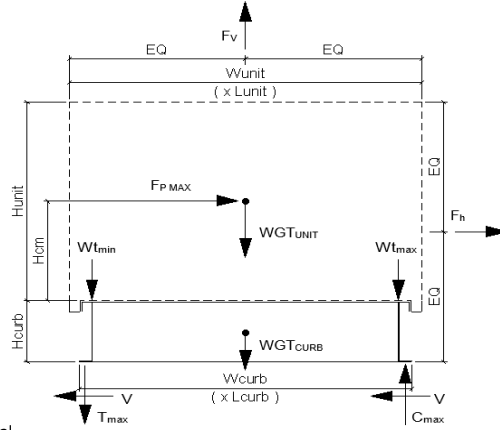

Seismic Loading - 2021 IBC/2022 CBC

Ss =	2.85	(Worst case for majority of California)
Fa =	1.20	(Default Site Class D - Table 11.4-1 ASCE 7-16)
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	785 lbs	(0.7*Fpmax)
	(unit only)	
		ap = 2.5
		Rp = 6
		FpmaxASD = 990 lbs
		(unit and curb)

Wind Loading - 2021 IBC/2022 CBC

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ACSE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 25.5-1D, ASCE7-16)
GCr _(horiz) =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr _(vert) =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16)
F _{h ASD trans} =	1042 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
F _{h ASD long} =	930 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
F _{vert ASD} =	477 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

Curb Loading

Transverse:

Compression _{SEISMIC} =	1003 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*wcurb]/wcurb
Tension _{SEISMIC} =	448 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*wcurb]/wcurb
Compression _{WIND} =	677 lbs	= [F _{h ASD trans} *Hcm + 2*0.6*Wtmax*wcurb - F _{vert ASD} *wcurb/2]/wcurb
Tension _{WIND} =	770 lbs	= [F _{h ASD trans} *Hcm - 2*0.6*Wtmin*wcurb + F _{vert ASD} *wcurb/2]/wcurb

---> Negative values indicate opposite load.

Longitudinal:

Compression _{SEISMIC} =	940 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*Lcurb]/Lcurb
Tension _{SEISMIC} =	386 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*Lcurb]/Lcurb
Compression _{WIND} =	528 lbs	= [F _{h ASD long} *Hcm + 2*0.6*Wtmax*Lcurb - F _{vert ASD} *Lcurb/2]/Lcurb
Tension _{WIND} =	621 lbs	= [F _{h ASD long} *Hcm - 2*0.6*Wtmin*Lcurb + F _{vert ASD} *Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

Governing Reactions:

Transverse: (on long edge)	Comp _{MAX} =	1003	lbs	---> Along long edge of curb.
	Tens _{MAX} =	770	lbs	---> Along long edge of curb.
Longitudinal: (on short edge)	Comp _{MAX} =	940	lbs	---> Along short edge of curb.
	Tens _{MAX} =	621	lbs	---> Along short edge of curb.


---> Negative values indicate opposite load.

Curb Design

F_y = 50 ksi F_u = 65 ksi
E = 29500 ksi t = 0.0566 **16 Gauge**

Calculate Section Properties of Curb

A' = 24.000 in	a = 23.717 in = A' - (2r+t)
B' = 1.000 in	a' = 23.943 in = A' - t
C' = 0.000 in (0 if no lips)	b = 0.859 in = B' - [r+t/2+α(r+t/2)]
α = 0.000 (0 - no Lip; 1 w/ lip)	b' = 0.972 in = B' - (t/2+αt/2)
R = 0.0849 (Inside bend radius)	c = 0.000 in = α(C' - (r+t/2))
t = 0.0566 in	c' = 0.000 in = α(C' - t/2)
r' = 0.113 in = R+t/2	u = 0.178 in = πr/2
x = 0.037 in (Distance between centroid and web centerline)	
I _x = 79.767 in ⁴	r _x = 7.39 in
I _y = 0.033 in ⁴	r _y = 0.150 in
A = 1.46 in ²	r _{min} = 0.150 in

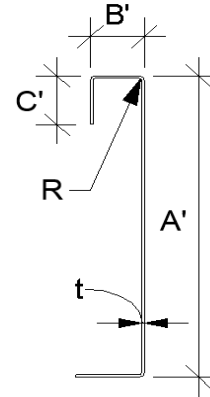

Axial Compression

P_u = 0.521 k (Max Axial Comp) Ω_c = 1.80
P_n/Ω_c = 3.656 k
F_e = 5.14 ksi $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c ≤ 1.5; F_n = (0.658λ_c²) F_y
λ_c = 3.12 $\Omega_c = \frac{F_y}{F_e}$ If λ_c > 1.5; F_n = $\frac{0.877}{\lambda_c^2} F_y$ λ_c = $\sqrt{\frac{F_y}{F_e}}$ F_e = $\frac{\pi^2 E}{(kl/r)^2}$
F_n = 4.51 ksi
L_y = 45 in Lateral unbraced length
k_yL_y/r_y = 238 (assume k=0.8)

Compression Check = O.K.

Check Web Crippling

h = 24 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0566 in	h/t = 424.03 ≤ 260	C _R = 0.14	
N = 7.00	N/t = 123.67 ≤ 210	C _N = 0.35	
Ω _w = 1.75	N/h = 0.291667 ≤ 2.0	C _h = 0.02	
P _n = 1.366 k	R/t = 1.50 ≤ 9.0		

P_n/Ω_w = 0.780 k P_n = C t² F_y sin(90) (1 - C_R √(R/t)) (1 + C_N √(N/t)) (1 - C_h √(h/t))
Long side: P_uTrans = 1.003 k **web stiffener REQ'D** # clips = 1
Short side: P_uLong = 0.940 k **web stiffener REQ'D** # clips = 1

***h/t > 260; use web stiffeners

Check Web Stiffener

16Ga x 3/4" x 6" (C-channel)
width of stiffener = 6.000 in t_s = 0.0566 **16 Gauge**
web of stiff. w = 5.717 in R_s = 0.0849 in
***Check w/ts ≤ 1.28√E/F_y Ω_c = 1.70
w/ts = 101.007
1.28√(E/F_y) = 31.091 --> w/ts over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc}
P_{wc} = 1.366 k A_e = 0.324 in²
P_n = 12.281 k P_n/Ω = 7.224 k

O.K.

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T_{crn}max = 261 lbs Max(F_pmaxASD/4 -OR- F_hASDtrans/4 corner connections)
V_{crn}max = 501 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.1
of Bolts required for Shear = 0.4
of Bolts Used = 3.0
Check Combined Stress in Bolts & Inserts: 0.173 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.415 in P_n/Ω = $\frac{1}{\Omega} 0.75tLF_u \geq V_{req}$ L_{req'd} = $\frac{V_{req}\Omega}{0.75tF_u}$
L_{req'd} = 0.427 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0566$ in
 $t_2 = 0.1017$ in (unit base rail thickness)
 $d = 0.190$ in (screw diameter)
 $t_2/t_1 = 1.8$

$Fu_1 = 65$ ksi
 $Fu_2 = 65$ ksi
 $dw = 0.375$ in (nom. washer diameter)

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ Pns = 1887 #
 $P_{ns} = 2.7t_1dF_{u1}$ 3.86 k
 $P_{ns} = 2.7t_2dF_{u2}$ 1.89 k
 3.39 k

For $t_2/t_1 \geq 2.5$:

Pns = 1887 #
 $P_{ns} = 2.7t_1dF_{u1}$ 1.89 k
 $P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

Tension:

$P_{not} = 1.068$ k (screw pull-out strength)
 $P_{nov} = 2.069$ k (screw pull-over strength)
 $P_{ts}/\Omega = 356$ # <- Controls
 $P_{ts}/\Omega = 820$ # (full tensile screw capacity)

$P_{not} = 0.85t_c dF_{u2}$
 $t_c = \min(t_1, t_2)$
 $P_{nov} = 1.5t_1d_wF_{u1}$

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	1.042	1	1.04	540 #	2	6.00 in
Short side:	0.930	1	0.93	540 #	2	6.00 in
clip width (in) =	7.00		clip height =	1.4 in		
min spacing =	0.57 in		edge distance =	0.5 in (min. 1.5d)		


Check Block shear rupture:

O.K.
 $F_y = 50$ ksi
 $A_{gv} = 0.368$ in²
 $R_n/\Omega = 5.954$ k

$\Omega = 2.22$ bolt/screw connection
 $A_{nv} = 0.352$ in²
 $A_{nt} = 0.034$ in²

$R_n = 0.6F_yA_{gv} + F_uA_{nt} \leq 0.6F_uA_{nv} + F_uA_{nt}$
 (AISI Sect. E5.3)

BSR O.K.

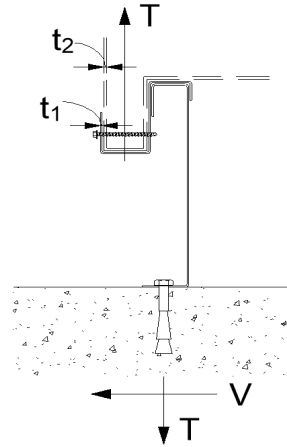

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

	Uplift _{MAX}	Shear _{MAX}
Transverse:	1299 lbs	521 lbs
Compression _{SEISMIC}	1789 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension _{SEISMIC}	1127 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression _{WIND}	1319 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vertASD} * w_{curb}/2] / w_{curb}$
Tension _{WIND}	1299 lbs	$= [F_{hASDtrans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vertASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	1021 lbs	495 lbs
Compression _{SEISMIC}	1642 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension _{SEISMIC}	980 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression _{WIND}	1040 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vertASD} * L_{curb}/2] / L_{curb}$
Tension _{WIND}	1021 lbs	$= [F_{hASDlong} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vertASD} * L_{curb}/2] / L_{curb}$

Wood Attachment: **1/4" ϕ x 3.5" Simpson SDS screws w/ 2.25" threaded emb (SGmin = 0.43)**

Transverse:	$T_{allmetal} = 797$ lbs	$V_{allmetal} = 876$ lbs
	$T_{allwood} = 616$ lbs	$V_{allwood} = 400$ lbs
# of Screws Req'd for Uplift =	2.11	COMBINED LOADING: 0.853 O.K.
# of Screws Req'd for Shear =	1.30	Screw Spacing = 12.8 in o.c.
Total # of screws Required =	4	

1/4" ϕ x 3.5" Simpson SDS screws @ 12.8 in o.c. along long side of curb w/ 2.25" threaded embed

Longitudinal:	# of Screws Req'd for Uplift = 1.7	COMBINED LOADING: 0.965 O.K.
	# of Screws Req'd for Shear = 1.2	Screw Spacing = 16.5 in o.c.
Total # of screws Required =	3	

1/4" ϕ x 3.5" Simpson SDS screws @ 16.5 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment:

1/2" ϕ A307 Bolts to steel angle below deck

Transverse:	$T_{bolt} = 3927$ lbs	$V_{bolt} = 2209$ lbs
	$T_{metal} = 1656$ lbs	$V_{metal} = 1756$ lbs
# of Bolts Req'd for Uplift =	0.78	COMBINED LOADING: 0.252 O.K.
# of Bolts Req'd for Shear =	0.30	Bolt Spacing = 34.5 in o.c.
Total # of Bolts Required =	2	

1/2" ϕ A307 Bolts to steel angle below deck @ 34.5 in o.c. along long side of curb

Longitudinal:	# of Bolts Req'd for Uplift = 0.62	COMBINED LOADING: 0.179 O.K.
	# of Bolts Req'd for Shear = 0.28	Req'd Min Spacing = 29.0 in o.c.
Total # of Bolts Required =	2	

1/2" ϕ A307 Bolts to steel angle below deck @ 29 in o.c. along short side of curb



For Concrete anchorage: SEISMIC (0.6-0.14S_{DS})D + 0.7Ω_e E Ω_o = 2.0

Concrete Attachment: 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed

Epoxy: Hilti HIT-HY 200 V3 (ICC ESR 4868)

f_c = 3000 psi
 h = 4 in (concrete thickness, t_{min} = h_{ef} + 2do) O.K.
 h_{ef} = 2.75 in (effective embedment)
 da = 0.5 in (anchor diameter) do = 0.625 in (hole diameter)
 n = 2 (number of dummy anchors to check capacity with spacing effect)
 s = 16.9 in (initial spacing estimate)
 tk_{cr} / uncr = 1135 2220 psi (from ESR 4868, Table 14, Temp range B)
 tk_{cr} / uncr = 1156 2261 psi If f'_c > 2500, multiply by (f'_c/2500)^{0.1}
 c_{Na} = 7.15 in (min. edge distance for full capacity); c_{Na} = 10d_a√(τ_{uncr}/1100)

Tension:

$$N_{ag} = \frac{A_{Na}}{A_{Na0}} \phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} N_{ba} \quad (ACI318-14, 17.4.5.1b)$$

Bond strength

$$\phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} = 1.0$$

***Bond strength will govern over concrete breakout

$$A_{Na} = 408.98 \text{ in}^2$$

$$A_{Na0} = 204.49 \text{ in}^2$$

$$N_{ba} = 4943 \text{ lbs}$$

$$N_{ba} = \lambda_a \tau_{cr} \pi d_a h_{ef} \alpha_{n,seismic}$$

$$\alpha_{n,seismic} = 0.99$$

$$N_{ag} = 9886 \text{ lbs (group)}$$

$$\lambda_a = 1.0$$

$$\phi N_{ag} = 4820 \text{ lbs (group)}$$

CONTROLS

$$\lambda_a = 1.0 \text{ for normal weight conc; U.b for light}$$

Breakout strength

$$N_{cbg} = \frac{A_{Nc}}{A_{Nco}} \phi_{ec,N} \phi_{ed,N} \phi_{cp,N} N_b$$

$$N_b = \lambda_a k_c \sqrt{f'_c} h_{ef}^{1.5}$$

$$A_{Nc} = 207.4875 \text{ in}^2$$

$$N_b = 4246 \text{ lbs}$$

$$\phi_{conc} = 0.75$$

$$A_{Nco} = 68.0625 \text{ in}^2$$

$$k_c = 17$$

$$\phi_{bond} = 0.65$$

$$N_{cbg} = 12945 \text{ lbs (group)}$$

$$\phi_{seis} = 0.75$$

$$\phi N_{cbg} = 7281 \text{ lbs (group)}$$

$$\phi_{steel} = 0.65$$

Shear:

$$V_{sa,eq} = 4940 \text{ (from ESR4868, Table 11)}$$

$$\alpha_{v,seismic} = 0.6$$

Steel strength

$$\phi V_{sa,eq} = 1927$$

$$T_{all,LRFD} = 2410 \text{ lbs (anchor)}$$

$$V_{all,LRFD} = 3067 \text{ lbs}$$

$$\alpha = (1 + 0.2SDS)D + 2.5E$$

$$T_{all,ASD} = T_{all,LRFD} / \alpha = 1411 \text{ lbs}$$

$$V_{all,ASD} = V_{all,LRFD} / \alpha = 1796 \text{ lbs}$$

$$D = 0.758 \quad E = 0.242 \quad \alpha = 1.709$$

Transverse: Uplift_{MAX} = 2371 lbs Shear_{MAX} = 990 lbs

$$\text{Compression}_{SEISMIC} = 3032 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Tension}_{SEISMIC} = 2371 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Shear}_{SEISMIC} = 990 \text{ lbs} = \Omega_o * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 1.68 \text{ spacing} = 17.25 \text{ in o.c.} \quad \text{Tapplied} = 1185.4 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 34.50 \text{ in o.c.} \quad \text{Vapplied} = 247.5 \text{ lbs}$$

Try using 2 bolts spaced at 34.50 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.98$ O.K.
---	---

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 34.5 in o.c. max. along long side of curb w/ 2.75in embed

Longitudinal: Uplift_{MAX} = 2077 lbs Shear_{MAX} = 990 lbs

$$\text{Compression}_{SEISMIC} = 2738 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb} / 2] / L_{curb}$$

$$\text{Tension}_{SEISMIC} = 2077 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb} / 2] / L_{curb}$$


$$\text{Shear}_{SEISMIC} = 990 \text{ lbs} = \Omega_o * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 1.47 \text{ spacing} = 14.50 \text{ in o.c.} \quad \text{Tapplied} = 1038.3 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 29.00 \text{ in o.c.} \quad \text{Vapplied} = 247.5 \text{ lbs}$$

Try using 2 bolts spaced at 29.00 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.87$ O.K.
---	---

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 29 in o.c. max. along short side of curb w/ 2.75in embed

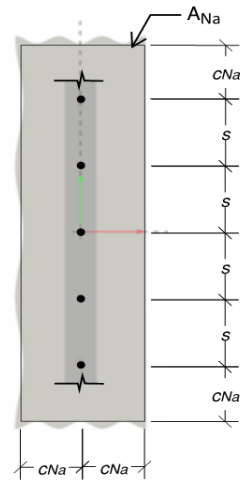

CURB DESIGN SUMMARY:		CBWC-119 LXL	Unit:	ALL P***B MODELS
CURB RAIL THICKNESS:		0.0566 in	16 Gauge	
UNIT CLIP THICKNESS:		0.0566 in	16 Gauge	
# OF CLIPS (LONG SIDE) - 1 clips with 2 - #10 SMS screws each clip				
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip				
# OF CLIPS (SHORT SIDE) - 1 clips with 2 - #10 SMS screws each clip				
WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip				
CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts				
CURB ANCHORAGE	WOOD	1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	STEEL	1/2" φ A307 Bolts to steel angle below deck
	CONCRETE			1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed
LONG DIRECTION		4 @ 12.83 in o.c.		2 @ 34.5 in o.c.
SHORT DIRECTION		3 @ 16.5 in o.c.		2 @ 29 in o.c.