



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

Structural Calculations
for
CBWC-301 Series
CBWCPRL SERIES**



Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: September 25, 2023

Project Number: PV2312

For wood, concrete, and steel attachments, see Roof Anchorage Detail, Form No. CB-60.

STRUCTURALLY CALCULATED WELDED ROOF CURBS FOR DIRECT FIT (SUN CORE) LARGE CABINET UNITS

| PROVENT P/N | A | EST. WEIGHT |
|-------------|-----|-------------|
| CBWCPRL08 | 8" | 168 Lbs. |
| CBWCPRL11 | 11" | 182 Lbs. |
| CBWCPRL14 | 14" | 197 Lbs. |
| CBWCPRL24 | 24" | 245 Lbs. |

ZX08-14; XX08-12; XYA7, ZYA7
ZY07-12; XY07-09; ZL08-14







Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

FEATURES

- Roof curb sides and ends are 16 Ga. galvanized steel.
- Gasketing package provided.
- Heat treated wood nailer provided.
- Insulated deck pans provided.
- Pitched curbs and taller curbs are available.

NOTES

- Attach ductwork to roof curb. Flanges of duct rest on top of curb. Support ductwork below the curb.
- Thru the curbs utilities are available. Contact your York distributor or ProVent directly.

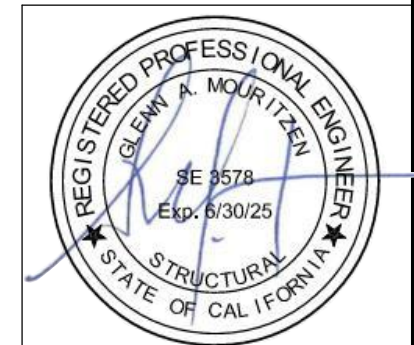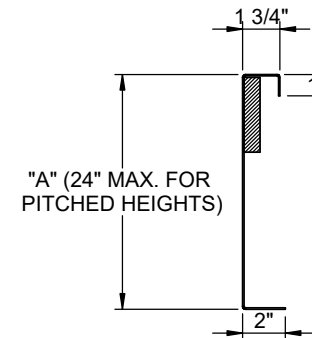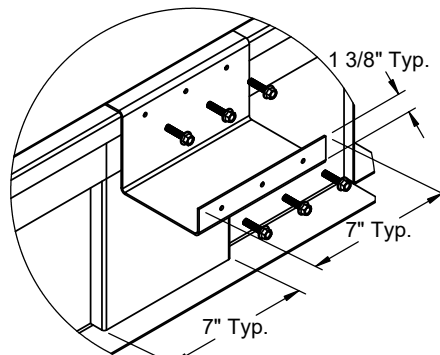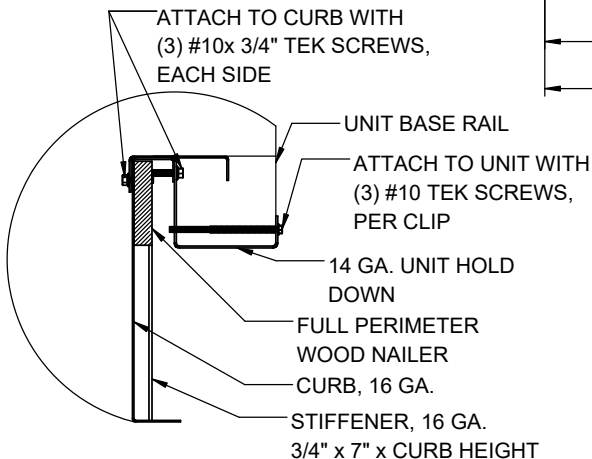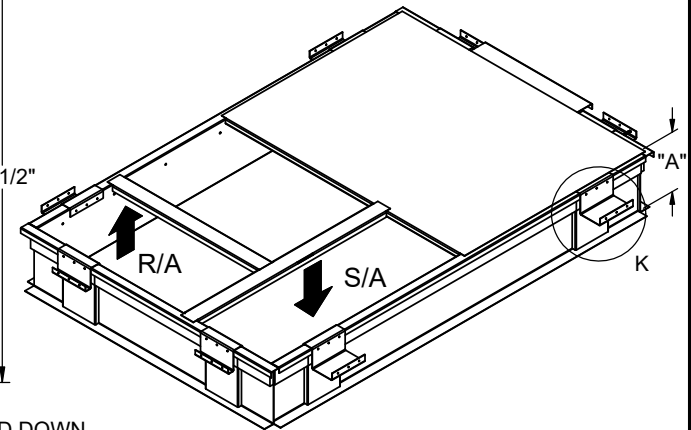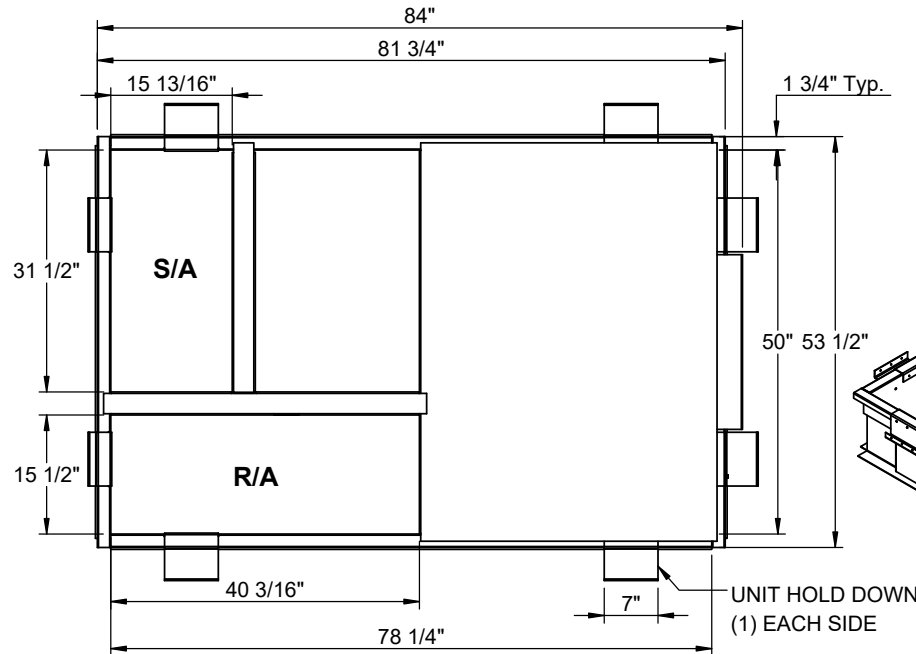

HOLD DOWN DETAIL

DETAIL K

CURB DETAIL



3847 WABASH DR.
MIRA LOMA, CA 91752

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBWC-301

PART NUMBER:
CBWCPRL SERIES


DATE:
7/27/2023

REV:
10

DRAWN BY:
JG

STEEL ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

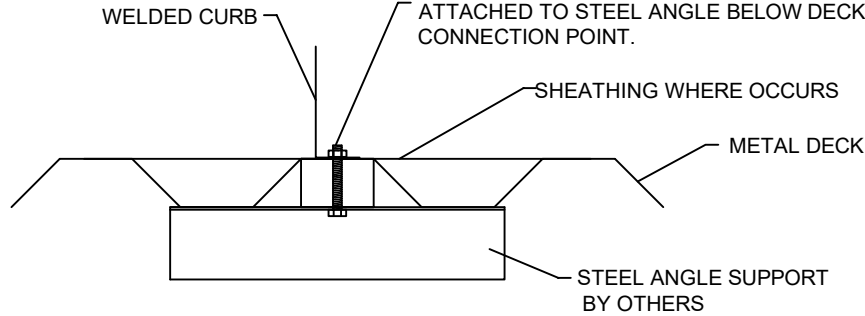

NO. OF ANCHORAGE BOLTS REQUIRED

| CURB | LONG SIDE | SHORT SIDE |
|---------|-----------------|-----------------|
| LXS | 2 @ 34.5" O.C. | 2 @ 19" O.C. |
| LXL | 2 @ 34.5" O.C. | 2 @ 29" O.C. |
| SUN3672 | 2 @ 60.5" O.C. | 2 @ 24.75" O.C. |
| PRD3715 | 2 @ 68.88" O.C. | 2 @ 39" O.C. |
| PRS | 2 @ 58.88" O.C. | 2 @ 28.69" O.C. |
| PRL | 2 @ 72" O.C. | 2 @ 41.5" O.C. |
| SAV1518 | 3 @ 54.56" O.C. | 2 @ 68.13" O.C. |
| SAV2025 | 3 @ 61.56" O.C. | 2 @ 68.13" O.C. |
| SAV28 | 3 @ 69.75" O.C. | 2 @ 68.13" O.C. |

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.

ASSUMES:


CONC SLAB
f_c= 4000PSI MINIMUM
4" MIN THICKNESS
NORMAL WEIGHT CONCRETE
MIN. 7-1/4" EDGE DISTANCE

Meets seismic requirements for the following codes:
CBC 2022
IBC 2021

ROOF ANCHORAGE DETAIL

| CBKD Series | CBWC Series |
|-------------|-------------|
| LXS | LXS |
| LXL | LXL |
| SUN3672 | SUN3672 |
| PRD3715 | PRD3715 |
| PRS | PRS |
| PRL | PRL |
| SAV1518 | SAV1518 |
| SAV2025 | SAV2025 |
| SAV28 | SAV28 |

CONCRETE ATTACHMENT




CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" Ø THREADED ROD IN HILTI HIT-HY 200 V3 EPOXY WITH 2-1/2" EMBED

NO. OF ANCHORAGE BOLTS REQUIRED

| CURB | LONG SIDE | SHORT SIDE |
|---------|-----------------|-----------------|
| LXS | 2 @ 34.5" O.C. | 2 @ 19.0" O.C. |
| LXL | 2 @ 34.5" O.C. | 2 @ 29" O.C. |
| SUN3672 | 2 @ 60.5" O.C. | 2 @ 24.75" O.C. |
| PRD3715 | 4 @ 22.96" O.C. | 2 @ 39" O.C. |
| PRS | 2 @ 58.88" O.C. | 2 @ 28.69" O.C. |
| PRL | 3 @ 36" O.C. | 2 @ 41.5" O.C. |
| SAV1518 | 4 @ 36.38" O.C. | 2 @ 68.13" O.C. |
| SAV2025 | 4 @ 41.04" O.C. | 3 @ 34.06" O.C. |
| SAV28 | 5 @ 34.88" O.C. | 3 @ 34.06" O.C. |

WOOD ATTACHMENT

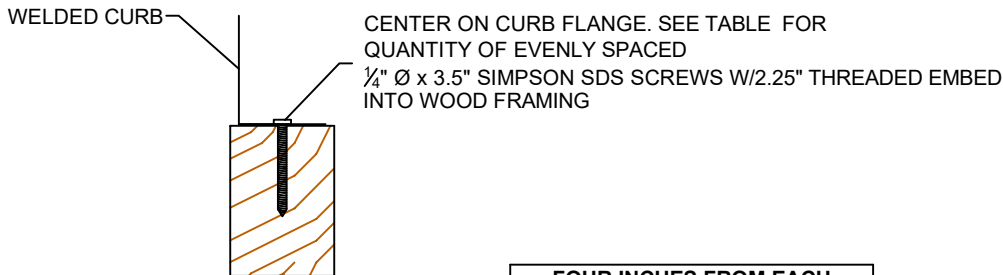

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø x 3.5" SIMPSON SDS SCREWS W/2.25" THREADED EMBED INTO WOOD FRAMING

FOUR INCHES FROM EACH CORNER EVENLY SPACED

NO. OF ANCHORAGE SCREWS REQUIRED

| CURB | LONG SIDE | SHORT SIDE |
|---------|-----------------|-----------------|
| LXS | 4 @ 12.83" O.C. | 3 @ 11.5" O.C. |
| LXL | 4 @ 12.83" O.C. | 3 @ 16.5" O.C. |
| SUN3672 | 4 @ 21.5" O.C. | 3 @ 14.38" O.C. |
| PRD3715 | 7 @ 12.15" O.C. | 5 @ 10.75" O.C. |
| PRS | 4 @ 20.96" O.C. | 3 @ 16.35" O.C. |
| PRL | 6 @ 15.2" O.C. | 4 @ 15.17" O.C. |
| SAV1518 | 6 @ 22.63" O.C. | 5 @ 18.03" O.C. |
| SAV2025 | 7 @ 21.19" O.C. | 5 @ 18.03" O.C. |
| SAV28 | 8 @ 20.5" O.C. | 5 @ 18.03" O.C. |



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
8/28/2023

REV:
10

DRAWN BY:
FMM




| | | |
|--------------|--|--------|
| Client: | ProVent | PV2312 |
| Description: | CBWC-301 | PRL |
| Unit: | ZX, ZL 08-14; XX 08-12; XY/ZY A7; ZY 07-12; XY 07-09 | |

Curb Information

| | | |
|----------------------|---------|------------------|
| Hcurb = | 24 in | (Height of curb) |
| Lcurb = | 84 in | (Length of curb) |
| wcurb = | 53.5 in | (Width of curb) |
| WGTCurb = | 245 lbs | (Weight of curb) |
| # Clips long side = | 2 | |
| # Clips short side = | 2 | |

Unit Information

| | | |
|-----------|----------|-----------------------------|
| WGTunit = | 1318 lbs | (Oper. Weight of Unit) |
| Wtmax = | 395 lbs | (Maximum corner weight) |
| Wtmin = | 280 lbs | (Minimum corner weight) |
| Hunit = | 55.3 in | (Height of unit above curb) |
| Hcm = | 27.65 in | (Height to center of mass) |
| Lunit = | 87.2 in | (Length of unit) |
| Wunit = | 61.7 in | (Width of unit) |

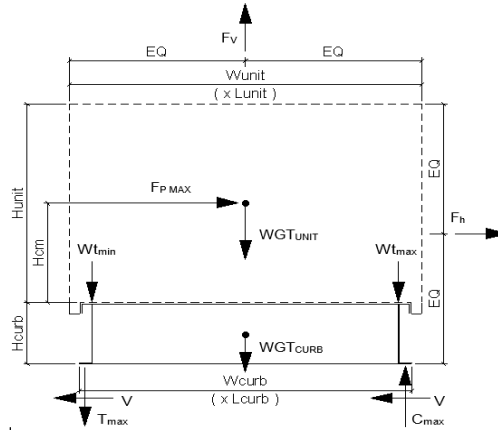

Seismic Loading - 2021 IBC/2022 CBC

| | | |
|------------|-------------|---|
| Ss = | 2.85 | (Worst case for majority of California) |
| Fa = | 1.20 | (Default Site Class D - Table 11.4-1 ASCE 7-16) |
| Ip = | 1.50 | (Importance Factor Category III Building) |
| Sms = | 3.420 | (Fa*Ss) |
| Sds = | 2.280 | (2/3*Sms) |
| Fpmax = | 1.710 Wp | (0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp |
| FpmaxASD = | 1578 lbs | (0.7*Fpmax) |
| | (unit only) | |
| | | ap = 2.5 |
| | | Rp = 6 |
| | | FpmaxASD = 1871 lbs |
| | | (unit and curb) |

Wind Loading - 2021 IBC/2022 CBC

| | | |
|----------------|----------|---|
| Kz = | 1.13 | (For 60 ft roof height, Exposure C - Table 26.10-1 ACSE 7-16) |
| Kzt = | 1.0 | (No topographic effects assumed for rooftop mounted units) |
| Kd = | 0.85 | (Directionality factor Table 26.6-1 ASCE 7-16) |
| V = | 115 | (Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat C, Fig 25.5-1D, ASCE7-16) |
| GCr(horiz) = | 1.9 | (Refer Sect 29.4.1 ASCE 7-16) |
| GCr(vert) = | 1.5 | (Refer Sect 29.4.1 ASCE 7-16) |
| qz = | 32.5 psf | = 0.00256*Kz*Kzt*Kd*V ² (Eq. 26.10-1 ASCE 7-16) |
| Fh ASD trans = | 1780 lbs | = 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2) |
| Fh ASD long = | 1260 lbs | = 0.6*qz*GCr*Wunit*(Hunit+Hcurb) |
| Fvert ASD = | 1093 lbs | = 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3) |

Curb Loading

Transverse:

| | | |
|----------------------------------|----------|--|
| Compression _{SEISMIC} = | 1859 lbs | = [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*wcurb]/wcurb |
| Tension _{SEISMIC} = | 658 lbs | = [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*wcurb]/wcurb |
| Compression _{WIND} = | 848 lbs | = [Fh ASD trans *Hcm + 2*0.6*Wtmax*wcurb - Fvert ASD *wcurb/2]/wcurb |
| Tension _{WIND} = | 1131 lbs | = [Fh ASD trans *Hcm - 2*0.6*Wtmin*wcurb + Fvert ASD *wcurb/2]/wcurb |

---> Negative values indicate opposite load.

Longitudinal:

| | | |
|----------------------------------|----------|---|
| Compression _{SEISMIC} = | 1563 lbs | = [FpmaxASD*Hcm + 2*(1+0.14*SDS)*Wtmax*Lcurb]/Lcurb |
| Tension _{SEISMIC} = | 362 lbs | = [FpmaxASD*Hcm - 2*(0.6-0.14*SDS)*Wtmin*Lcurb]/Lcurb |
| Compression _{WIND} = | 342 lbs | = [Fh ASD long *Hcm + 2*0.6*Wtmax*Lcurb - Fvert ASD *Lcurb/2]/Lcurb |
| Tension _{WIND} = | 625 lbs | = [Fh ASD long *Hcm - 2*0.6*Wtmin*Lcurb + Fvert ASD *Lcurb/2]/Lcurb |

---> Negative values indicate opposite load.

Governing Reactions:

| | | | |
|---|-----------------------|----------|--------------------------------|
| Transverse: (on long edge) | Comp _{MAX} = | 1859 lbs | ---> Along long edge of curb. |
| | Tens _{MAX} = | 1131 lbs | ---> Along long edge of curb. |
| Longitudinal: (on short edge) | Comp _{MAX} = | 1563 lbs | ---> Along short edge of curb. |
| | Tens _{MAX} = | 625 lbs | ---> Along short edge of curb. |


---> Negative values indicate opposite load.

Curb Design

F_y = 50 ksi F_u = 65 ksi
E = 29500 ksi t = 0.0566 **16 Gauge**

Calculate Section Properties of Curb

| | |
|---|--------------------------------------|
| A' = 24.000 in | a = 23.717 in = A' - (2r+t) |
| B' = 1.750 in | a' = 23.943 in = A' - t |
| C' = 0.000 in (0 if no lips) | b = 1.609 in = B' - [r+t/2+α(r+t/2)] |
| α = 0.000 (0 - no Lip; 1 w/ lip) | b' = 1.722 in = B' - (t/2+αt/2) |
| R = 0.0849 (Inside bend radius) | c = 0.000 in = α(C' - (r+t/2)) |
| t = 0.0566 in | c' = 0.000 in = α(C' - t/2) |
| r' = 0.113 in = R+t/2 | u = 0.178 in = πr/2 |
| x = 0.109 in (Distance between centroid and web centerline) | |
| I _x = 91.935 in ⁴ | r _x = 7.71 in |
| I _y = 0.174 in ⁴ | r _y = 0.336 in |
| A = 1.54 in ² | r _{min} = 0.336 in |

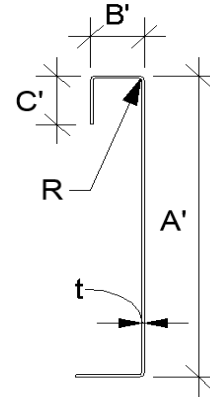

Axial Compression

P_u = 0.890 k (Max Axial Comp) Ω_c = 1.80
P_n/Ω_c = 15.456 k
F_e = 20.54 ksi $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c ≤ 1.5; F_n = (0.658λ_c²) F_y
λ_c = 1.56 $\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c}$ If λ_c > 1.5; F_n = $\frac{0.877}{\lambda_c^2} F_y$ λ_c = $\sqrt{\frac{F_y}{F_e}}$ F_e = $\frac{\pi^2 E}{(kl/r)^2}$
F_n = 18.01 ksi
L_y = 50 in Lateral unbraced length
k_yL_y/r_y = 119 (assume k=0.8)

Compression Check = O.K.

Check Web Crippling

| | | | |
|--------------------------|----------------------|-----------------------|--|
| h = 24 in | -- Check limits: | C = 4.00 | } (See table C3.4.1-2, fastened to support, one flange, end loading) |
| t = 0.0566 in | h/t = 424.03 ≤ 260 | C _R = 0.14 | |
| N = 7.00 | N/t = 123.67 ≤ 210 | C _N = 0.35 | |
| Ω _w = 1.75 | N/h = 0.291667 ≤ 2.0 | C _h = 0.02 | |
| P _n = 1.366 k | R/t = 1.50 ≤ 9.0 | | |

P_n/Ω_w = 0.780 k P_n = C t² F_y sin(90) (1 - C_R $\sqrt{\frac{R}{t}}$) (1 + C_N $\sqrt{\frac{N}{t}}$) (1 - C_h $\sqrt{\frac{h}{t}}$)
Long side: P_uTrans = 0.929 k **web stiffener REQ'D** # clips = 2
Short side: P_uLong = 0.781 k **web stiffener REQ'D** # clips = 2

***h/t > 260; use web stiffeners

Check Web Stiffener

16Ga x 3/4" x 6" (C-channel)
width of stiffener = 6.000 in t_s = 0.0566 **16 Gauge**
web of stiff. w = 5.717 in R_s = 0.0849 in
***Check w/ts ≤ 1.28√E/F_y Ω_c = 1.70
w/ts = 101.007
1.28√(E/F_y) = 31.091 --> w/ts over limit Use C3.7.2
P_n = 0.7(P_{wc} + A_eF_y) ≥ P_{wc}
P_{wc} = 1.366 k A_e = 0.324 in²
P_n = 12.281 k P_n/Ω = 7.224 k

O.K.

Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

T_{crn}max = 468 lbs Max(F_{pmaxASD}/4 -OR- F_{hASDtrans}/4 corner connections)
V_{crn}max = 929 lbs Max(Tens/2 -OR- Comp/2 corner connections per side)
Bolt: Tall = 2480 lbs Vall = 1208 lbs
Threaded Insert: Tall = 2860 lbs Vall = 1536 lbs
of Bolts required for Tension = 0.2
of Bolts required for Shear = 0.8
of Bolts Used = 3.0
Check Combined Stress in Bolts & Inserts: 0.319 **O.K.**

Check 1/8" welded connection

<--- USE WELD Ω = 2.35
Assume L/t > 25: 25*t = 1.415 in P_n/Ω = $\frac{1}{\Omega} 0.75tLF_u \geq V_{req}$ L_{req'd} = $\frac{V_{req}\Omega}{0.75tF_u}$
L_{req'd} = 0.791 in



Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0566$ in

$F_{u1} = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_{u2} = 65$ ksi

$d = 0.190$ in (screw diameter)

$d_w = 0.375$ in (nom. washer diameter)

$t_2/t_1 = 1.8$

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$ Pns = 1887 # 3.86 k

$P_{ns} = 2.7t_1dF_{u1}$ 1.89 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{ns}/\Omega = 629$ #

$P_{ss}/\Omega = 540$ # <- Controls

Tension: $P_{not} = 1.068$ k (screw pull-out strength)

$P_{nov} = 2.069$ k (screw pull-over strength)

$P_{ts}/\Omega = 356$ # <- Controls

$P_{ts}/\Omega = 820$ #

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2.7t_1dF_{u1}$ 1.89 k

$P_{ns} = 2.7t_2dF_{u2}$ 3.39 k

$P_{not} = 0.85t_c dF_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 1.5t_1d_wF_{u1}$

(full tensile screw capacity)

| | Shear (k) | # clips | V_{clip} (k) | V_{allow} (lb) | # screws | spacing |
|-------------|-----------|---------|----------------|------------------|----------|---------|
| Long side: | 1.780 | 2 | 0.89 | 540 # | 2 | 6.00 in |
| Short side: | 1.578 | 2 | 0.79 | 540 # | 2 | 6.00 in |

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.57 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

$F_y = 50$ ksi

$A_{gv} = 0.368$ in²

$R_n/\Omega = 5.954$ k

thinnest part = 0.0566 AISI BSR applies

$\Omega = 2.22$ bolt/screw connection


$A_{nv} = 0.352$ in²

$R_n = 0.6F_yA_{gv} + F_uA_{nt} \leq 0.6F_uA_{nv} + F_uA_{nt}$

$A_{nt} = 0.034$ in²

(AISI Sect. E5.3)

BSR O.K.

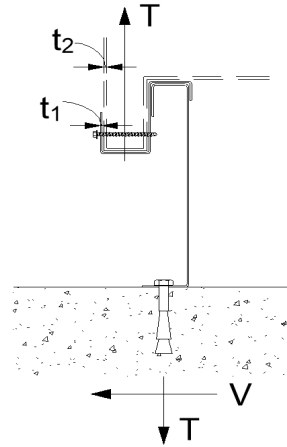

Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: $(0.6-0.14S_{DS})D + 0.7E$

WIND: $0.6D + W$

| Transverse: | Uplift _{MAX} = | 1796 lbs | Shear _{MAX} = | 935 lbs |
|----------------------------------|-------------------------|--|------------------------|---------|
| Compression _{SEISMIC} = | 2837 lbs | = $[F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}$ | | |
| Tension _{SEISMIC} = | 1587 lbs | = $[F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*w_{curb}/2]/w_{curb}$ | | |
| Compression _{WIND} = | 1641 lbs | = $[F_{hASDtrans}*(H_{cm}+H_{curb})+0.6*WGT_{unit+curb}*w_{curb}/2-F_{vertASD}*w_{curb}/2]/w_{curb}$ | | |
| Tension _{WIND} = | 1796 lbs | = $[F_{hASDtrans}*(H_{cm}+H_{curb})-0.6*WGT_{unit+curb}*w_{curb}/2+F_{vertASD}*w_{curb}/2]/w_{curb}$ | | |
| Longitudinal: | Uplift _{MAX} = | 931 lbs | Shear _{MAX} = | 935 lbs |
| Compression _{SEISMIC} = | 2181 lbs | = $[F_{pmaxASD}*(H_{cm}+H_{curb})+(1+0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}$ | | |
| Tension _{SEISMIC} = | 931 lbs | = $[F_{pmaxASD}*(H_{cm}+H_{curb})-(0.6-0.14S_{DS})*WGT_{unit+curb}*L_{curb}/2]/L_{curb}$ | | |
| Compression _{WIND} = | 697 lbs | = $[F_{hASDlong}*(H_{cm}+H_{curb})+0.6*WGT_{unit+curb}*L_{curb}/2-F_{vertASD}*L_{curb}/2]/L_{curb}$ | | |
| Tension _{WIND} = | 852 lbs | = $[F_{hASDlong}*(H_{cm}+H_{curb})-0.6*WGT_{unit+curb}*L_{curb}/2+F_{vertASD}*L_{curb}/2]/L_{curb}$ | | |

Wood Attachment: **1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded emb (SGmin = 0.43)**

| Transverse: | Tall _{metal} = | 797 lbs | Vall _{metal} = | 876 lbs |
|-------------|--------------------------------|---------|-------------------------|--------------|
| | Tall _{wood} = | 616 lbs | Vall _{wood} = | 400 lbs |
| | # of Screws Req'd for Uplift = | 2.92 | COMBINED LOADING: | 0.876 O.K. |
| | # of Screws Req'd for Shear = | 2.34 | Screw Spacing = | 15.2 in o.c. |
| | Total # of screws Required = | 6 | | |

1/4" φ x 3.5" Simpson SDS screws @ 15.2 in o.c. along long side of curb w/ 2.25" threaded embed

| Longitudinal: | # of Screws Req'd for Uplift = | 1.5 | COMBINED LOADING: | 0.962 O.K. |
|---------------|--------------------------------|-----|-------------------|--------------|
| | # of Screws Req'd for Shear = | 2.3 | Screw Spacing = | 15.2 in o.c. |
| | Total # of screws Required = | 4 | | |

1/4" φ x 3.5" Simpson SDS screws @ 15.2 in o.c. along short side of curb w/ 2.25" threaded embed

Steel Deck Attachment:

1/2" φ A307 Bolts to steel angle below deck

| Transverse: | Tall _{bolt} = | 3927 lbs | Vall _{bolt} = | 2209 lbs |
|-------------|-------------------------------|----------|-------------------------|--------------|
| | Tall _{metal} = | 1656 lbs | Vall _{metal} = | 1756 lbs |
| | # of Bolts Req'd for Uplift = | 1.08 | COMBINED LOADING: | 0.471 O.K. |
| | # of Bolts Req'd for Shear = | 0.53 | Bolt Spacing = | 72.0 in o.c. |
| | Total # of Bolts Required = | 2 | | |

1/2" φ A307 Bolts to steel angle below deck @ 72 in o.c. along long side of curb

| Longitudinal: | # of Bolts Req'd for Uplift = | 0.56 | COMBINED LOADING: | 0.231 O.K. |
|---------------|-------------------------------|------|---------------------|--------------|
| | # of Bolts Req'd for Shear = | 0.53 | Req'd Min Spacing = | 41.5 in o.c. |
| | Total # of Bolts Required = | 2 | | |

1/2" φ A307 Bolts to steel angle below deck @ 41.5 in o.c. along short side of curb



For Concrete anchorage: SEISMIC (0.6-0.14S_{DS})D + 0.7Ω_e, E Ω_o = 2.0

Concrete Attachment: 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed

Epoxy: Hilti HIT-HY 200 V3 (ICC ESR 4868)

f_c = 3000 psi
 h = 4 in (concrete thickness, t_{min} = h_{ef} + 2do) O.K.
 h_{ef} = 2.75 in (effective embedment)
 da = 0.5 in (anchor diameter) do = 0.625 in (hole diameter)
 n = 2 (number of dummy anchors to check capacity with spacing effect)
 s = 16.9 in (initial spacing estimate)
 tk_{cr} / uncr = 1135 2220 psi (from ESR 4868, Table 14, Temp range B)
 tk_{cr} / uncr = 1156 2261 psi If f'_c > 2500, multiply by (f'_c/2500)^{0.1}
 c_{Na} = 7.15 in (min. edge distance for full capacity); c_{Na} = 10d_a√(τ_{uncr}/1100)

Tension:

$$N_{ag} = \frac{A_{Na}}{A_{Na0}} \phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} N_{ba} \quad (ACI318-14, 17.4.5.1b)$$

Bond strength

$$\phi_{ec,Na} \phi_{ed,Na} \phi_{cp,Na} = 1.0$$

***Bond strength will govern over concrete breakout

$$A_{Na} = 408.98 \text{ in}^2$$

$$A_{Na0} = 204.49 \text{ in}^2$$

$$N_{ba} = 4943 \text{ lbs} \quad N_{ba} = \lambda_a \tau_{cr} \pi d_a h_{ef} \alpha_{n,seismic}$$

$$N_{ag} = 9886 \text{ lbs (group)}$$

$$\phi N_{ag} = 4820 \text{ lbs (group)}$$

CONTROLS

$$\alpha_{n,seismic} = 0.99$$

$$\lambda_a = 1.0$$

$$\lambda_a = 1.0 \text{ for normal weight conc; U.b for light}$$

Breakout strength

$$N_{cbg} = \frac{A_{Nc}}{A_{Nco}} \phi_{ec,N} \phi_{ed,N} \phi_{cp,N} N_b$$

$$N_b = \lambda_a k_c \sqrt{f'_c} h_{ef}^{1.5}$$

$$A_{Nc} = 207.4875 \text{ in}^2$$

$$A_{Nco} = 68.0625 \text{ in}^2$$

$$N_{cbg} = 12945 \text{ lbs (group)}$$

$$\phi N_{cbg} = 7281 \text{ lbs (group)}$$

$$N_b = 4246 \text{ lbs}$$

$$k_c = 17$$

$$\phi_{conc} = 0.75$$

$$\phi_{bond} = 0.65$$

$$\phi_{seis} = 0.75$$

$$\phi_{steel} = 0.65$$

Shear:

$$V_{sa,eq} = 4940 \text{ (from ESR4868, Table 11)}$$

$$\alpha_{v,seismic} = 0.6$$

Steel strength

$$\phi V_{sa,eq} = 1927$$

$$T_{all,LRFD} = 2410 \text{ lbs (anchor)}$$

$$V_{all,LRFD} = 3067 \text{ lbs}$$

$$\alpha = (1 + 0.2SDS)D + 2.5E$$

$$T_{all,ASD} = T_{all,LRFD} / \alpha = 1411 \text{ lbs}$$

$$V_{all,ASD} = V_{all,LRFD} / \alpha = 1796 \text{ lbs}$$

$$D = 0.758 \quad E = 0.242 \quad \alpha = 1.709$$

Transverse: Uplift_{MAX} = 3393 lbs Shear_{MAX} = 1871 lbs

$$\text{Compression}_{SEISMIC} = 4643 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Tension}_{SEISMIC} = 3393 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb} / 2] / w_{curb}$$

$$\text{Shear}_{SEISMIC} = 1871 \text{ lbs} = \Omega_o * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 2.40 \text{ spacing} = 36.00 \text{ in o.c.} \quad \text{Tapplied} = 1131.0 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 72.00 \text{ in o.c.} \quad \text{Vapplied} = 374.2 \text{ lbs}$$

Try using 3 bolts spaced at 36.00 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.01$ O.K.

Use 3 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 36 in o.c. max. along long side of curb w/ 2.75in embed

Longitudinal: Uplift_{MAX} = 2081 lbs Shear_{MAX} = 1871 lbs

$$\text{Compression}_{SEISMIC} = 3332 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb} / 2] / L_{curb}$$

$$\text{Tension}_{SEISMIC} = 2081 \text{ lbs} = [\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb} / 2] / L_{curb}$$


$$\text{Shear}_{SEISMIC} = 1871 \text{ lbs} = \Omega_o * F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 1.48 \text{ spacing} = 20.75 \text{ in o.c.} \quad \text{Tapplied} = 1040.7 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 2.00 \text{ spacing} = 41.50 \text{ in o.c.} \quad \text{Vapplied} = 374.2 \text{ lbs}$$

Try using 2 bolts spaced at 41.50 in o.c. COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.95$ O.K.

Use 2 - 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy @ 41.5 in o.c. max. along short side of curb w/ 2.75in embed

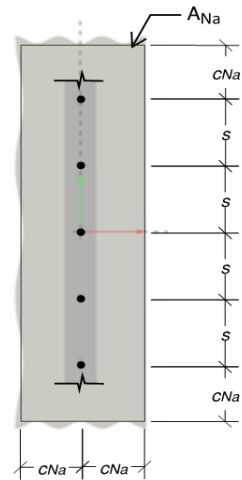

| CURB DESIGN SUMMARY: | | Unit: |
|--|--|--|
| CURB RAIL THICKNESS: 0.0566 in 16 Gauge | | ZX, ZL 08-14; XX 08-12; XY/ZY A7; |
| UNIT CLIP THICKNESS: 0.0566 in 16 Gauge | | ZY 07-12; XY 07-09 |
| # OF CLIPS (LONG SIDE) - 2 clips with 2 - #10 SMS screws each clip | | |
| WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip | | |
| # OF CLIPS (SHORT SIDE) - 2 clips with 2 - #10 SMS screws each clip | | |
| WEB STIFFENER: 16Ga x 3/4" x 6" (C-channel) stiffener at each clip | | |
| CORNER CONNECTION: Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts | | |
| CURB ANCHORAGE | WOOD | STEEL |
| | 1/4" φ x 3.5" Simpson SDS screws w/ 2.25" threaded embed | 1/2" φ A307 Bolts to steel angle below deck |
| | | CONCRETE |
| | | 1/2" φ HAS rods in Hilti HIT-HY 200 V3 epoxy w/ 2.75in embed |
| LONG DIRECTION | 6 @ 15.2 in o.c. | 2 @ 72 in o.c. |
| SHORT DIRECTION | 4 @ 15.17 in o.c. | 2 @ 41.5 in o.c. |